

# SHELLHARBOUR CITY COUNCIL

## WATER SENSITIVE URBAN DESIGN (WSUD)

### STANDARD DRAWINGS

#### DRAWING SCHEDULE

DRAWING SHEET	DRAWING TITLE
01	COVER SHEET
02	BIORETENTION - STANDARD NOTES
03	BIORETENTION - GENERAL ARRANGEMENT
04	BIORETENTION - DETAILS
05	BIORETENTION - SMALL BIORETENTION SYSTEMS
06	BIORETENTION - INLET DIVERSION STRUCTURES
07	BIORETENTION - INLET STRUCTURES
08	BIORETENTION - OUTLET STRUCTURES
09	BIORETENTION - OUTLET SCOUR PROTECTION
10	BIORETENTION - RAINGARDEN SYSTEM LESS THAN 30m <sup>2</sup>
11	BIORETENTION - WITHIN FLOOD DETENTION BASIN
12	BIORETENTION - LANDSCAPING
13	BIORETENTION - CONSTRUCTION WORKS STAGING - 1
14	BIORETENTION - CONSTRUCTION WORKS STAGING - 2
15	VEGETATED SWALES - FLAT SITES
16	VEGETATED SWALES - STEEP SITES
17	POROUS PAVING
18	BIORETENTION - TOWN CENTRES
19	TREE PIT BIORETENTION - STREET
20	OSD - REQUIREMENTS
21	OSD - ABOVE GROUND STORAGE
22	OSD - UNDERGROUND STORAGE
23	OSD - COMBINED OSD & FILTER CARTRIDGES
24	OSD - DEEMED TO COMPLY SOLUTION
25	RAINWATER TANKS - CHARGED LINE SYSTEMS & MUSIC MODELLING REQUIREMENTS

#### GENERAL NOTES

- A THE PURPOSE OF THESE DRAWINGS IS TO PROVIDE GENERAL DESIGN GUIDANCE ON KEY DETAILS HOWEVER THEY ARE NOT A STANDALONE DESIGN RESOURCE.
- B THE FOLLOWING SET OF DRAWINGS ARE DUPLICATED FROM THE BLACKTOWN CITY COUNCIL WSUD DRAWINGS, AND ADOPTED FOR USE IN THE SHELLHARBOUR CITY COUNCIL LGA.
- C THESE DRAWINGS ARE INTENDED TO PROVIDE A LIST OF COMPLYING SOLUTIONS THAT COUNCIL ACCEPTS. THEY SHALL NOT BE USED TO STIFLE INNOVATION OR REPLACE SOUND ENGINEERING JUDGEMENT. ALTERNATIVE SOLUTIONS WILL BE ADDRESSED BY COUNCIL ON A MERITS BASED APPROACH.
- D WHERE THERE IS A CLASH BETWEEN THESE DRAWINGS AND COUNCIL'S BIORETENTION SPECIFICATION, THE CONTRACTOR SHALL SEEK CLARIFICATION FROM COUNCIL.
- E THE STANDARD DRAWINGS SHOWN HEREIN MAY REQUIRE MODIFICATION TO SUIT LOCAL TOPOGRAPHY, SOILS, LANDSCAPE, SERVICES & SITE CONDITIONS. DESIGNS SHOULD INTEGRATE TREATMENT SYSTEMS INTO THE SURROUNDING LANDSCAPE.
- F WSUD SYSTEMS WITH STRUCTURAL ELEMENTS (e.g. RETAINING WALLS) REQUIRE SITE SPECIFIC STRUCTURAL DESIGN INPUT.
- G ALL WATER QUALITY AND QUANTITY MANAGEMENT MEASURES SHALL BE DESIGNED TO ENSURE:
  - EASE OF MAINTENANCE
  - ACCESS FOR MAINTENANCE
  - SAFE WORK PRACTICES
  - PUBLIC SAFETY AND HEALTH
  - COMPLIANCE WITH DESIGN CRITERIA

#### REFERENCES

- ADOPTION GUIDELINES FOR STORMWATER BIOFILTRATION SYSTEMS (CRCWSC, 2015)
- WATER BY DESIGN 2014 "BIORETENTION TECHNICAL DESIGN GUIDE"
- CATCHMENTS & CREEKS, FACT SHEETS (VARIOUS)

#### ABBREVIATIONS

NSL - NATURAL SURFACE LEVEL	CL - COVER LEVEL
FSL - FINISHED SURFACE LEVEL	RL - REDUCED LEVEL
U/S - UPSTREAM	RCP - REINFORCED CONCRETE PIPE
D/S - DOWNSTREAM	NTS - NOT TO SCALE
IL - INVERT LEVEL	EDD - EXTENDED DETENTION DEPTH
RRJ - RUBBER RING JOINT	HGL - HYDRAULIC GRADE LINE
UNO - UNLESS NOTED OTHERWISE	NOM - NOMINAL
TYP - TYPICAL	TWL - TOP WATER LEVEL
EY - EXCEEDANCES PER YEAR	K <sub>SAT</sub> - SATURATED HYDRAULIC CONDUCTIVITY RATE
HDPE - HIGH DENSITY POLYETHYLENE	
PSD - PARTICLE SIZE DISTRIBUTION	

NOT TO SCALE	LIST OF REVISIONS	AMENDMENT DETAILS	APPROVED - Manager Technical Services	LOCATIONS	SERVICES	LEGEND	ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet & College Avenue)	POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529	PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE	PLAN DETAILS	FILE:	REVISION
	REV. DATE OFFICER		DATE:	Services shown are those known to exist at date of design. Prior to commencement of excavation contact the relevant gas, electricity, water and telecommunications service providers, including the RMS, for most recent service locations and precautions that may be necessary	Gas: --- G --- Electricity: --- E --- Water: --- W --- Sewer: --- S --- TelComm Local Cable: --- T --- TelComm Major or Optic Fibre: --- MOF ---					SCC STANDARD DRAWING	SCC COVER SHEET	
SURVEYED OFFICER: DATE: SURVEY MARKS:			DESIGNED: DATE: DRAWN: DATE:	SEDIMENT AND EROSION CONTROL Provide sediment and erosion control measures in accordance with the 'Erosion & Sediment Control' guide by the NSW Office of Environment & Heritage							PLAN No:	SHEET: 1/25

BIORETENTION SYSTEMS ARE FULLY VEGETATED FILTERS. THE ABILITY OF A BIORETENTION SYSTEM TO DETAIN AND INFILTRATE INCOMING STORMWATER IS A FUNCTION OF THE FILTER SURFACE AREA, EXTENDED DETENTION (PONDING) DEPTH, INFILTRATION RATE OF THE SURFACE AND THE HYDRAULIC CONDUCTIVITY OF THE FILTER MEDIA.

SHELLHARBOUR CITY COUNCIL REQUIRES 'SATURATED SYSTEMS'. THE CONFIGURATION OF THE OUTLET IS SUCH THAT THE SYSTEM RETAINS WATER IN A 'SATURATED' ZONE. THIS IMPROVES WATER TREATMENT THROUGH BETTER PLANT SURVIVAL. THE RECOMMENDED MINIMUM DEPTH OF THIS ZONE IS 400mm, IN LARGE SYSTEMS THE TOP OF THE SATURATED ZONE SHOULD BE 200mm BELOW THE BOTTOM OF THE FILTER MEDIA LAYER, WITHIN THE TRANSITION LAYER. THIS MAY BE REDUCED IN SMALL SYSTEMS SUBJECT TO HGL CALCULATIONS.

SATURATED SYSTEMS MUST BE LINED TO PREVENT EXFILTRATION & RETAIN WATER.

### MEDIA PROPERTIES

A TYPICAL BIORETENTION SYSTEM HAS 3 LAYERS; A DRAINAGE LAYER, A TRANSITION LAYER AND THE FILTER MEDIA LAYER. GEOFABRIC IS NOT TO BE PLACED BETWEEN THE LAYERS OF MEDIA, OR SOCKS PLACED ON SUB-SOIL DRAINAGE.

THE MEDIA SHOULD BE PLACED IN LIFTS NO DEEPER THAN 250mm THICK AND LIGHTLY COMPACTED. A MAXIMUM OF ONE PASS WITH A SMALL VIBRATING COMPACTOR OR EQUIVALENT. EQUIPMENT SHOULD NOT BE USED FOR MEDIA PLACEMENT THAT WOULD INADVERTANTLY COMPACT THE LAYERS AND AFFECT THE INFILTRATION RATES OF WATER THROUGH THE MEDIA.

### FILTER MEDIA SPECIFICATIONS

THE FILTER MEDIA IS THE TOP LAYER AND THE GROWING MEDIUM. MEDIA SHALL BE IN ACCORDANCE WITH THE PROPERTIES LISTED IN TABLE 3 ADOPTION GUIDELINES FOR STORMWATER BIOFILTRATION SYSTEMS (CRC FOR WSC, 2015). AS MODIFIED BELOW:

<b>DEPTH</b>	500mm TYP BUT VARIES DEPENDING ON SYSTEM SCALE AND SIZE																														
<b>MATERIAL</b>	EITHER AN ENGINEERED MATERIAL - A WASHED, WELL GRADED SAND - OR NATURALLY OCCURRING SAND, A MIXTURE IS PERMITTED. IT SHOULD BE FREE OF RUBBISH AND WEEDS AND NOT BE HYDROPHOBIC. AN APPROVED FILTER MEDIA IS THE (M165) MEDIA FROM BENEDICT SAND AND GRAVEL OR APPROVED EQUIVALENT.																														
<b>HYDRAULIC CONDUCTIVITY</b>	HYDRAULIC CONDUCTIVITY: A TARGET, AS BUILT OR IN-SITU SATURATED HYDRAULIC CONDUCTIVITY RATE OF THE FILTER MEDIA SHALL BE A MINIMUM OF 100mm/Hr. THE EX-SITU (EX BIN) RATE SHALL BE A MINIMUM OF 250mm/Hr AND VERIFIED, WITH INDEPENDENT NATA REGISTERED LABORATORY TEST DATA NO LONGER THAN ONE MONTH OLD. FOR ALL MUSIC MODELS ADOPT THE IN-SITU RATE OF 100mm/Hr. TESTING OF MEDIA SHALL CONFORM TO ASTM-F1815-11. EVERY 100m <sup>3</sup> OF MEDIA SHALL BE TESTED FOR COMPLIANCE WITH ALL SPECIFIED CRITERIA IN THIS TABLE.																														
<b>PH</b>	5.5 - 7 AS SPECIFIED FOR "NATURAL SOILS AND BLENDS" (PH : IN WATER)																														
<b>ELECTRICAL CONDUCTIVITY</b>	<1.2 DS/M AS SPECIFIED FOR "NATURAL SOILS AND BLENDS"																														
<b>NUTRIENT CONTENT</b>	LOW NUTRIENT CONTENT TOTAL NITROGEN (TN) < 1000 mg/kg NITROGEN DRAWDOWN > 0.5 (NDI) AVAILABLE PHOSPHATE (COLWELL) < 80mg/kg ORTHOPHOSPHATE < 40 mg/kg (IN BOTH STANDARD OR SATURATED SYSTEMS)																														
<b>GRADING OF PARTICLES</b>	SMOOTH GRADING - ALL PARTICLE SIZE CLASSES SHOULD BE REPRESENTED ACROSS SIEVE SIZES FROM THE 0.05mm TO THE 3.4mm SIEVE AS PER ASTM F 1632-03 (2010). <table border="1"> <thead> <tr> <th colspan="3">ACCEPTABLE RANGE</th> </tr> <tr> <th></th> <th>(%W/W)</th> <th>RETAINED</th> </tr> </thead> <tbody> <tr> <td>CLAY &amp; SILT</td> <td>&lt; 3%</td> <td>(&lt; 0.05 mm)</td> </tr> <tr> <td>VERY FINE SAND</td> <td>5-30%</td> <td>(0.05 - 0.15 mm)</td> </tr> <tr> <td>FINE SAND</td> <td>10-30%</td> <td>(0.15 - 0.25 mm)</td> </tr> <tr> <td>MEDIUM SAND</td> <td>40-60%</td> <td>(0.25 - 0.5 mm)</td> </tr> <tr> <td>COARSE SAND</td> <td>&lt; 25%</td> <td>(0.5 - 1.0 mm)</td> </tr> <tr> <td>VERY COARSE SAND</td> <td>0-10%</td> <td>(1.0 - 2.0 mm)</td> </tr> <tr> <td>FINE GRAVEL</td> <td>&lt; 3%</td> <td>(2.0 - 3.4 mm)</td> </tr> <tr> <td>ORGANIC CONTENT</td> <td>≤ 5%</td> <td></td> </tr> </tbody> </table> IMMEDIATELY PRIOR TO DELIVERY TO SITE A PSD TEST (AS1141) SHALL BE UNDERTAKEN. IF THE PSD DOES NOT COMPLY A HYDRAULIC CONDUCTIVITY TEST SHALL BE UNDERTAKEN. DELIVERY SHALL NOT BE APPROVED UNTIL THE MEDIA IS APPROVED. THERE SHOULD BE NO GAP IN THE PARTICLE SIZE GRADING AND THE COMPOSITION SHOULD NOT BE DOMINATED BY A SMALL PARTICLE SIZE RANGE. ORGANIC MATTER CONTENT SHALL BE 3% TO 5% TO SUPPORT VEGETATION.	ACCEPTABLE RANGE				(%W/W)	RETAINED	CLAY & SILT	< 3%	(< 0.05 mm)	VERY FINE SAND	5-30%	(0.05 - 0.15 mm)	FINE SAND	10-30%	(0.15 - 0.25 mm)	MEDIUM SAND	40-60%	(0.25 - 0.5 mm)	COARSE SAND	< 25%	(0.5 - 1.0 mm)	VERY COARSE SAND	0-10%	(1.0 - 2.0 mm)	FINE GRAVEL	< 3%	(2.0 - 3.4 mm)	ORGANIC CONTENT	≤ 5%	
ACCEPTABLE RANGE																															
	(%W/W)	RETAINED																													
CLAY & SILT	< 3%	(< 0.05 mm)																													
VERY FINE SAND	5-30%	(0.05 - 0.15 mm)																													
FINE SAND	10-30%	(0.15 - 0.25 mm)																													
MEDIUM SAND	40-60%	(0.25 - 0.5 mm)																													
COARSE SAND	< 25%	(0.5 - 1.0 mm)																													
VERY COARSE SAND	0-10%	(1.0 - 2.0 mm)																													
FINE GRAVEL	< 3%	(2.0 - 3.4 mm)																													
ORGANIC CONTENT	≤ 5%																														

TO AVOID MIGRATION OF THE FILTER MEDIA INTO THE TRANSITION LAYER THE PARTICLE SIZE DISTRIBUTION SHOULD BE ASSESSED TO MEET BRIDGING CRITERIA. THE SMALLEST 15% (D15) OF THE TRANSITION LAYER PARTICLES MUST BE NO GREATER THAN 5 TIMES THE SIZE OF THE LARGEST 15% (D85) OF THE FILTER MEDIA PARTICLES. THAT IS:

D15(TRANSITION) ≤ 5 x D85(FILTER)

ALTERNATIVE MEDIA MAY BE APPROVED AT THE DISCRETION OF COUNCIL. AS A MINIMUM DETAILED MATERIAL TESTING AND DEMONSTRATED PERFORMANCE WILL BE REQUIRED. IF ANY RECYCLED MATERIAL IS TO BE USED IT MUST BE DEMONSTRATED AT THE CONTRACTOR'S EXPENSE THAT THE MATERIAL IS BOTH INERT AND FREE OF CONTAMINANTS.

THE CONTRACTOR SHALL ARRANGE FOR IN-SITU TESTING OF THE SPECIFIED HYDRAULIC CONDUCTIVITY AT A RATE OF 2 TESTS PER 50m<sup>2</sup> OR PART OF & 1 TEST PER 200m<sup>2</sup> THEREAFTER OF FILTER MEDIA AREA FOR COMPLIANCE WITH THE ABOVE SPECIFICATION.

### BATTERS:

BATTERS SHALL BE SCARIFIED WITH A ROTARY HOE. A SOIL FERTILITY REPORT SHALL BE UNDERTAKEN BY A NATA REGISTERED LAB AND QUALIFIED HORTICULTURIST / SOIL SCIENTIST. BATTERS SHALL BE AMELIORATED TO IMPROVE FERTILITY IN ACCORDANCE WITH SOIL FERTILITY REPORT.

ALTERNATIVELY REMOVE TOP 200mm OF TOPSOIL AND REPLACE WITH AN IMPORTED TOPSOIL COMPLIANT WITH AS4419.

### TRANSITION LAYER (MIDDLE) SPECIFICATION

THE PURPOSE OF THE TRANSITION LAYER IS TO PREVENT THE MIGRATION OF THE FILTER MEDIA INTO THE DRAINAGE LAYER. IT CREATES A LAYER BETWEEN THE FILTER MEDIA AND THE DRAINAGE LAYER. THE LAYER DEPTH IS TO BE A MIN OF 400mm THICK, IN A SATURATED SYSTEM.

THE MATERIAL MUST BE CLEAN, WELL GRADED SAND/COARSE MATERIAL CONTAINING LITTLE OR NO FINES. USE OF WELL WASHED RECYCLED GLASS IS ACCEPTABLE. AN INDICATIVE PARTICLE SIZE DISTRIBUTION IS BETWEEN 0.5mm AND 1.4mm. FINE PARTICLE CONTENT <2%. IN ADDITION TO BRIDGING CRITERIA, THE D15 (TRANSITION) ≥ D15 (FILTER) x 5, THIS CRITERIA ENSURES GREATER HYDRAULIC CONDUCTIVITY OF THE TRANSITION LAYER THAN THE MEDIA.

THE CONTRACTOR SHALL ARRANGE FOR TESTING OF THE PSD & COMPLIANCE WITH BRIDGING CRITERIA & HYDRAULIC CONDUCTIVITY OF A RATE OF 1 TEST PER 1000m<sup>2</sup> OF FILTER MEDIA AREA.

### DRAINAGE LAYER SPECIFICATION

THIS LAYER COLLECTS STORES AND CONVEYS TREATED STORMWATER INTO A SLOTTED COLLECTION PIPE BEDDED INTO THE DRAINAGE LAYER. IT CONSISTS OF A CLEAN GRAVEL 5-7mm WASHED SCREENINGS (NOT SCORIA). THE LAYER DEPTH SHALL MAINTAIN A MINIMUM 50mm COVER OVER THE SUB SURFACE DRAINAGE PIPE. RECYCLED CONCRETE OR BRICK PRODUCTS WILL NOT BE ACCEPTED.

BRIDGING CRITERIA AS FOLLOWS APPLIES: THE D15 (DRAINAGE LAYER) ≤ 5 x D85 (TRANSITION LAYER)  
HYDRAULIC CONDUCTIVITY CRITERIA APPLIES AS FOLLOWS: THE D15 (DRAINAGE LAYER) ≥ D15 (TRANSITION) x 5

THE CONTRACTOR SHALL ARRANGE FOR TESTING OF THE PSD & COMPLIANCE WITH BRIDGING CRITERIA & HYDRAULIC CONDUCTIVITY OF A RATE OF 1 TEST PER 1000m<sup>2</sup> OF FILTER MEDIA AREA & AND MINIMUM OF 1 TEST.

### SUB SURFACE DRAINAGE PIPES

SYSTEMS > 60m LONG NEED INTERMEDIATE FLUSHING POINTS AND RISERS. THE PIPES WITHIN THE BIORETENTION SYSTEM SHOULD BE A MINIMUM 90mm (UNO) DIAMETER UPVC SLOTTED PIPE (CONSISTENT WITH AS/NZS 1254) WITH MINIMUM 1,500mm<sup>2</sup> OPENINGS/M. JOINTS TO BE RUBBER RING JOINT, BENDS SHOULD BE 45° TO ENSURE THAT THE PIPE CAN BE FLUSHED. SLOTS SHALL BE A MAXIMUM OF 4MM WIDE.

CORRUGATED PLASTIC PIPE (I.E. 'AG' PIPE) IS NOT ACCEPTABLE DUE TO THE RISK OF COMPRESSION FAILURE AND ROOT PENETRATION. THE PIPES SHALL BE:

1. SPACED AT A MAXIMUM OF 3m CENTRES.
2. DESIGNED TO CONVEY A MINIMUM FLOW OF 4.45L/S/100m<sup>2</sup> OF FILTER AREA. THIS WAS CALCULATED USING DARCY'S LAW AND ASSUMED EDD OF 0.3m AND FILTER MEDIA DEPTH OF 0.5m AND KSAT OF 100mm/Hr.

FOR LARGE SYSTEMS, THE STANDARD DRAWINGS ADOPT DIA 150mm PIPES SPACED AT 3m CENTRES WHICH MEETS THIS CRITERIA. FOR SMALLER SYSTEMS DIA 90mm PIPES MY BE USED SUBJECT TO CONFIRMATION THE HGL REMAINS BELOW THE FILTER MEDIA (AT MAXIMUM DESIGN FLOW). HGL CALCULATIONS SHALL CONSIDER DEPTH OF WEIR FLOW (REFER DETAIL 11 & 13 SHEET 8), FRICTION & FITTING LOSSES ALONG THE LENGTH OF THE SUBSOIL DRAINAGE PIPE. ASSUME 50% OF THE DESIGN FLOW CONVEYED AT MID POINT OF PIPE.

### LINERS

ALL BIORETENTION SYSTEMS ARE TO BE LINED TO RETAIN WATER. LINING CAN INCLUDE CLAY LINING (MIN. 300mm COMPACTED THICKNESS), HDPE WATERTIGHT MEMBRANE 1.5mm THICK, GEOSYNTHETIC CLAY LINERS (I.E. BENTOFIX). THE LINER IS TO EXTEND TO THE SURFACE OF THE MEDIA LAYER WHERE NO BUILDINGS ARE LOCATED NEXT TO THE SYSTEM. IF BUILDINGS ARE LOCATED NEXT TO THE SYSTEM THE LINER IS TO BE ATTACHED 100mm ABOVE THE EXTENDED DETENTION DEPTH TO THE SIDE OF THE BUILDING.

INSTALL A LAYER OF NON-WOVEN NEEDLE PUNCHED GEOFABRIC, SUCH AS BIDIM A34 OR APPROVED EQUIVALENT, UNDER AND OVER HDPE LINERS, TO MINIMISE THE RISK OF DAMAGE CAUSED BY ROCKS IN THE SUBSOIL. ALL HDPE LINERS SHALL HAVE WELDED WATER TIGHT JOINTS.

### GROSS POLLUTANT TRAPS (GPTs)

A GPT IS REQUIRED UPSTREAM OF ALL BIORETENTION BASINS WHERE THE UPSTREAM CATCHMENT >2000m<sup>2</sup>. IT MUST BE LOCATED AWAY FROM UNDERGROUND SERVICES WITH MAINTENANCE ACCESS. IF LOCATED ON PRIVATE LAND AN EASEMENT OR COVENANT WILL BE REQUIRED.

GPTs SHALL HAVE CONCRETE SURROUNDS WITH CLEAR ACCESS FOR EDUCTOR TRUCKS. THE DIMENSIONS OF THE CONCRETE SURROUND SHALL BE DETERMINED IN CONSULTATION WITH COUNCIL.

### SCOUR PROTECTION:

OUTLET PIPES FROM BIORETENTION BASINS WHICH DISCHARGE TO A WATERWAY SHALL HAVE OUTLET PROTECTION IN ACCORDANCE WITH THE DETAILS SHOWN IN THESE DRAWINGS.

### BIORETENTION SIZES & DIMENSIONS:

MAX FILTER AREA TO BE 1000m<sup>2</sup>. IF A FILTER > 1000m<sup>2</sup> IS REQUIRED, USE TWO OR MORE CELLS LINKED IN PARALLEL. CELLS SHALL NOT BE IN SERIES.

TYPICAL BIORETENTION SIZES			
SCALE	AREA	TYP. MAXIMUM CATCHMENT SIZE	APPLICABLE SHEETS
RAINGARDENS	< 30m <sup>2</sup>	2000m <sup>2</sup>	4, 10, 12
SMALL	30m <sup>2</sup> - 100m <sup>2</sup>	6500m <sup>2</sup>	4, 5, 6, 8, 12, 13, 14
LARGE	> 100m <sup>2</sup>	6.5ha PER 1000m <sup>2</sup> CELL	3, 4, 6, 7, 8, 12, 13, 14

THE MAX WIDTH OF LARGE BIORETENTION SYSTEMS IS TO BE 15m (IF ACCESS IS AVAILABLE FROM BOTH SIDES) OR A MAXIMUM 7.5m WIDTH IF ONLY ACCESSIBLE FROM ONE SIDE. DESIGN ACCESS TRACKS IN ACCORDANCE WITH AUSTRROADS PUBLICATION (AP-G34-13) FOR A 9m SERVICE VEHICLE AND AN EXCAVATOR WITH 9m REACH. ALL PARTS OF THE BASIN MUST BE REACHABLE BY EXCAVATOR.

### VEGETATION, SHADING AND MULCHING

PLANTS ARE AN ESSENTIAL COMPONENT OF THE BIORETENTION SYSTEM, REMOVING POLLUTANTS AND MAINTAINING THE HYDRAULIC CONDUCTIVITY OF THE FILTER MEDIA. PLANTS MUST BE CAPABLE OF SURVIVING IN THE FILTER MEDIA ENVIRONMENT (SANDY SOIL, DRY PERIODS WITH INTERMITTENT INUNDATION). A LIST OF SUITABLE SPECIES IS INCLUDED.

PLANTS IN 50mm TUBES OR HIKO CELLS ARE SUITABLE FOR PLANTING IN BIORETENTION SYSTEMS. ESTABLISHMENT WATERING WILL BE REQUIRED.

PLANTS WILL NEED TO BE PRE-ORDERED EARLY IN THE DESIGN PROCESS TO ENSURE THEY ARE AVAILABLE AT THE DESIRED TIME. ALL PLANTS SHALL BE VIGOROUS AND HEALTHY AND FREE FROM ROOT BALLING AND WEEDS. THE PLANTS SHALL BE POTTED ON IF A DELAY OCCURS.

DESIGNS MUST CONSIDER SUNLIGHT AVAILABILITY FOR THE PLANTS. THE ORIENTATION OR DEPTH OF THE SYSTEM CAN CAUSE EXCESSIVE PLANT SHADING, ESPECIALLY IN WINTER.

BIORETENTION SYSTEMS SHALL NOT BE MULCHED. IF MULCH IS USED ON ADJACENT BATTERS IT SHALL BE PLACED SO THAT IT WILL NOT BE WASHED INTO THE BIORETENTION SYSTEM.

DURING ESTABLISHMENT EROSION OF THE BOTTOM OF ACCESS RAMPS & AROUND ALL SURCHARGE PITS SHALL BE CONTROLLED USING JUTE.

### ACCESS

ACCESS FOR MAINTENANCE IS AN ESSENTIAL PART OF SYSTEM DESIGN AND OPERATION. ALL DESIGNS SHALL ENSURE EASE OF ACCESS WITHOUT UNDUE RISK TO MAINTENANCE PERSONNEL. DEEP BIORETENTION SYSTEMS SHALL INCLUDE AN ACCESS SYSTEM THAT ENSURES MAINTENANCE CREWS CAN EASILY AND SAFELY CARRY OUT REMOVAL OF LITTER, DEBRIS, SEDIMENT, REPLANTING, WEEDING AND REPLACEMENT OF THE FILTER MEDIA.

### ESTABLISHMENT / STAGING OF WORKS

IT IS RECOMMENDED THAT BIORETENTION SYSTEMS BE ESTABLISHED OFF-LINE WHEREVER POSSIBLE. THIS ALLOWS VEGETATION TO ESTABLISH WITHOUT BEING IMPACTED BY HIGH STORMWATER FLOWS. DESIGN DRAWINGS SHALL SHOW TEMPORARY WORKS FOR THE ESTABLISHMENT PHASE, SUCH AS A TEMPORARY COVER ON AN INLET, TEMPORARY IRRIGATION AND TEMPORARY EROSION CONTROL. REFER TO SHELLHARBOUR CITY COUNCIL BIORETENTION SPECIFICATION FOR FURTHER INFORMATION. STAGES AS FOLLOWS:

WHEN INCORPORATING WATER QUALITY CONTROLS IN A SUBDIVISION DEVELOPMENT, COUNCIL REQUIRES A STAGED IMPLEMENTATION. STAGES TYPICALLY INCLUDE:


1. DURING BULK EARTHWORKS PHASE A SEDIMENT BASIN IN PLACE OF THE FINAL BIORETENTION.
2. FOLLOWING COMPLETION OF BULK EARTHWORKS A SACRIFICIAL BASIN SHOULD BE CONSTRUCTED TO HAVE THE SUBDIVISION CERTIFICATE / LINEN PLANS RELEASED.
3. ONCE 90% OF CATCHMENT DEVELOPMENT IS COMPLETE A FULLY FUNCTIONAL BIORETENTION SYSTEM IS MADE OPERATIONAL. THIS IS AT THE DISCRETION OF COUNCIL WHO MAY VARY THIS REQUIREMENT.


### INSPECTION/HOLD POINTS

DURING CONSTRUCTION, IT IS CRITICAL THAT THE DESIGNER UNDERTAKE INSPECTIONS AT KEY POINTS, TO ENSURE THAT BIORETENTION SYSTEMS ARE INSTALLED ACCORDING TO THEIR DESIGN INTENT. THE FOLLOWING MINIMUM HOLD POINTS ARE REQUIRED:

STAGE	INSPECTION AND HOLD POINTS
2	COMPLETION OF BASIN BULK EARTHWORKS AND INSPECTION OF SUBGRADE INCLUDING REMOVAL OF ALL SEDIMENT.
2	INSTALLATION OF GEOTEXTILE AND LINER AS APPROPRIATE.
2	INSTALLATION OF INLET PITS AND PIPES.
2	INSTALLATION OF OUTLET PIT AND PIPES.
2	INSTALLATION OF SLOTTED PIPES AND FLUSHING POINTS.
2	PRIOR TO PURCHASE OF BIORETENTION MEDIA, TRANSITION AND DRAINAGE LAYER, PROVIDE TEST RESULTS INCLUDING PSD IMMEDIATELY PRIOR TO DELIVERY.
2	INSTALLATION OF DRAINAGE LAYER INCLUDING PSD IMMEDIATELY PRIOR TO DELIVERY.
3	INSTALLATION OF TRANSITION LAYER (250mm). INCLUDING PSD IMMEDIATELY PRIOR TO DELIVERY.
3	INSTALLATION OF GEOTEXTILE A16 OR SIMILAR.
3	INSTALLATION OF SACRIFICIAL MEDIA LAYER & TURF.
3	REMOVAL OF SACRIFICIAL LAYER AND GEOTEXTILE.
3	INSTALLATION OF UPFLOW PITS.
3	INSTALLATION OF PERMEABLE CONCRETE PIPES.
3	INSTALLATION OF REMAINING 200mm OF TRANSITION LAYER. INCLUDING PSD IMMEDIATELY PRIOR TO DELIVERY.
3	INSTALLATION OF FILTER MEDIA.
3	COMPLETED WORKS, INCLUDING SCOUR PADS.
3	INSITU TESTING OF FILTER MEDIA HYDRAULIC CONDUCTIVITY USING DOUBLE RING INFILTRMETER BY NATA REGISTERED OR AN APPROVED TESTER.
3	PLACEMENT OF JUTE MAT AND PLANTING.
3	CERTIFICATION OF PLANT SPECIES AND DENSITY BY HORTICULTURIST / ECOLOGIST / LANDSCAPE ARCHITECT / ENVIRONMENTAL ENGINEER.

AT EACH STAGE, CHECK THE FINISHED LEVELS AS WELL AS THE QUALITY OF COMPLETED WORK. THE SUPERINTENDENT SHALL PROVIDE CERTIFICATION VERIFYING INSTALLATION AND COMPLIANCE AT EACH STAGE.

NOT TO SCALE	LIST OF REVISIONS	AMENDMENT DETAILS	APPROVED - Manager Technical Services		LOCATIONS	SERVICES	LEGEND	 ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet & College Avenue)  POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529 PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE	<h1>PLAN DETAILS</h1> <h2>SCC STANDARD DRAWING</h2>	FILE:	REVISION
	SURVEYED OFFICER: DATE: SURVEY MARKS:		REV. DATE OFFICER ..... ..... ..... ..... ..... ..... ..... ..... ..... .....	DATE:  DESIGNED:  DATE:  DRAWN:  DATE:						SEDIMENT AND EROSION CONTROL Provide sediment and erosion control measures in accordance with the 'Erosion & Sediment Control' guide by the NSW Office of Environment & Heritage	Gas: --- G --- Electricity: --- E --- Water: --- W --- Sewer: --- S --- TelComm Local Cable: --- T --- TelComm Major or Optic Fibre: --- MOF ---

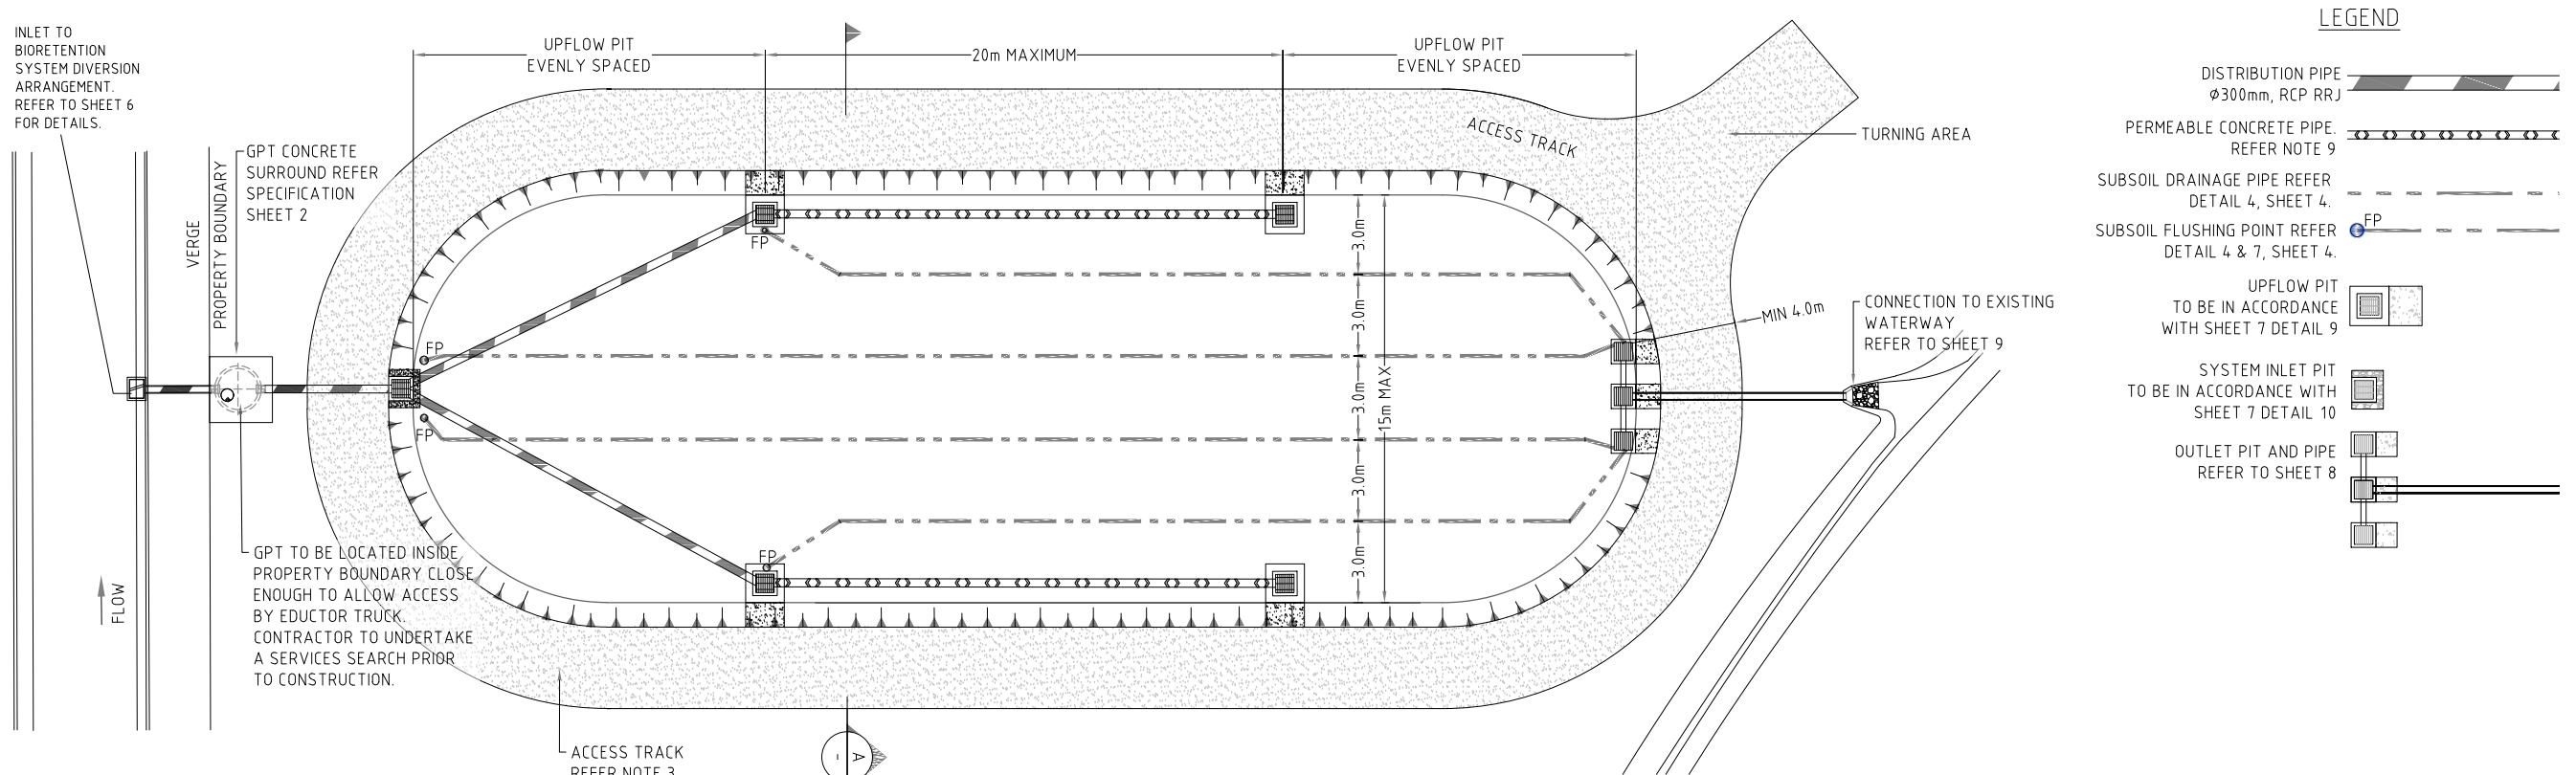


INLET TO BIORETENTION SYSTEM DIVERSION ARRANGEMENT. REFER TO SHEET 6 FOR DETAILS.

GPT CONCRETE SURROUND REFER SPECIFICATION SHEET 2


GPT TO BE LOCATED INSIDE PROPERTY BOUNDARY CLOSE ENOUGH TO ALLOW ACCESS BY EDUCTOR TRUCK. CONTRACTOR TO UNDERTAKE A SERVICES SEARCH PRIOR TO CONSTRUCTION.

ACCESS TRACK REFER NOTE 3

PLAN 1  
TYPICAL BIORETENTION SYSTEM  
NTS

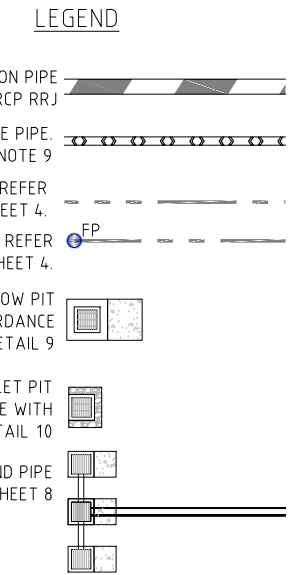

- DESIGN NOTES:**
- 1) BIORETENTION SYSTEMS SHALL BE DESIGNED TO ACCEPT ONLY LOW FLOWS WITH A HIGH FLOW BYPASS DIVERTED AROUND THE BIORETENTION SYSTEM.
  - 2) GENERALLY BIORETENTION SYSTEMS ARE DESIGNED TO TREAT THE 6 MONTH PEAK FLOW BEING APPROXIMATELY THE 0.75 x 1 YEAR ARI.
  - 3) THE ACCESS TRACK SHALL BE 4m WIDE AND GRADED WITH A 3% CROSSFALL REFER DETAIL 5 SHEET 4. ACCESS TRACKS SHALL BE DESIGNED FOR ACCESS BY A 9m SERVICE VEHICLE. EVERY PART OF THE BASIN SHALL BE REACHABLE BY AN EXCAVATOR WITH A 9m REACH. A FILTER MEDIA WIDTH OF 15m WILL ACHIEVE THIS OBJECTIVE.
  - 4) SUBSOIL AND PERMEABLE CONCRETE PIPES SHALL BE LAID HORIZONTAL.
  - 5) DESIGNERS SHALL CONSIDER DEPTH OF PIPES & SPECIFY APPROPRIATE PIPE CLASSES.
  - 6) OUTLET PIPES SHALL BE DESIGNED TO HAVE THE SAME CAPACITY AS INLET PIPES.
  - 7) THE OVERFLOW/OUTLET PIT SHALL BE SIZED TO CONVEY THE DESIGN INFLOW SUCH THAT THE DEPTH OF FLOW, H, ABOVE THE PIT INLET LEVEL IS LIMITED TO LESS THAN 100mm USING THE WEIR EQUATION. THE DESIGNER SHALL ASSUME THAT ONLY 50% OF THE WEIR LENGTH IS AVAILABLE AND THE REMAINING 50% IS BLOCKED.
  - 8) FOR BIORETENTION SYSTEMS UP TO 600 m<sup>2</sup>, 2 OFF UPFLOW PITS SHALL BE USED. FOR BIORETENTION SYSTEMS > 600 m<sup>2</sup>, 4 OFF UPFLOW PITS SHALL BE PROVIDED WITH PERMEABLE CONCRETE PIPES AS SHOWN.
  - 9) PERMEABLE CONCRETE PIPE WITH A MINIMUM IMPEDED EXFILTRATION RATE OF 0.6L/s/m OF PIPE SHALL BE PROVIDED AT A RATE OF 4m OF PIPE PER 100m<sup>2</sup> OF FILTER AREA. CURRENTLY HYDROCON PIPES SATISFY THIS CRITERIA.
  - 10) UPFLOW PITS SHALL BE LOCATED ON EDGE OF FILTER MEDIA AS SHOWN AND SPACED TO ALLOW AN EVEN DISTRIBUTION OF WATER INTO THE BIORETENTION SYSTEM WITH A MAXIMUM SPACING OF 20m.
  - 11) LINER TO BE IN ACCORDANCE WITH DETAIL 6. SHEET 4.




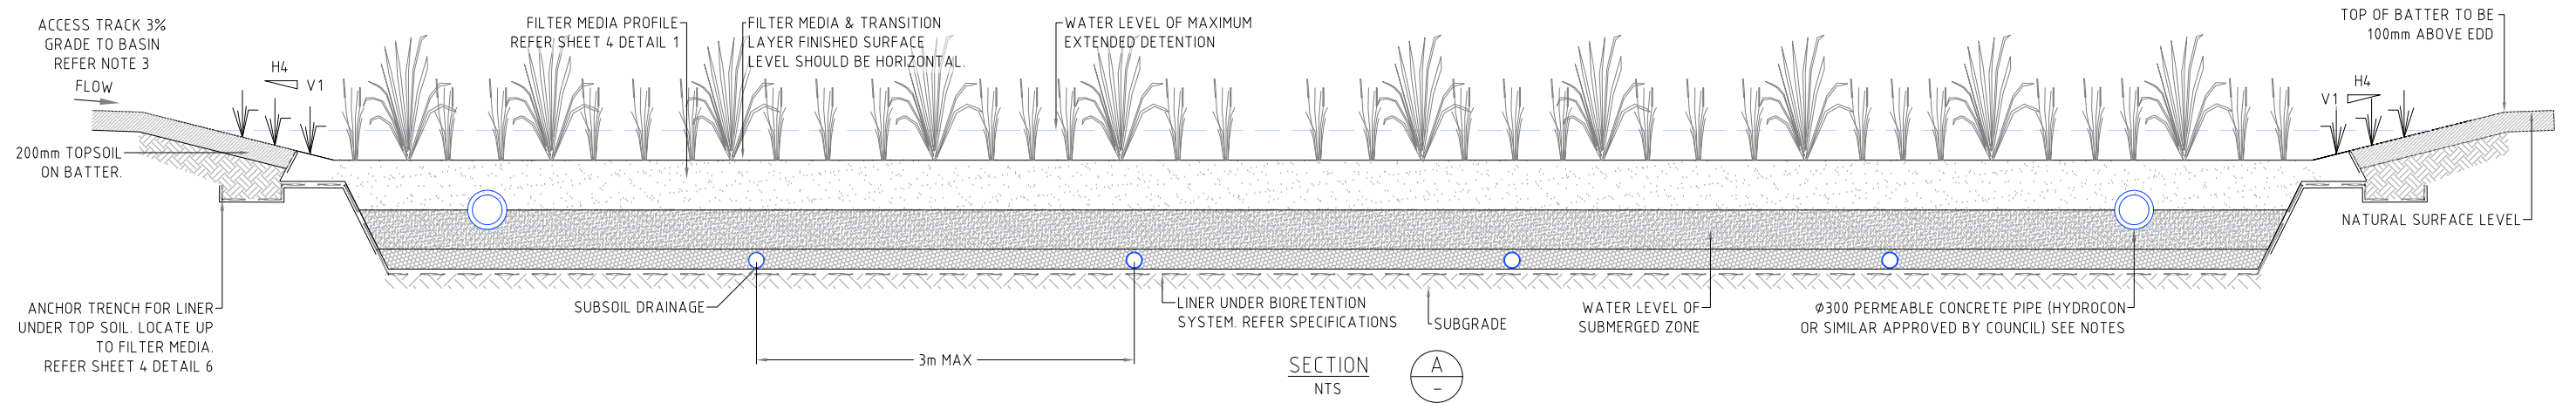


SECTION A  
NTS

NOT TO SCALE	LIST OF REVISIONS	AMENDMENT DETAILS	APPROVED - Manager Technical Services	LOCATIONS	SERVICES	<p>ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet &amp; College Avenue)</p> <p>POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529</p> <p>PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE</p>	FILE:	REVISION
	<p>DESIGNED: _____</p> <p>DATE: _____</p> <p>DRAWN: _____</p> <p>DATE: _____</p>	<p>SEDIMENT AND EROSION CONTROL</p> <p>Provide sediment and erosion control measures in accordance with the 'Erosion &amp; Sediment Control' guide by the NSW Office of Environment &amp; Heritage</p>	<p>Services shown are those known to exist at date of design. Prior to commencement of excavation contact the relevant gas, electricity, water and telecommunications service providers, including the RMS, for most recent service locations and precautions that may be necessary</p>	<p>Gas: — G —</p> <p>Electricity: — E —</p> <p>Water: — W —</p> <p>Sewer: — S —</p> <p>TelComm Local Cable: — T —</p> <p>TelComm Major or Optic Fibre: — MOF —</p>	<p>SCC BIORETENTION - GENERAL ARRANGEMENT</p>		<p>PLAN No: _____</p> <p>SHEET: 3/25</p>	

PLAN DETAILS  
SCC STANDARD DRAWING



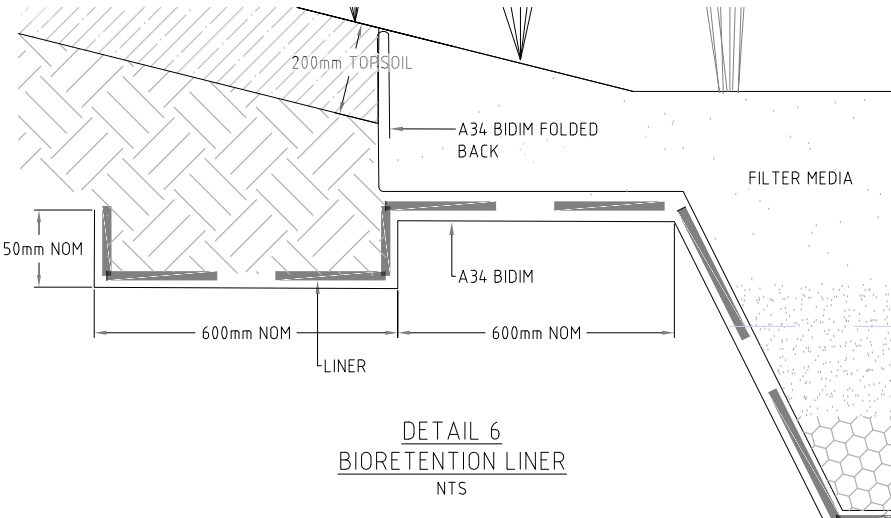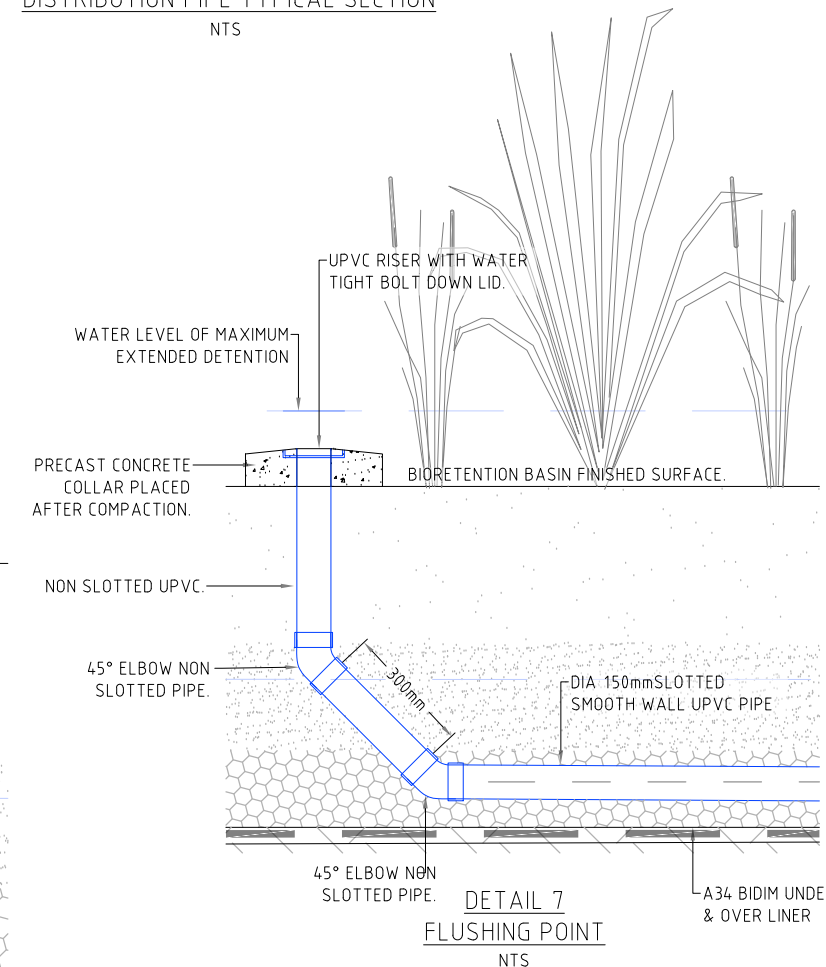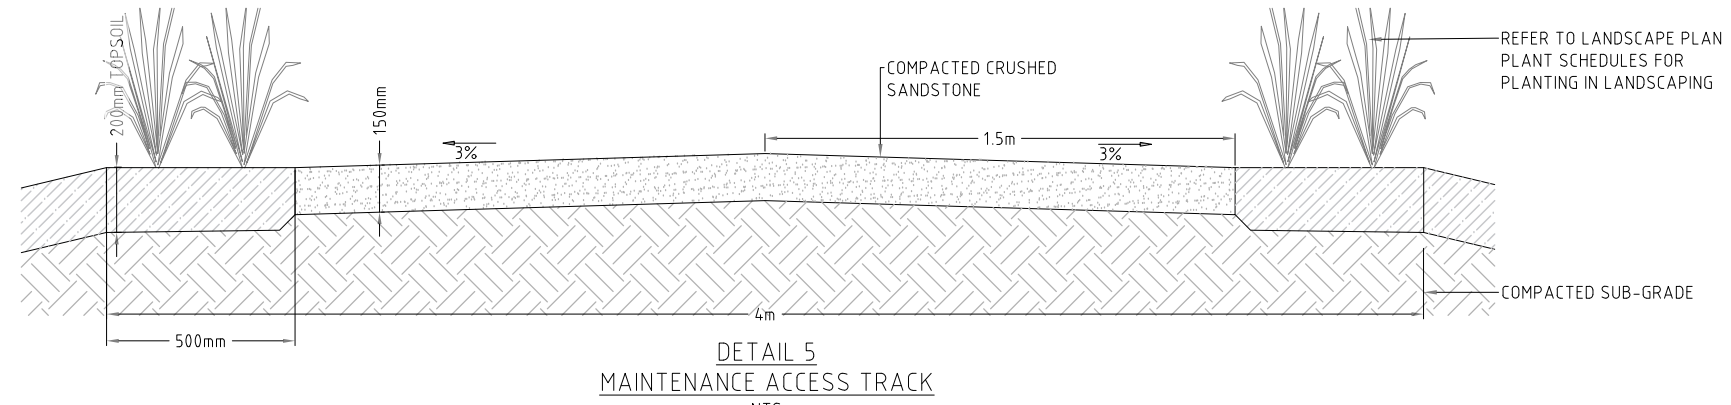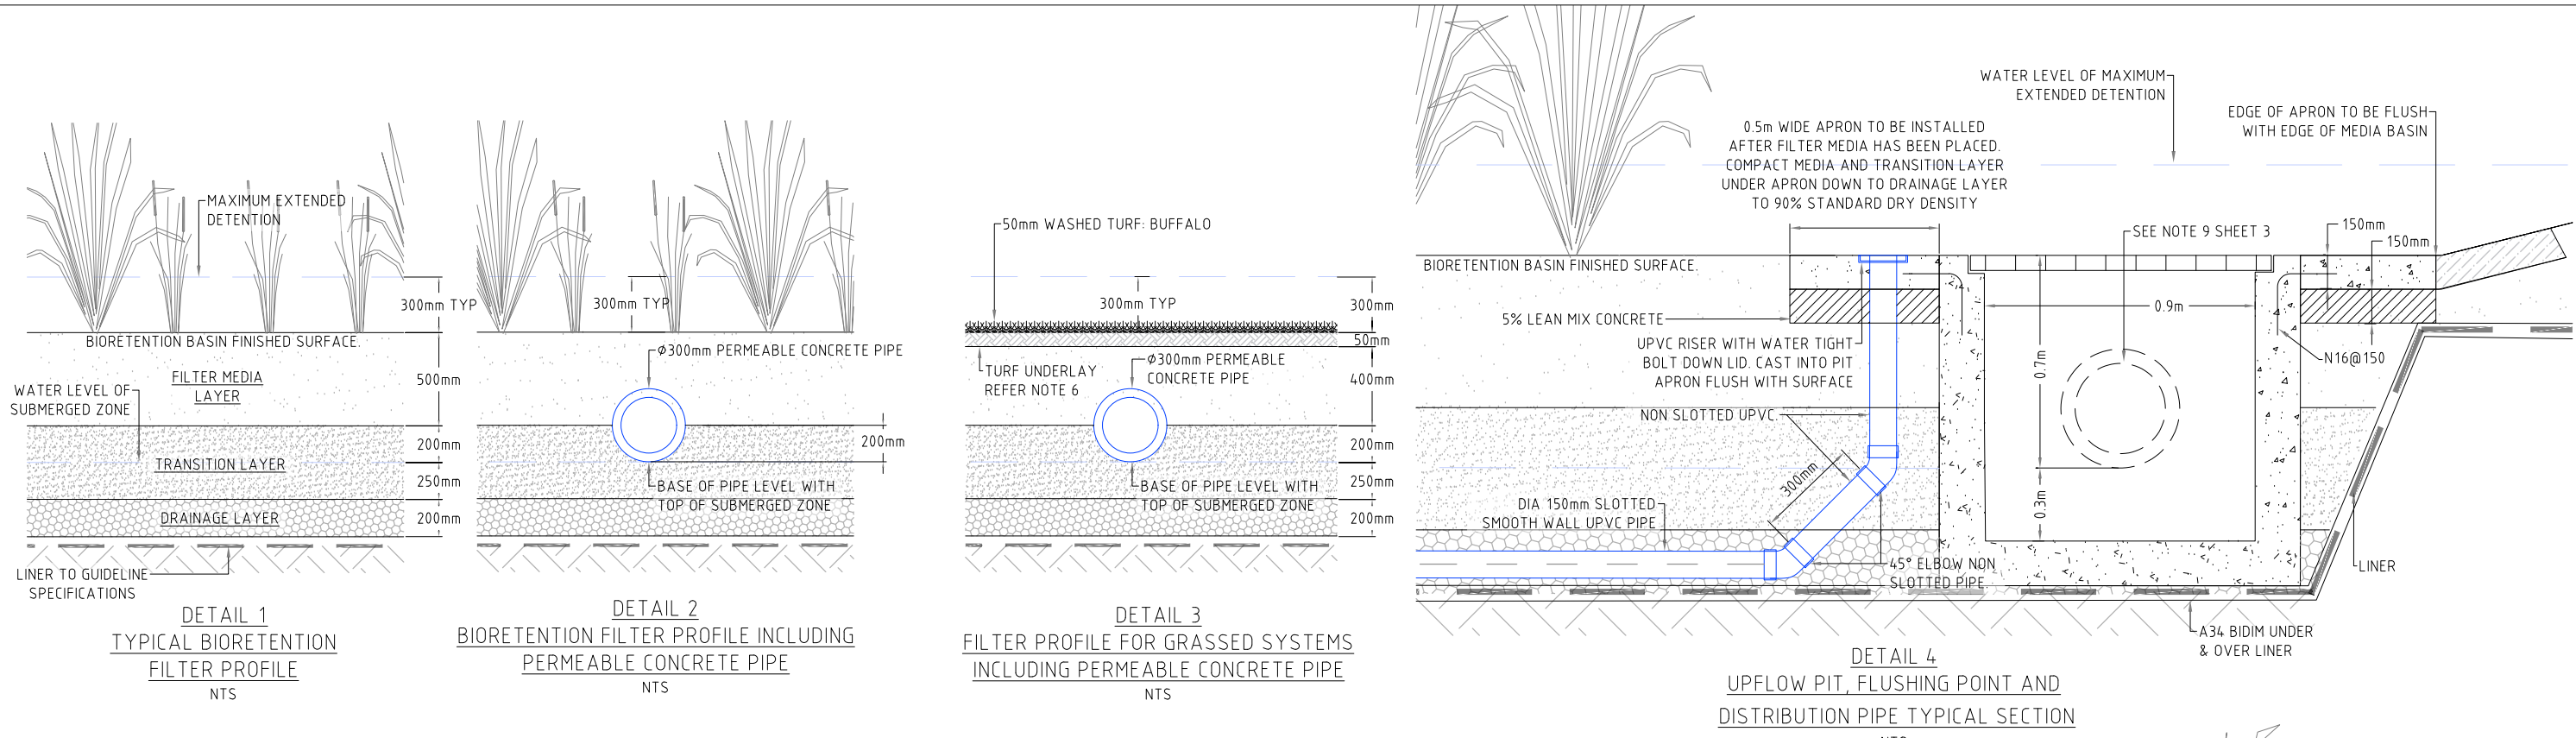

- DESIGN NOTES:**
- EDD MAY BE INCREASED TO 500MM WHERE REQUIRED.
  - GEOTEXTILE FABRICS MUST NOT BE USED BETWEEN THE FILTER MEDIA, TRANSITION AND DRAINAGE LAYERS IN BIORETENTION SYSTEMS DUE TO THE RISK OF CLOGGING. THE SOIL SPECIFICATIONS ARE DESIGNED TO LIMIT THE MIGRATION OF PARTICLES THROUGH THE SYSTEM.
  - NO GEOTEXTILE SOCKS TO BE INSTALLED ON THE SLOTTED DRAINAGE PIPES.
  - THE TOP LEVEL OF THE SATURATED ZONE MUST BE LOCATED WITHIN THE TRANSITION LAYER 200mm BELOW THE FILTER MEDIA. THE HEIGHT OF THE SATURATED ZONE IS CONTROLLED BY THE OUTLET LEVEL. REFER SHEET 8
  - FILTER MEDIA, TRANSITION AND DRAINAGE LAYERS SHALL BE PROVIDED IN ACCORDANCE WITH THE SPECIFICATION ON SHEET 2.
  - TURF UNDERLAY SHALL BE A 70:30 SAND:TOPSOIL MIX. SAND SHALL COMPLY WITH THE TRANSITION LAYER SPECIFICATION ON SHEET 2.
  - TOPSOIL SHALL COMPLY WITH AS4419. SITE TOPSOILS MAY BE REUSED PROVIDED THEY HAVE BEEN ASSESSED BY A QUALIFIED HORTICULTURIST OR SOIL SCIENTIST AND AMELIORATED ACCORDING TO THEIR RECOMMENDATIONS.
  - TURF SHALL BE WATERED IMMEDIATELY AFTER LAYING UNTIL UNDERLAY IS MOISTENED TO FULL DEPTH. CONTINUE WATERING AS REQUIRED TO MAINTAIN GROWTH RATES FREE OF STRESS FOR 6 WEEKS.
  - ONCE TURF HAS ESTABLISHED (4-6 WEEKS TYP.) TOP DRESS WITH FILTER MEDIA TO CREATE A LEVEL FINISH, TWO OR MORE ADDITIONAL TOP DRESSES MAY BE REQUIRED DEPENDING ON THE EXTENT OF SETTLEMENT.


NOT TO SCALE	LIST OF REVISIONS	AMENDMENT DETAILS	APPROVED - Manager Technical Services	LOCATIONS	SERVICES	<p>ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet &amp; College Avenue)</p> <p>POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529</p> <p>PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE</p>	PLAN DETAILS		FILE:	REVISION
	SURVEYED: _____ OFFICER: _____ DATE: _____ SURVEY MARKS: _____	REV. DATE OFFICER _____ _____ _____		DATE: _____ DESIGNED: _____ DATE: _____ DRAWN: _____ DATE: _____	SERVICES shown are those known to exist at date of design. Prior to commencement of excavation contact the relevant gas, electricity, water and telecommunications service providers, including the RMS, for most recent service locations and precautions that may be necessary		LEGEND Gas: — G — Electricity: — E — Water: — W — Sewer: — S — TelComm Local Cable: — T — TelComm Major or Optic Fibre: — MOF —	<b>SCC STANDARD DRAWING</b>		SCC BIORETENTION - DETAILS PLAN No: _____

**DESIGN NOTES:**


- THIS APPROACH IS TO BE USED FOR BIORETENTION SYSTEMS >30m<sup>2</sup> AND <100m<sup>2</sup>. FOR SYSTEMS <30m<sup>2</sup> REFER TO SHEET 10. FOR SYSTEMS LARGER THAN 100m<sup>2</sup> REFER TO LARGE SYSTEMS DETAILS SHOWN ON SHEET 3 ONWARDS.
- MAXIMUM LENGTH TO BE 20m.
- FOR CATCHMENTS UP TO 2000m<sup>2</sup> THE MINIMUM REQUIREMENT IS FOR A RAINGARDEN SEDIMENT PIT.
- FOR CATCHMENTS GREATER THAN 2000m<sup>2</sup>, EITHER
  - PROVIDE SYSTEM INLET WITH SEDIMENT PIT PLUS A PROPRIETARY GPT TARGETING 90% ANNUAL GROSS POLLUTANT AND HYDROCARBONS REMOVAL AND SIZED FOR 0.75 x 1YR ARI PEAK FLOWS. OR;
  - PROVIDE A 200 MICRON ENVIROPOD OR STORMSACK OR APPROVED EQUIVALENT TO EVERY SURFACE INLET PIT OR TRENCH GRATE AND DESIGN THE BIORETENTION FOR 400mm EXTENDED DETENTION DEPTH TO TREAT HYDROCARBONS.
- ENSURE THE HGL IN ALL UPSTREAM PITS IS ABOVE THE EDD HEIGHT TO PREVENT UPWELLING ELSEWHERE IN THE SYSTEM & DIRECT ALL OVERLAND FLOWS TOWARDS THE BASIN
- WHERE THE BIORETENTION FORMS PART OF A DETENTION SYSTEM THE SUBSOIL FLOWS ARE TO DISCHARGE DOWNSTREAM OF THE DISCHARGE CONTROL PIT.
- AS AN ALTERNATIVE TO THE ARRANGEMENT SHOWN HERE, SMALL SYSTEMS MAY BE CONFIGURED AS LARGE SYSTEMS (REFER SHEETS 3&4) USING PERMEABLE PIPES AND SURCHARGE PITS TO DISTRIBUTE THE FLOW.

**LEGEND**


- SUBSOIL DRAINAGE PIPE REFER DETAIL 7, SHEET 4.
- SUBSOIL FLUSHING POINT REFER DETAIL 7, SHEET 4.

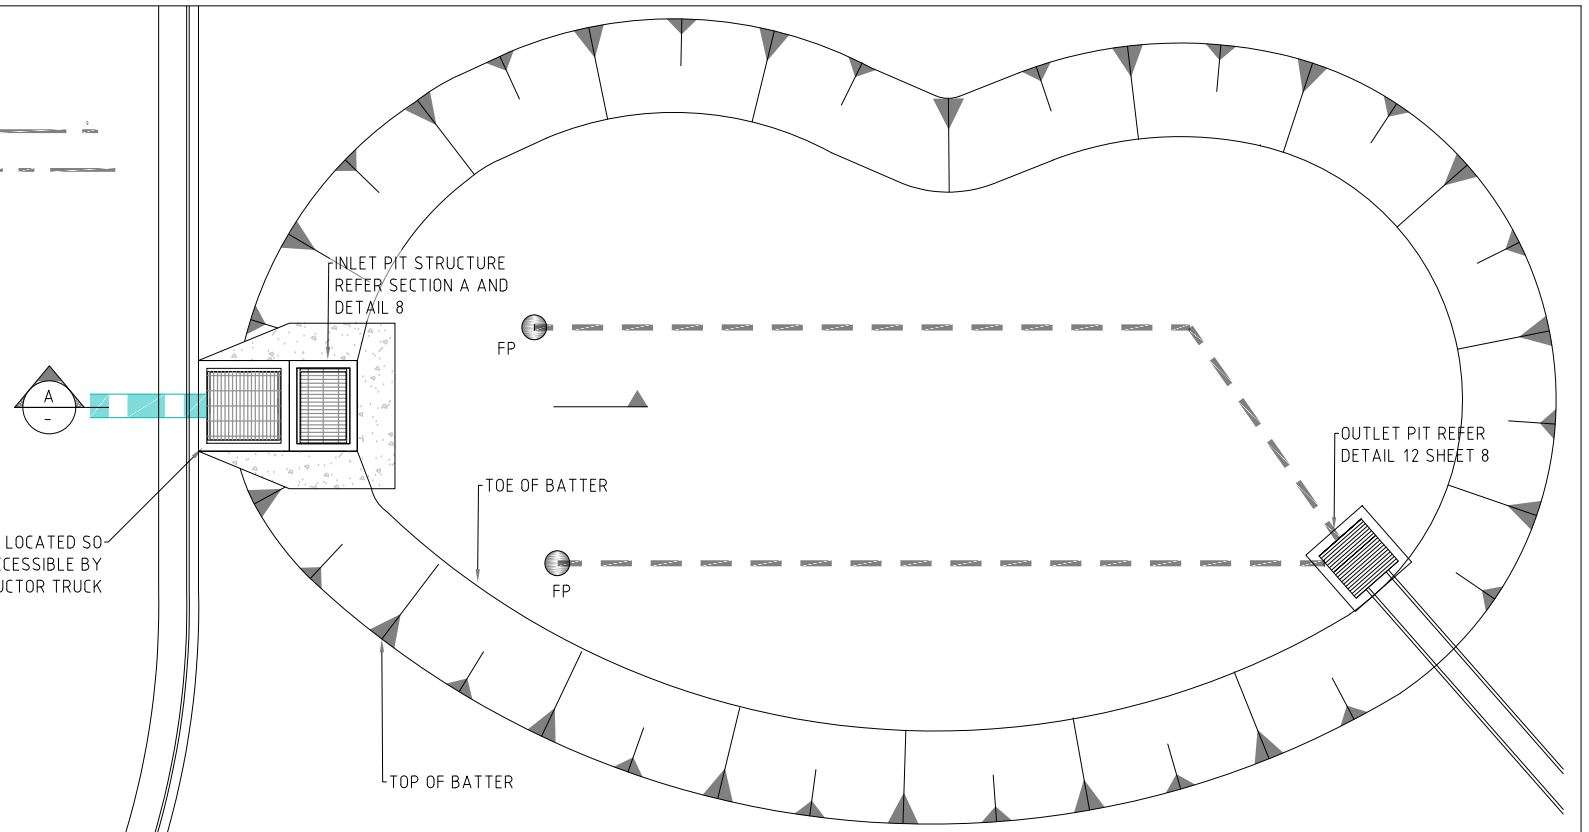

**PLAN 2**  
TYPICAL SMALL BIORETENTION SYSTEM (<100m<sup>2</sup>)  
NTS

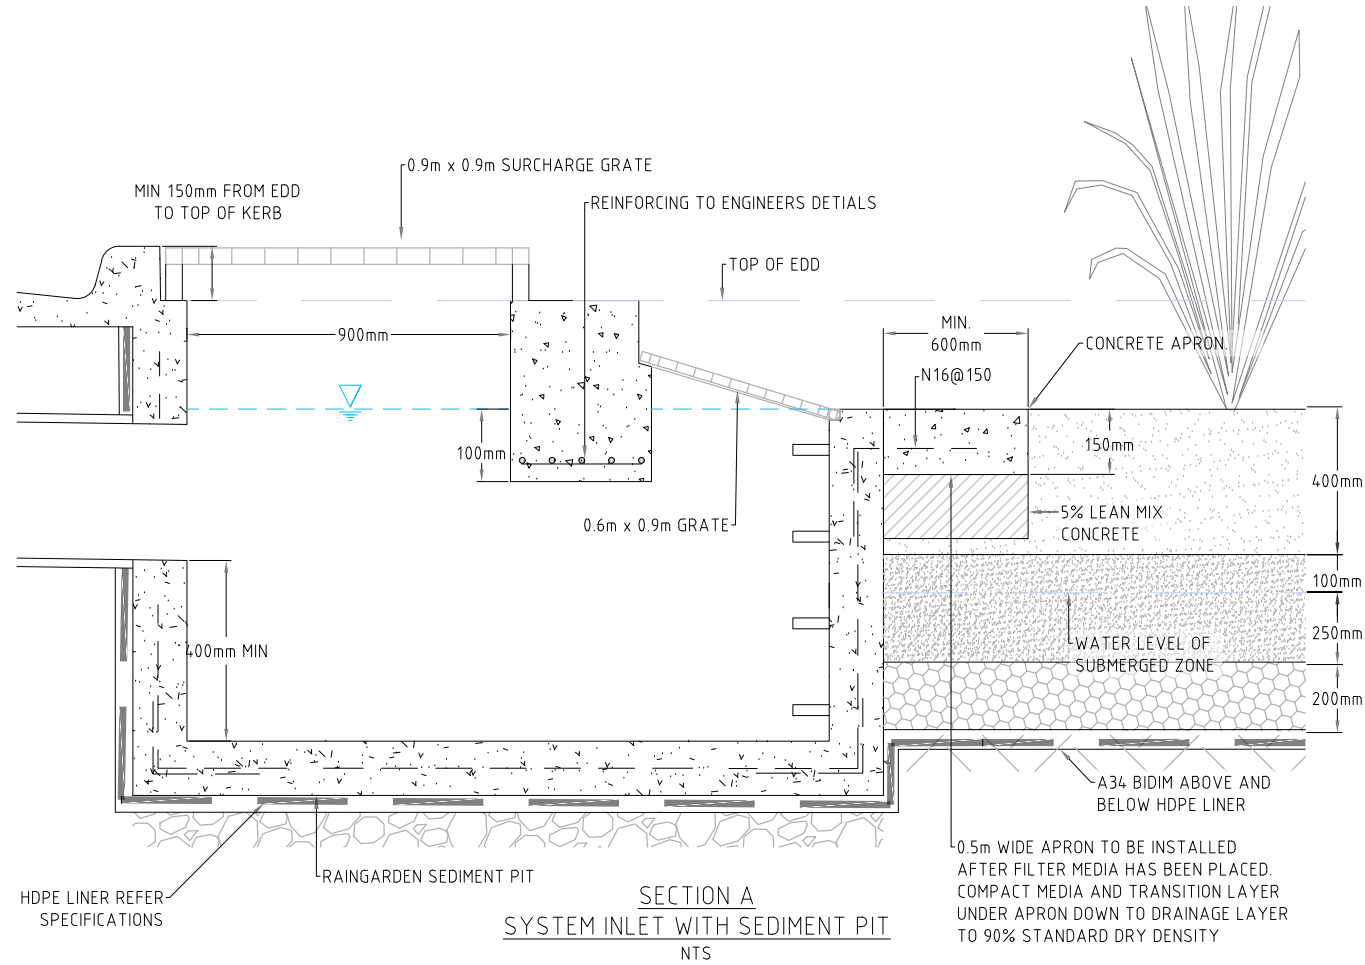

**SECTION A**  
SYSTEM INLET WITH SEDIMENT PIT  
NTS

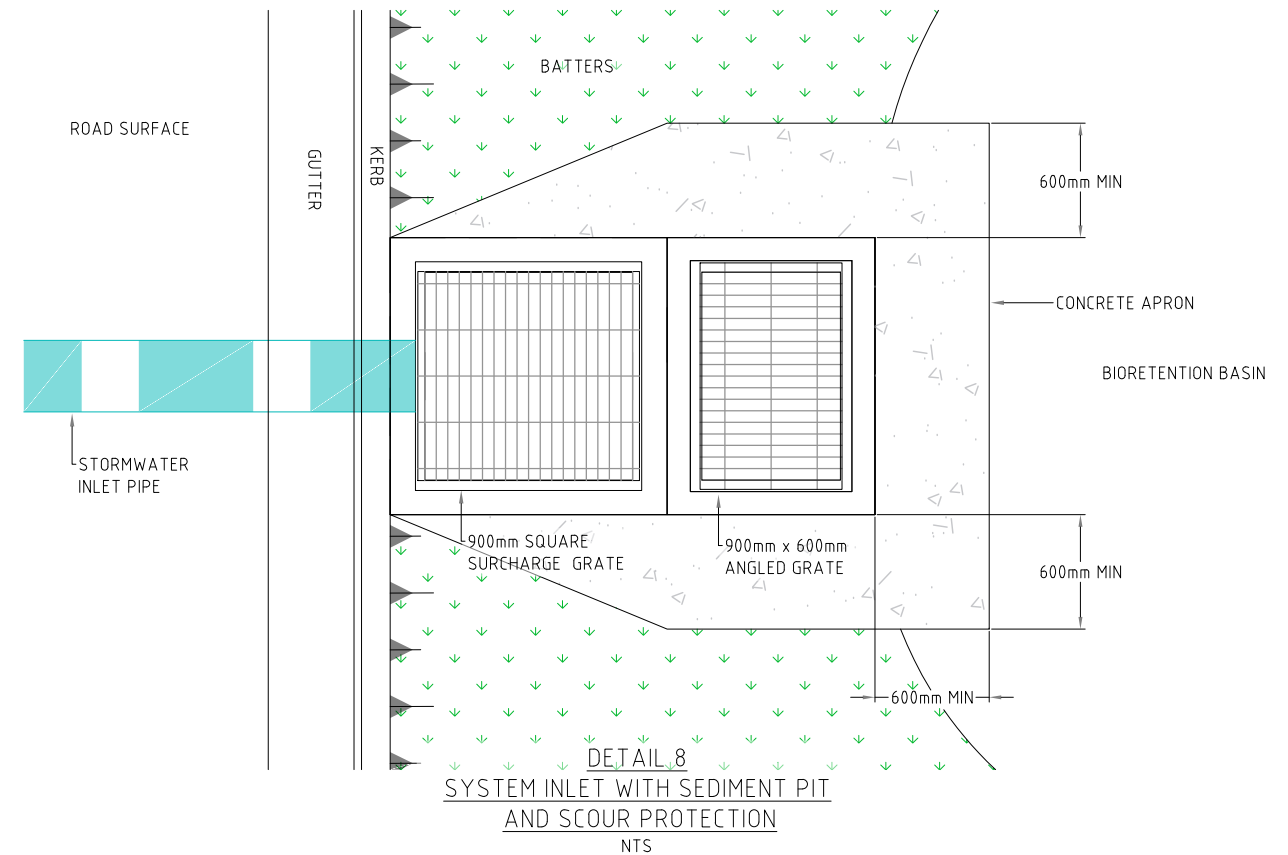





**DETAIL 8**  
SYSTEM INLET WITH SEDIMENT PIT  
AND SCOUR PROTECTION  
NTS

NOT TO SCALE	LIST OF REVISIONS	AMENDMENT DETAILS	APPROVED - Manager Technical Services	LOCATIONS	SERVICES	<p>ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet &amp; College Avenue)</p> <p>POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529</p> <p>PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE</p>	FILE:	REVISION
	<p>DESIGNED: _____</p> <p>DATE: _____</p> <p>DRAWN: _____</p> <p>DATE: _____</p>	<p>SEDIMENT AND EROSION CONTROL</p> <p>Provide sediment and erosion control measures in accordance with the 'Erosion &amp; Sediment Control' guide by the NSW Office of Environment &amp; Heritage</p>	<p>Gas: --- G ---</p> <p>Electricity: --- E ---</p> <p>Water: --- W ---</p> <p>Sewer: --- S ---</p> <p>TelComm Local Cable: --- T ---</p> <p>TelComm Major or Optic Fibre: --- MOF ---</p>	<p>SCC SMALL BIORETENTION SYSTEMS</p>	<p>PLAN No: _____</p> <p>SHEET: 5/25</p>			

**PLAN DETAILS**  
**SCC STANDARD DRAWING**






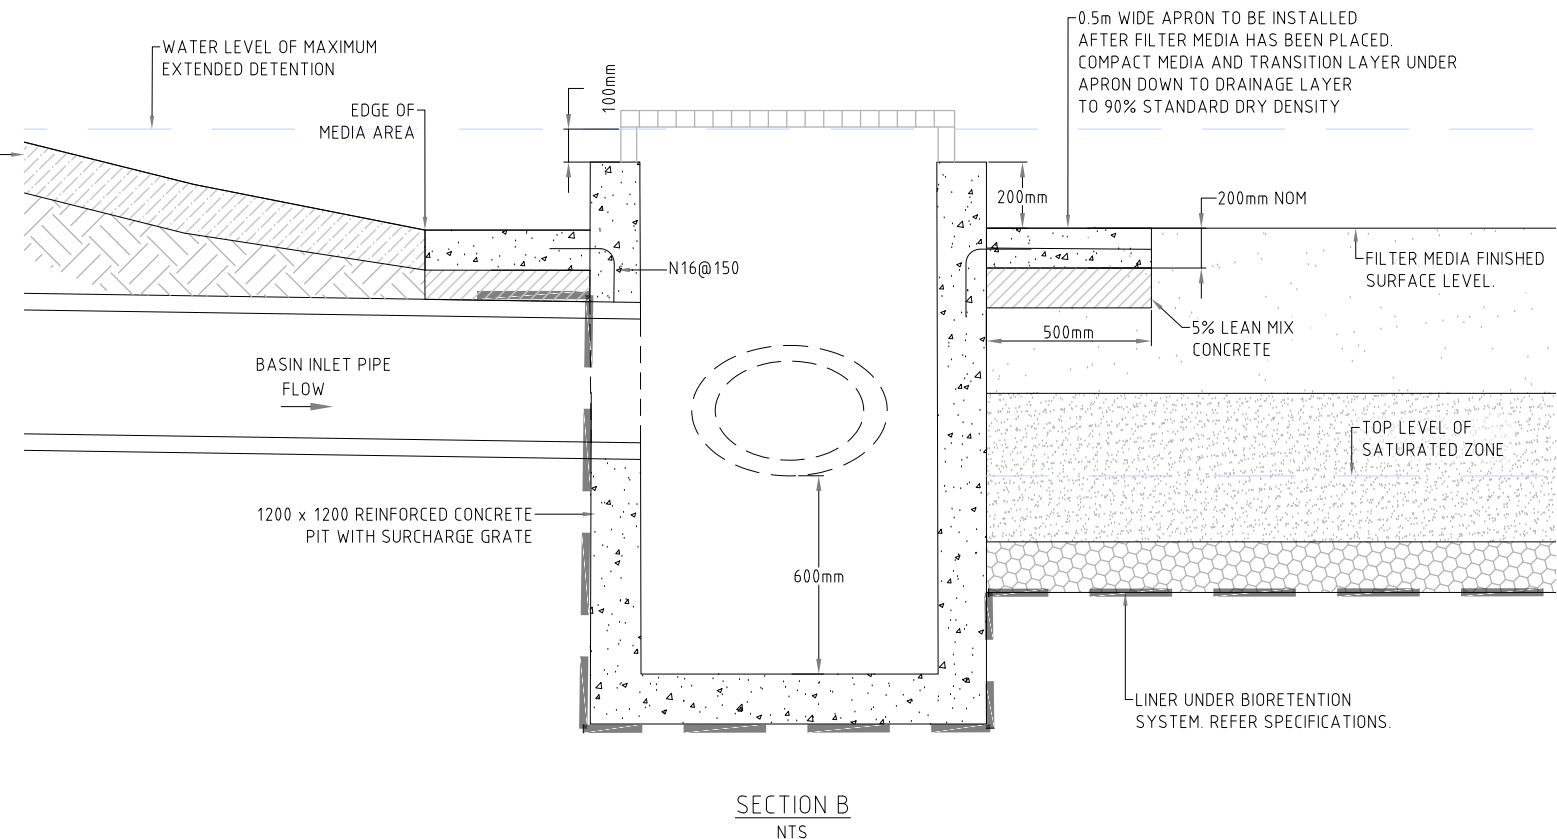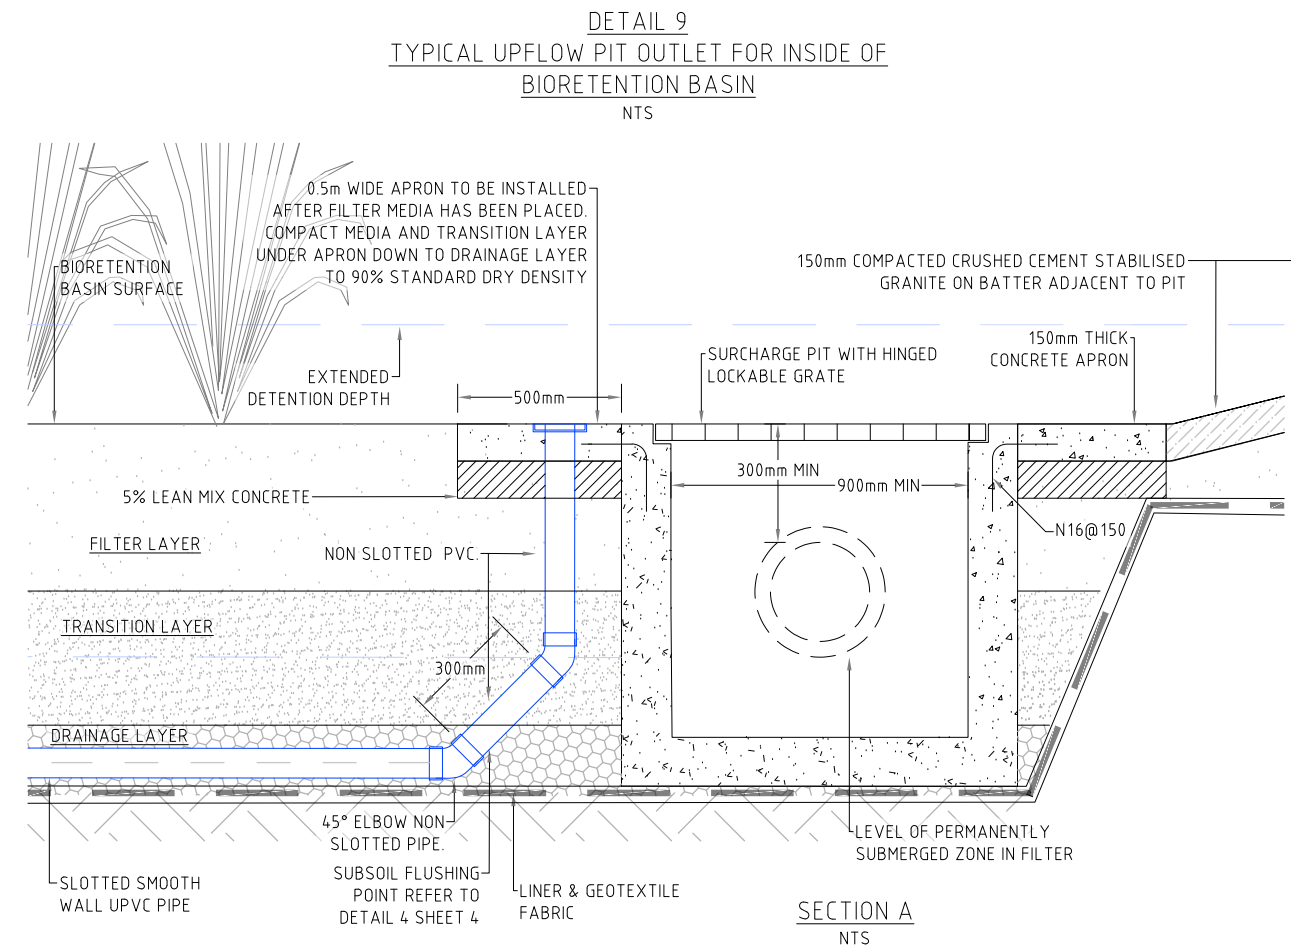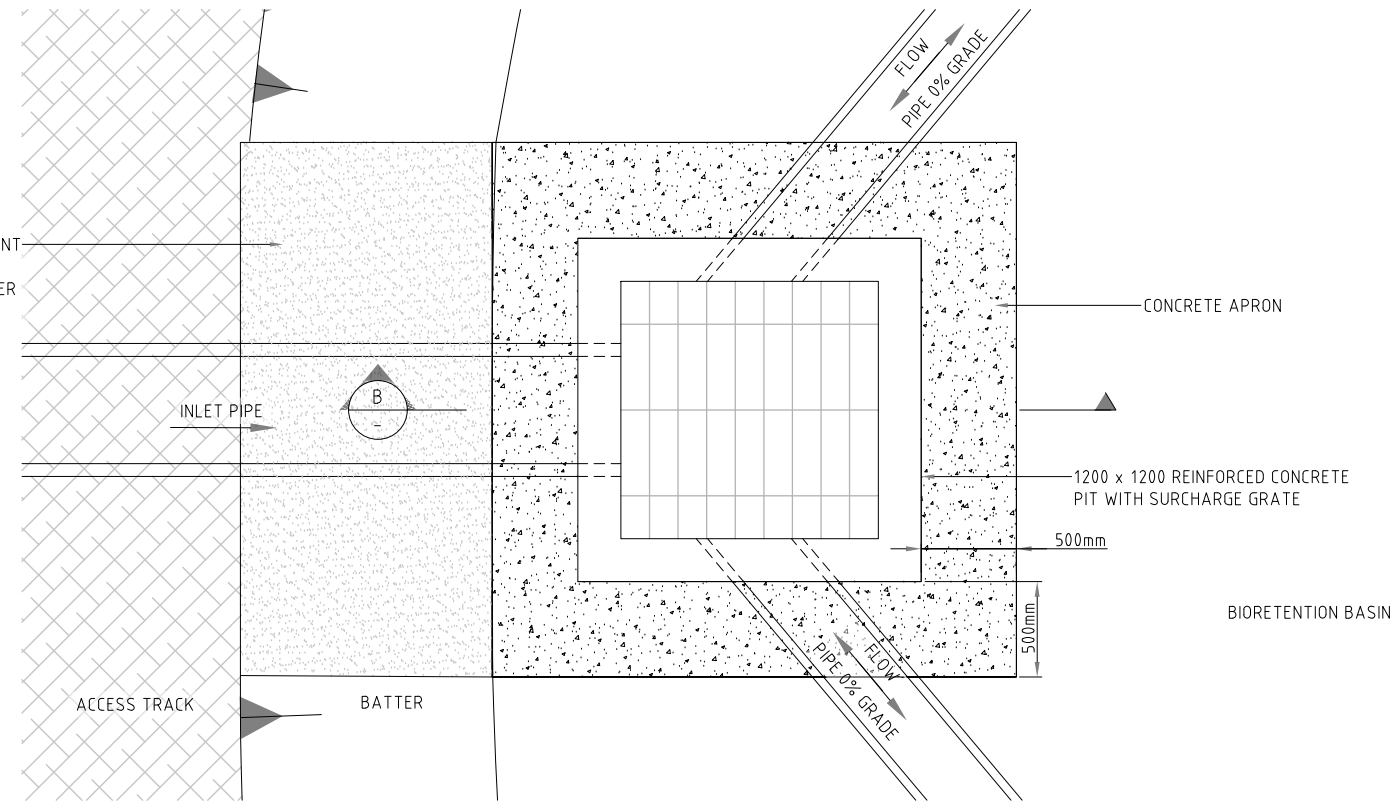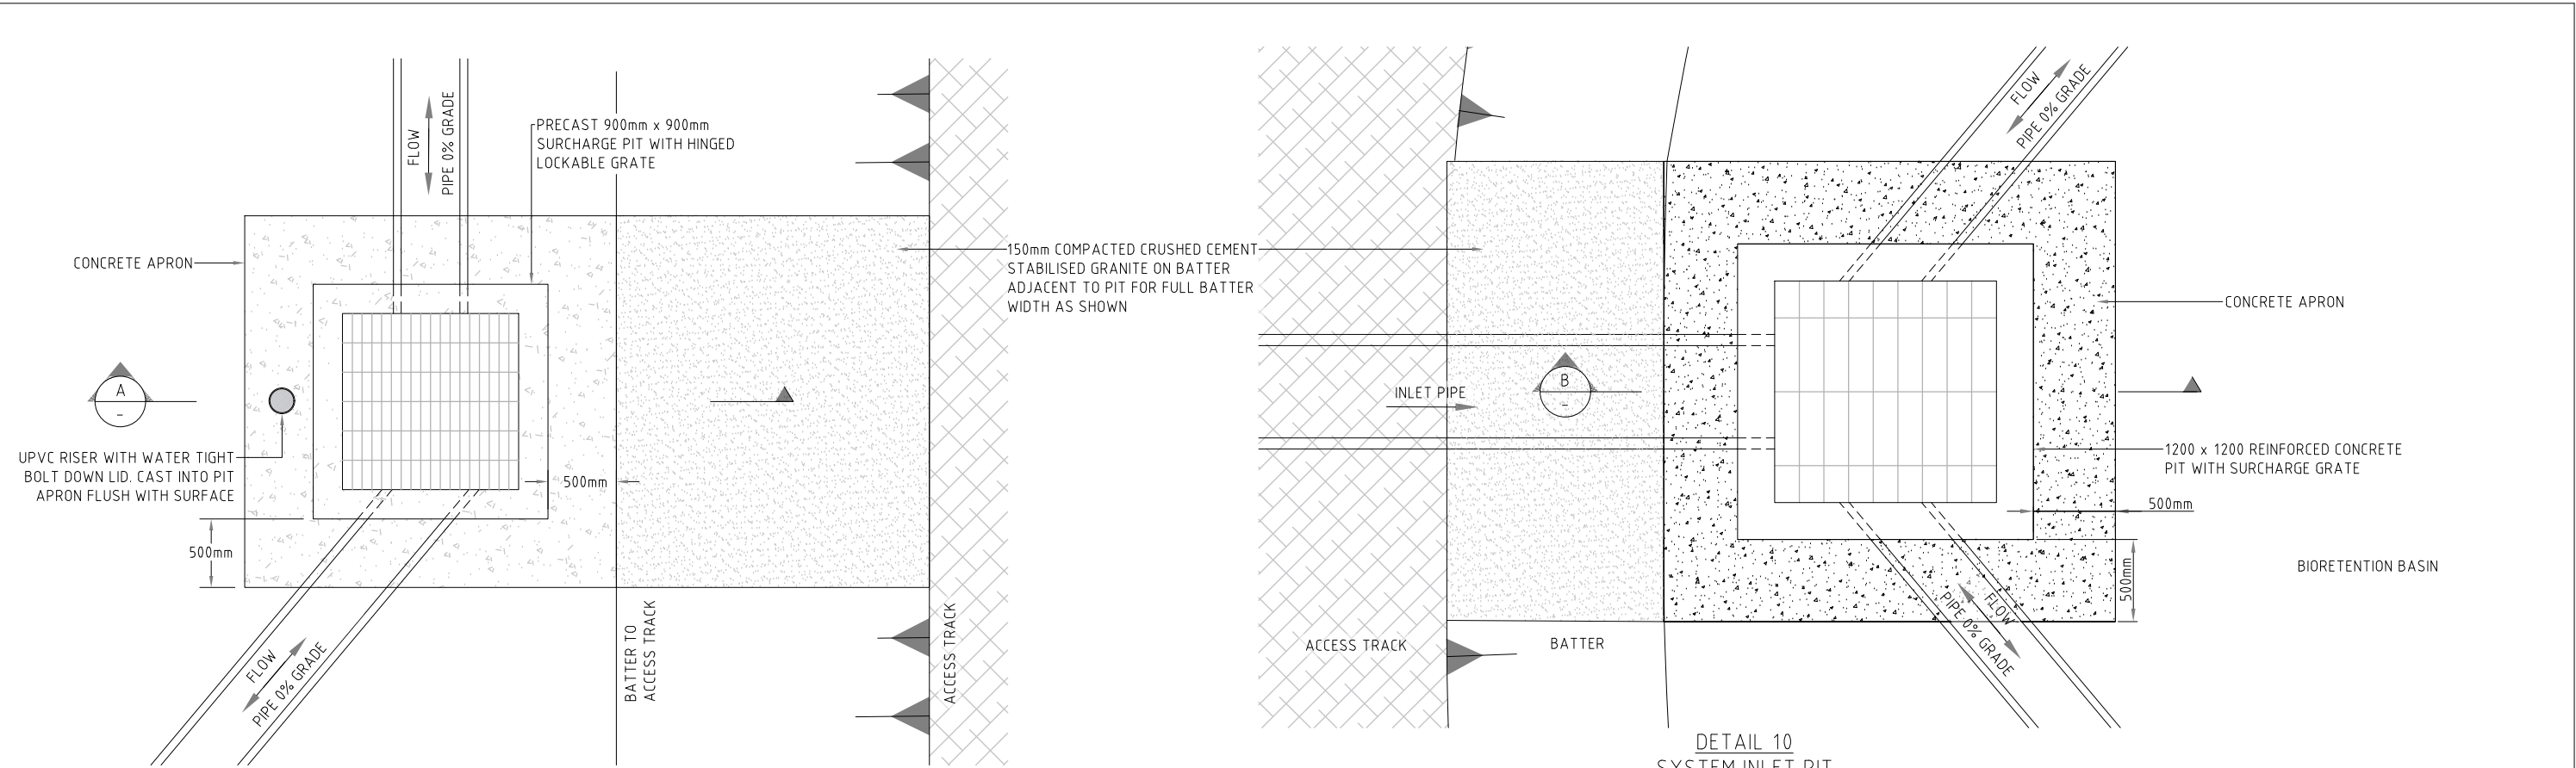


<p>NOT TO SCALE</p> <p>SURVEYED OFFICER: _____</p> <p>DATE: _____</p> <p>SURVEY MARKS: _____</p>	<p>LIST OF REVISIONS</p> <table border="1"> <tr> <th>REV.</th> <th>DATE</th> <th>OFFICER</th> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> </table>	REV.	DATE	OFFICER																<p>AMENDMENT DETAILS</p> <p>APPROVED - Manager Technical Services</p> <p>DATE: _____</p> <p>DESIGNED: _____</p> <p>DATE: _____</p> <p>DRAWN: _____</p> <p>DATE: _____</p>	<p>LOCATIONS</p> <p>SERVICES</p> <p>LEGEND</p> <p>Gas: --- G ---</p> <p>Electricity: --- E ---</p> <p>Water: --- W ---</p> <p>Sewer: --- S ---</p> <p>TelComm Local Cable: --- T ---</p> <p>TelComm Major or Optic Fibre: --- MOF ---</p>	<p>ADMINISTRATION CENTRE</p> <p>SHELLHARBOUR CIVIC CENTRE</p> <p>76 CYGNET AVENUE</p> <p>(Cnr Cygnet &amp; College Avenue)</p> <p>POSTAL ADDRESS</p> <p>Locked Bag 155</p> <p>SHELLHARBOUR CITY CENTRE NSW 2529</p> <p>PH: (02) 4221 6111</p> <p>FAX: (02) 4221 6016</p> <p>DX26402 SHELLHARBOUR CITY CENTRE</p>	<p>FILE: SCC BIORETENTION - INLET STRUCTURES</p> <p>PLAN No: _____</p> <p>REVISION</p> <p>SHEET: 7/25</p>
	REV.	DATE	OFFICER																				
<p>SEDIMENT AND EROSION CONTROL</p> <p>Provide sediment and erosion control measures in accordance with the 'Erosion &amp; Sediment Control' guide by the NSW Office of Environment &amp; Heritage</p>		<p>SERVICES</p> <p>Gas: --- G ---</p> <p>Electricity: --- E ---</p> <p>Water: --- W ---</p> <p>Sewer: --- S ---</p> <p>TelComm Local Cable: --- T ---</p> <p>TelComm Major or Optic Fibre: --- MOF ---</p>	<p>ADMINISTRATION CENTRE</p> <p>SHELLHARBOUR CIVIC CENTRE</p> <p>76 CYGNET AVENUE</p> <p>(Cnr Cygnet &amp; College Avenue)</p> <p>POSTAL ADDRESS</p> <p>Locked Bag 155</p> <p>SHELLHARBOUR CITY CENTRE NSW 2529</p> <p>PH: (02) 4221 6111</p> <p>FAX: (02) 4221 6016</p> <p>DX26402 SHELLHARBOUR CITY CENTRE</p>	<p>FILE: SCC BIORETENTION - INLET STRUCTURES</p> <p>PLAN No: _____</p> <p>REVISION</p> <p>SHEET: 7/25</p>																			

PLAN DETAILS  
SCC STANDARD DRAWING

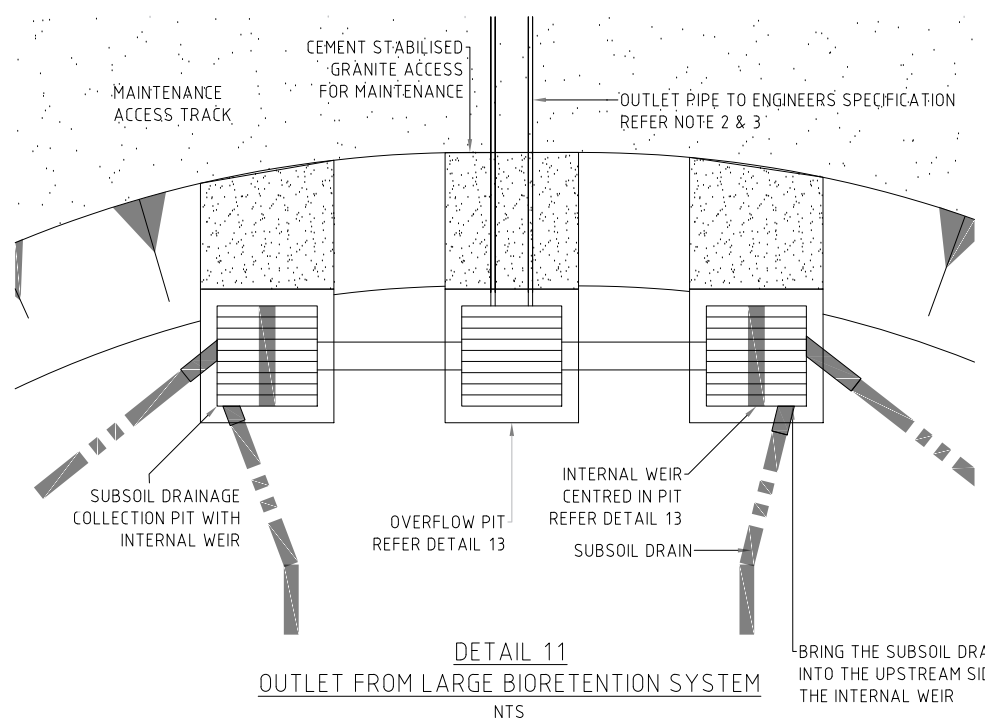


DETAIL 11  
OUTLET FROM LARGE BIORETENTION SYSTEM  
NTS

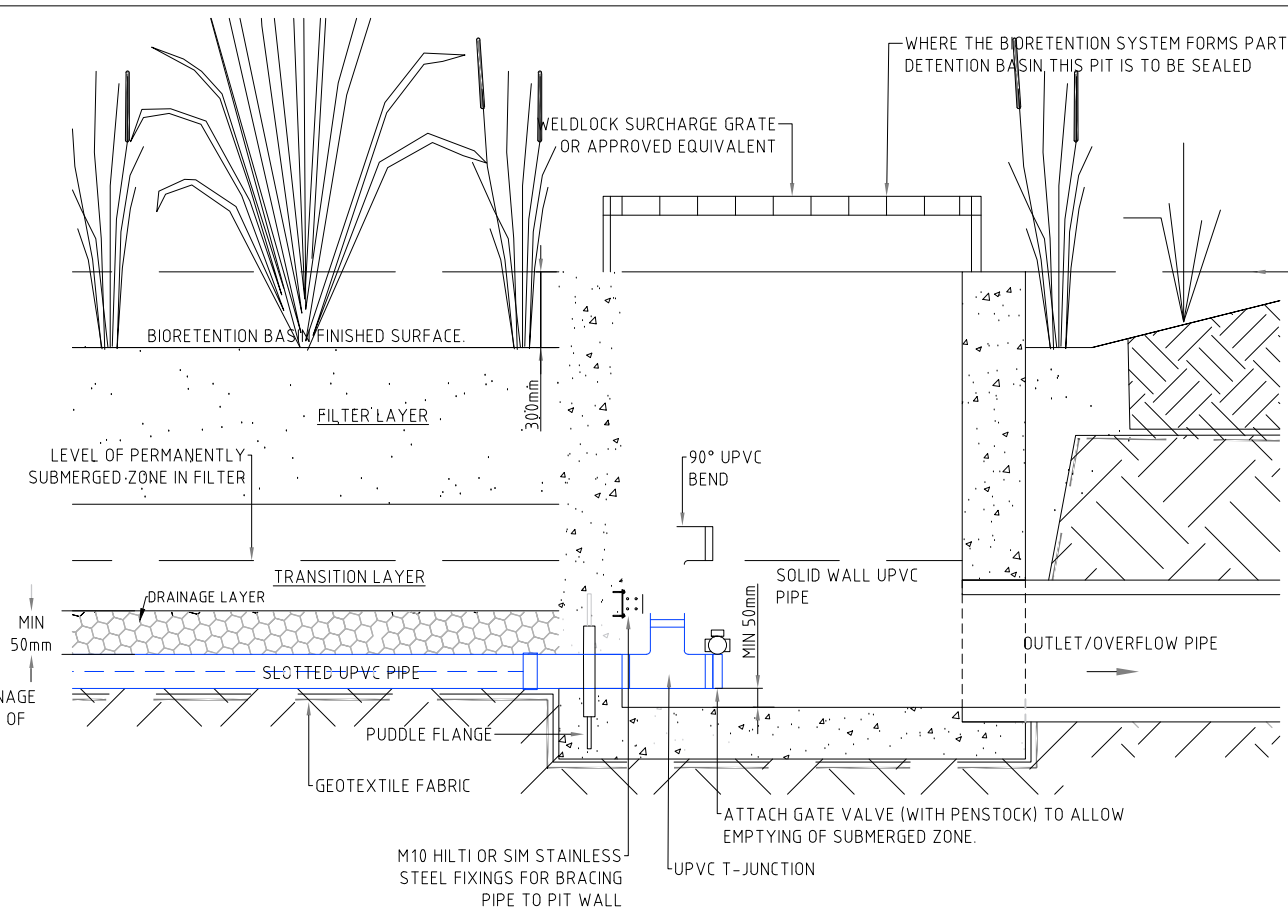

DETAIL 12  
OUTLET FOR SMALL SYSTEMS (<100m<sup>2</sup>) & RAINGARDENS (<30m<sup>2</sup>)  
NTS

- NOTES:
1. THE SYSTEM SHALL BE DESIGNED TO ENSURE THAT THE HGL DOES NOT RISE INTO THE MEDIA FOR A DESIGN FLOW ACHIEVED AT  $K_{SAT}$  WHEN THE DEPTH OF PONDING IS 300mm USING DARCY'S LAW. A 1.8m WIDE (2x900mm) WEIR AND SUBSOIL DRAINAGE AS SHOWN IN THESE DRAWINGS MEETS THIS CRITERIA FOR A 1000M<sup>2</sup> CELL.
  2. OVERFLOW PIT AND PIPE TO BE SIZED SO THAT WATER LEVEL IN PIT DOES NOT EXCEED THE LEVEL OF THE SATURATED ZONE IN 2 YEAR ARI EVENT TO ENSURE THE BIORETENTION SYSTEM REMAINS FUNCTIONAL.
  3. OUTLET PIPES SHALL BE DESIGNED TO HAVE THE SAME CAPACITY AS INLET PIPES.

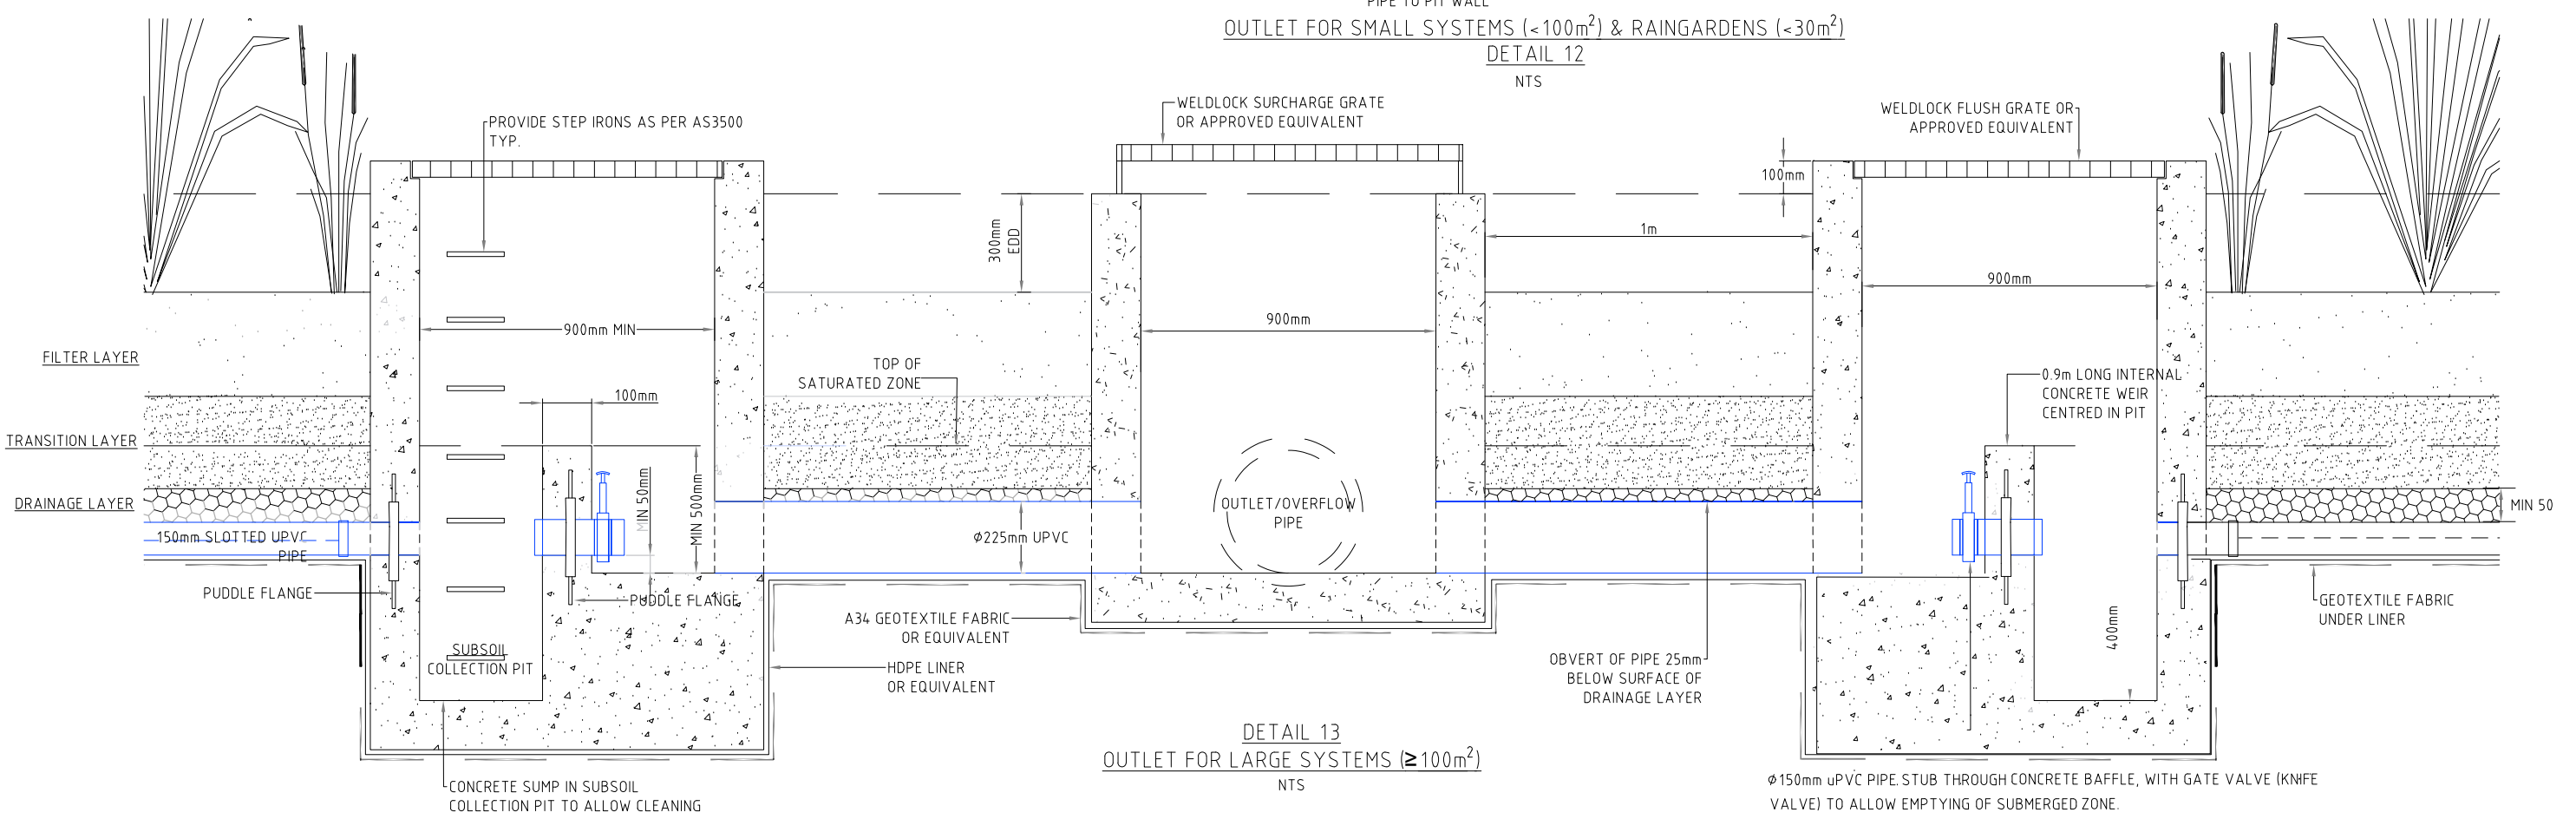

DETAIL 13  
OUTLET FOR LARGE SYSTEMS (≥100m<sup>2</sup>)  
NTS

NOT TO SCALE

LIST OF REVISIONS	AMENDMENT DETAILS	
REV.	DATE	OFFICER

SURVEYED OFFICER: \_\_\_\_\_  
DATE: \_\_\_\_\_  
SURVEY MARKS: \_\_\_\_\_

APPROVED - Manager Technical Services

DATE: \_\_\_\_\_

DESIGNED: _____	<b>SEDIMENT AND EROSION CONTROL</b> Provide sediment and erosion control measures in accordance with the 'Erosion & Sediment Control' guide by the NSW Office of Environment & Heritage
DATE: _____	
DRAWN: _____	
DATE: _____	

LOCATIONS SERVICES LEGEND

Services shown are those known to exist at date of design. Prior to commencement of excavation contact the relevant gas, electricity, water and telecommunications service providers, including the RMS, for most recent service locations and precautions that may be necessary

Gas: — G —  
Electricity: — E —  
Water: — W —  
Sewer: — S —  
TelComm Local Cable: — T —  
TelComm Major or Optic Fibre: — M —  
MOF: — MOF —

ADMINISTRATION CENTRE  
SHELLHARBOUR CIVIC CENTRE  
76 CYGNET AVENUE  
(Cnr Cygnet & College Avenue)

POSTAL ADDRESS  
Locked Bag 155  
SHELLHARBOUR CITY CENTRE NSW 2529

PH: (02) 4221 6111  
FAX: (02) 4221 6016  
DX26402 SHELLHARBOUR CITY CENTRE

# PLAN DETAILS


## SCC STANDARD DRAWING

FILE: SCC BIORETENTION - OUTLET STRUCTURES	REVISION
PLAN No: _____	SHEET: 8/25







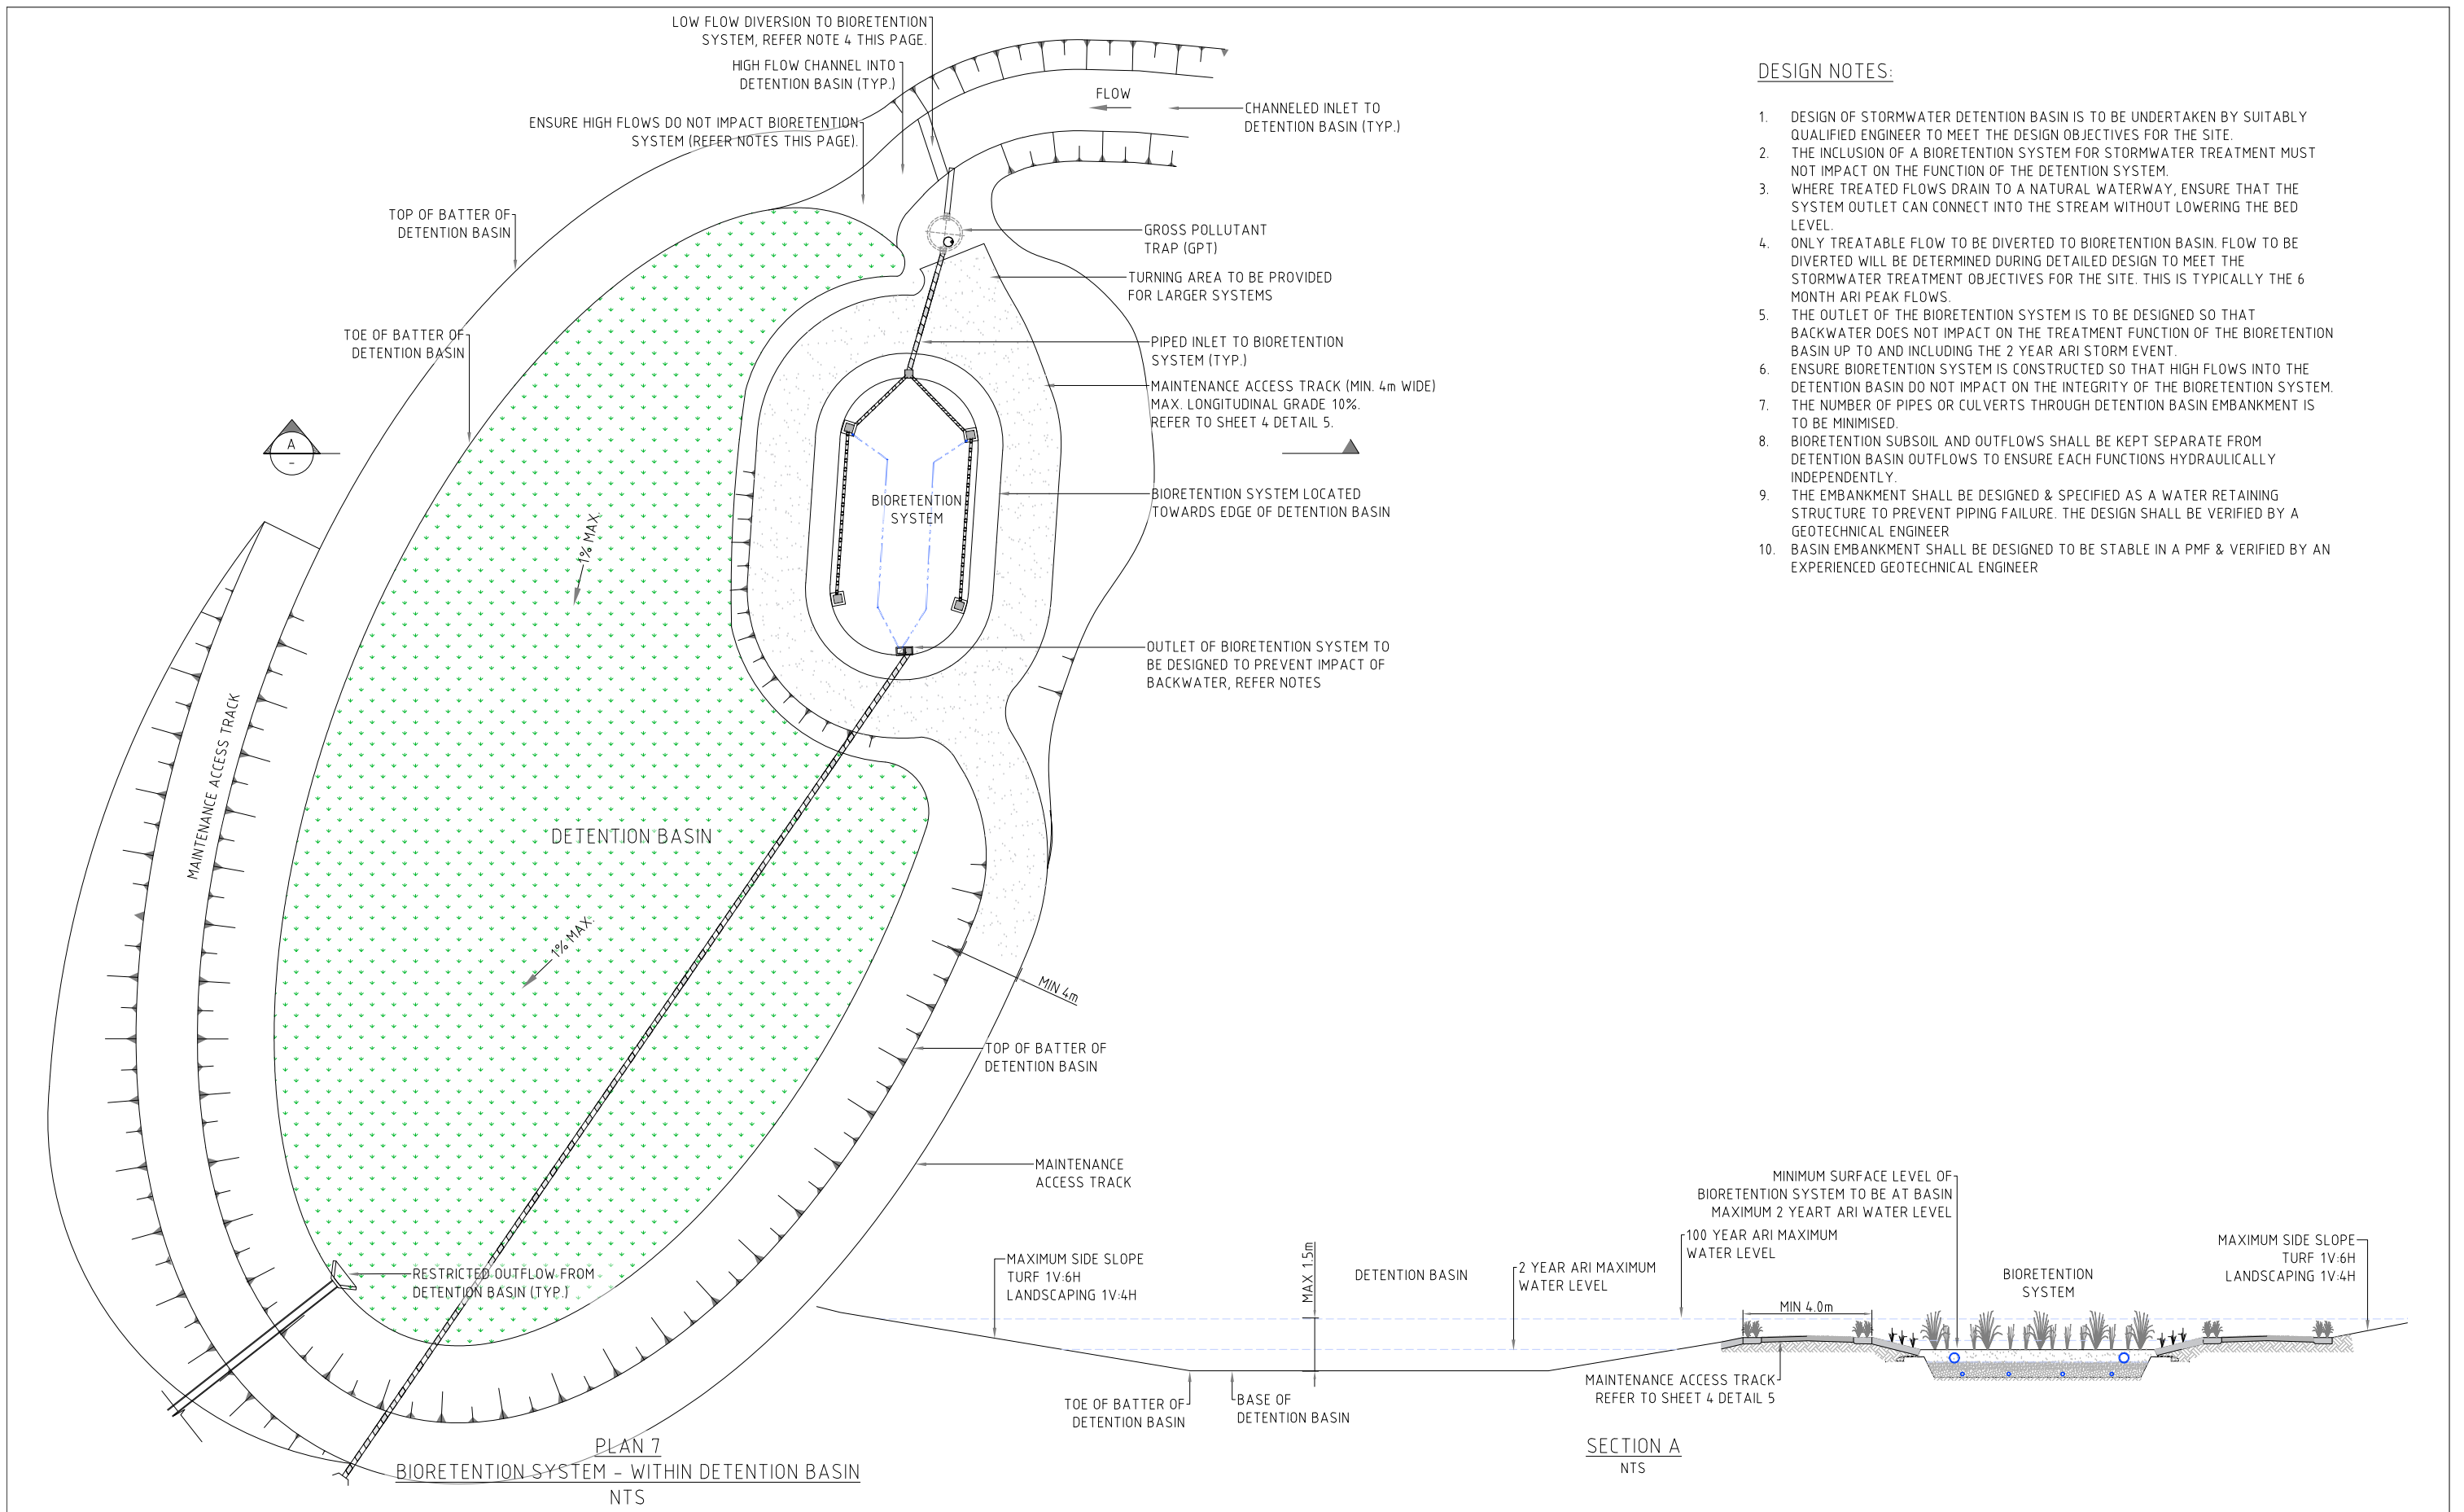


- DESIGN NOTES:**
1. DESIGN OF STORMWATER DETENTION BASIN IS TO BE UNDERTAKEN BY SUITABLY QUALIFIED ENGINEER TO MEET THE DESIGN OBJECTIVES FOR THE SITE.
  2. THE INCLUSION OF A BIORETENTION SYSTEM FOR STORMWATER TREATMENT MUST NOT IMPACT ON THE FUNCTION OF THE DETENTION SYSTEM.
  3. WHERE TREATED FLOWS DRAIN TO A NATURAL WATERWAY, ENSURE THAT THE SYSTEM OUTLET CAN CONNECT INTO THE STREAM WITHOUT LOWERING THE BED LEVEL.
  4. ONLY TREATABLE FLOW TO BE DIVERTED TO BIORETENTION BASIN. FLOW TO BE DIVERTED WILL BE DETERMINED DURING DETAILED DESIGN TO MEET THE STORMWATER TREATMENT OBJECTIVES FOR THE SITE. THIS IS TYPICALLY THE 6 MONTH ARI PEAK FLOWS.
  5. THE OUTLET OF THE BIORETENTION SYSTEM IS TO BE DESIGNED SO THAT BACKWATER DOES NOT IMPACT ON THE TREATMENT FUNCTION OF THE BIORETENTION BASIN UP TO AND INCLUDING THE 2 YEAR ARI STORM EVENT.
  6. ENSURE BIORETENTION SYSTEM IS CONSTRUCTED SO THAT HIGH FLOWS INTO THE DETENTION BASIN DO NOT IMPACT ON THE INTEGRITY OF THE BIORETENTION SYSTEM.
  7. THE NUMBER OF PIPES OR CULVERTS THROUGH DETENTION BASIN EMBANKMENT IS TO BE MINIMISED.
  8. BIORETENTION SUBSOIL AND OUTFLOWS SHALL BE KEPT SEPARATE FROM DETENTION BASIN OUTFLOWS TO ENSURE EACH FUNCTIONS HYDRAULICALLY INDEPENDENTLY.
  9. THE EMBANKMENT SHALL BE DESIGNED & SPECIFIED AS A WATER RETAINING STRUCTURE TO PREVENT PIPING FAILURE. THE DESIGN SHALL BE VERIFIED BY A GEOTECHNICAL ENGINEER
  10. BASIN EMBANKMENT SHALL BE DESIGNED TO BE STABLE IN A PMF & VERIFIED BY AN EXPERIENCED GEOTECHNICAL ENGINEER

<p>NOT TO SCALE</p> <p>SURVEYED OFFICER: _____ DATE: _____ SURVEY MARKS: _____</p>	<p>LIST OF REVISIONS</p> <table border="1"> <tr> <th>REV.</th> <th>DATE</th> <th>OFFICER</th> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> </table>	REV.	DATE	OFFICER																									<p>AMENDMENT DETAILS</p>	<p>APPROVED - Manager Technical Services</p> <p>DATE: _____</p>		<p>LOCATIONS</p> <p>Services shown are those known to exist at date of design. Prior to commencement of excavation contact the relevant gas, electricity, water and telecommunications service providers, including the RMS, for most recent service locations and precautions that may be necessary</p>	<p>SERVICES</p> <p>Gas: — G —</p> <p>Electricity: — E —</p> <p>Water: — W —</p> <p>Sewer: — S —</p> <p>TelComm Local Cable: — T —</p> <p>TelComm Major or Optic Fibre: — MOF —</p>	<p>ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet &amp; College Avenue)</p> <p>POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529</p> <p>PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE</p>	<p><b>PLAN DETAILS</b></p> <p><b>SCC STANDARD DRAWING</b></p>		<p>FILE: SCC BIORETENTION - WITHIN FLOOD DETENTION BASIN</p>	<p>REVISION</p>
		REV.	DATE	OFFICER																																		
<p>DESIGNED: _____</p> <p>DATE: _____</p>	<p>SEDIMENT AND EROSION CONTROL</p> <p>Provide sediment and erosion control measures in accordance with the 'Erosion &amp; Sediment Control' guide by the NSW Office of Environment &amp; Heritage</p>	<p>PLAN No: _____</p>	<p>SHEET: 11/25</p>																																			




**DESIGN NOTES:**

- VEGETATION COVER IS AN ESSENTIAL FUNCTIONAL COMPONENT OF THE BIORETENTION BASIN
- PLANTS ARE TO BE 25mm HIKO CELLS OR 50mm TUBESTOCK
- PLANTING SHOULD OCCUR NO LATER THAN 14 DAYS AFTER INSTALLATION OF THE FILTER MEDIA. AFTER PLANTING THE SOIL SHOULD BE RE-INSTATED TO A FLAT SURFACE.
- THE PLANTS SHALL BE PLANTED AS A MATRIX ENSURING A DIVERSE COVERAGE.
- PLANTING SHOULD INCORPORATE SEVERAL TYPES OF VEGETATION INCLUDING SHRUBS AND GRASSES AND TUFTED PLANTS FROM THE PLANTING LIST.
- A MINIMUM OF 4 DIFFERENT SPECIES IS REQUIRED FOR RAINGARDENS (<30m<sup>2</sup>), A MIN OF 6 FOR SMALL SYSTEMS < 100m<sup>2</sup> & 10 OR MORE FOR LARGE SYSTEMS (>100m<sup>2</sup>).
- PLANT ESTABLISHMENT AND WATERING IS REQUIRED FOR 12 MONTHS FROM PLANTING.
- NO SURFACE MULCHING OF BIORETENTION BASINS IS PERMITTED.
- NO WEED MAT OR HYDRO-MULCH IS TO BE APPLIED TO THE SURFACE OF THE BIORETENTION BASIN FOLLOWING THE CONSTRUCTION PHASE (I.E. IN ITS FINAL DESIGN FORM, VEGETATED AS PER PLANTING SCHEDULE), AS THIS WILL HINDER FILTRATION OF STORMWATER THROUGH THE FILTER MEDIA. JUTE MATTING IS PERMITTED.
- 40% OF COVERAGE SHALL COMPRISE OF THE PLANTS MARKED WITH \*\*\*
- PLANTS FROM THE PREFERRED PLANTING LIST SHALL BE PLANTED IN PREFERENCE TO PLANTS FROM THE ALTERNATIVE PLANTING LIST. PLANTS FROM THE ALTERNATIVE PLANTING LIST CAN BE USED WHERE PREFERRED PLANTS ARE COMMERCIALY UNAVAILABLE.
- PLANTING SHALL IDEALLY OCCUR FROM OCTOBER TO MARCH TO IMPROVE VIABILITY OF JURENILE PLANTS.
- ALL PLANTS SHALL BE HARDENED PRIOR TO PLANTING.
- SOME PLANTS MAY NOT BE AVAILABLE COMMERCIALY & MAY NEED TO BE GROWN FROM SEED. THIS CAN TAKE UP TO 12 MONTHS. PLANNING OF PLANTING STAGE SHALL TAKE LONG LEAD IN TIMES INTO ACCOUNT.
- THE FINAL PLANTING LIST SHALL BE APPROVED BY COUNCIL.

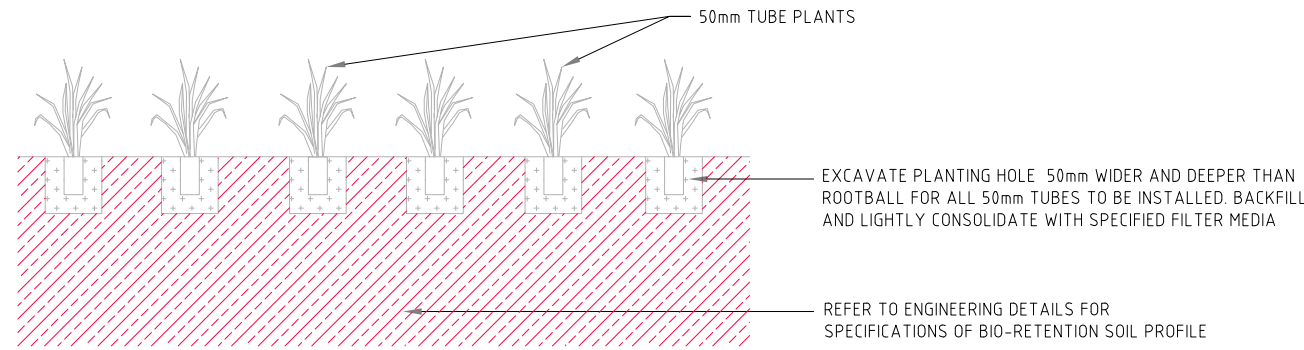

**DETAIL 17**  
TYPICAL PLANTING  
NTS

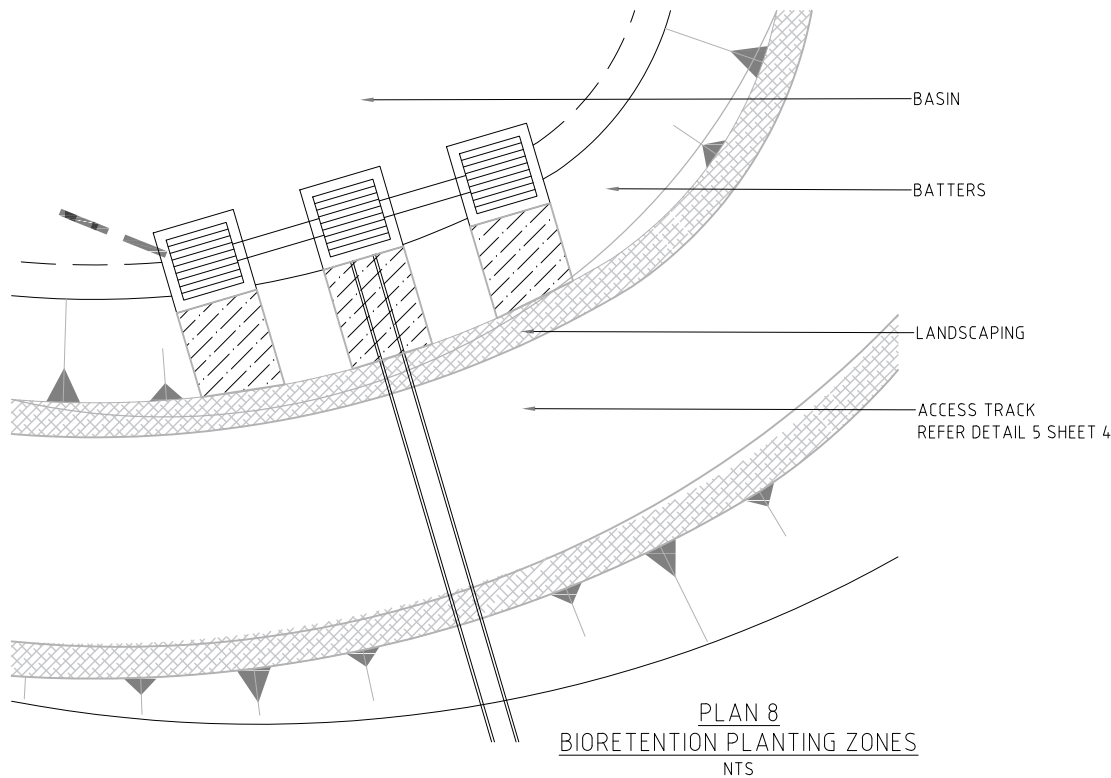

**PLAN 8**  
BIORETENTION PLANTING ZONES  
NTS

**PREFERRED PLANTING LIST**

COMMON NAME	SPECIES	TYPE OF VEGETATION	PLANT DENSITY PER m <sup>2</sup>	PLANTING ZONE (REFER PLAN 8)
Tall Sedge ***	<i>Carex appressa</i>	Tufted short rhizomatous, 1.2 h	8-10	Basin
Blue Flax-Lily	<i>Dianella revoluta</i>	Tufted perennial herb, 1 h	8-10	Basin
Wallaby Grass ***	<i>Rytidosperma tenuior, Austroanthonia tenuior, Danthonia tenuior</i>	Tufted perennial grass, 1.2 h	8-10	Basin
Common Rush ***	<i>Juncus usitatus</i>	Tufted short rhizomatous, 1 h	8-10	Basin
Kangaroo Grass ***	<i>Themeda trianda, Themeda australis</i>	Densely tufted leafy perennial, 1.2 h	8-10	Basin
Knobby Club Rush ***	<i>Ficinia nodosa</i>	Rhizomatous perennial, 1 h	8-10	Basin
Eskdale, Tussock Grass	<i>Poa labillardieri</i>	Densely tufted perennial grass, 0.6 h	8-10	Basin
Gorse Bitter Pea	<i>Daviesia ulicifolia</i>	Small shrub, 2 h	1 per 2 m <sup>2</sup>	Basin & Batters
Pink Honey Myrtle	<i>Melaleuca erubescens</i>	Hard, rough barked shrub, 2 m	1 per 2 m <sup>2</sup>	Basin & Batters
Blueberry Lily	<i>Dianella longifolia</i>	Perennial rhizomatous tufted herb, 1 h	8-10	Batters & Landscape
Wattle Mat-rush	<i>Lomandra filiformis</i>	Perennial tussock, 0.5 h	8-10	Batters & Landscape
Tanika, Spiny Mat-rush	<i>Lomandra longifolia</i>	Perennial weeping tussock, 0.7 h	8-10	Batters & Landscape
Weeping Grass	<i>Microlaena stipoides</i>	Slender, tufted perennial grass, 0.7 h	8-10	Batters & Landscape
Pale Rush	<i>Juncus pallidus</i>		8-10	Basin
Sea Rush	<i>Juncus kraussii</i>	Tussock, rhizomatous perennial, 1 m	8-10	Basin
N/A	<i>Lachnagrostis filiformis</i>	Erect perennial grass, 0.7 h	8-10	Basin
N/A	<i>Lachnagrostis billardierei</i>	Erect perennial grass, 0.7 h	8-10	Basin
Chaffy Saw-sedge	<i>Gahnia filum</i>	Tussock forming perennial, 1 h	8-10	Basin
N/A	<i>Cyperus polystachyos</i>	Tufted perennial, short rhizome, 0.6 h	8-10	Basin
N/A	<i>Austrostipa stipoides</i>	Tufted perennial grass, 1.2 h	8-10	Basin
Tassel Sedge	<i>Carex fascicularis</i>	Tufted rhizomatous perennial, 1 h	8-10	Basin
Swamp Foxtail Grass	<i>Pennisetum alopecuroides</i>	Clumping tussocks perennial, 1.5 h	8-10	All
N/A	<i>Baloskion / Restio pallens</i>	Dioecious perennial herb, 1 h	8-10	Basin
N/A	<i>Schoenoplectus mucronatus</i>	Tufted perennial, 1 h	8-10	Basin
Marsh Clubrush	<i>Bolboschoenus fluviatilis</i>	Rhizomatous tufted perennial, 2.5 h	8-10	Basin
N/A	<i>Bolboschoenus caldwellii</i>	Rhizomatous tufted perennial, 1 h	8-10	Basin

THE PLANTS IN THIS LIST HAVE BEEN SELECTED SPECIFICALLY FOR WESTERN SYDNEY CONDITIONS BY HUNTER & SAINTY  
h REFERS TO MATURE HEIGHT (m)


**ALTERNATIVE PLANTING LIST**

COMMON NAME	SPECIES	TYPE OF VEGETATION	PLANT DENSITY PER m <sup>2</sup>	PLANTING ZONE (REFER PLAN 8)
Corkscrew Grass	<i>Austrostipa setacea</i>	Tufted perennial grass, 0.8h	8-10	Basin
Barbed Wire Grass	<i>Cymbopogon refractus</i>	Tufted perennial grass, 1 h	8-10	Basin
Shorthair Plume Grass	<i>Dichelachne micrantha</i>	Tufted perennial grass, 1.2 h	8-10	Basin
Forest Hedgehog Grass	<i>Echinopogon ovatus</i>	Rhizomatous perennial, 1.2 h	8-10	Basin
Wiry Panic Grass	<i>Entolasia stricta</i>	Shrubby rhizomatous perennial, 0.8 h	8-10	Basin
Paddock Lovegrass	<i>Eragrostis leptostachya</i>	Loosely tufted perennial, 1 h	8-10	Basin
Hop Goodenia	<i>Goodenia ovata</i>	Erect, ascending or prostrate shrub, 2 h	1 per 2 m <sup>2</sup>	Basin & Batters
Sticky Hop Bush	<i>Dodonaea viscosa</i>	Small shrub to tree, 8 m	1 per 2 m <sup>2</sup>	Batters & Landscape
N/A	<i>Cyperus laevigatus</i>	Rhizomatous perennial, 0.6 h	8-10	Basin
Queensland Bluegrass	<i>Dichantheum sericeum</i>	Tufted warm season perennial, 1.2 h	8-10	Basin


<b>NOT TO SCALE</b>	<b>LIST OF REVISIONS</b> REV. DATE OFFICER	<b>AMENDMENT DETAILS</b>	<b>APPROVED - Manager Technical Services</b> DATE:	<b>SERVICES</b> LEGEND Gas: --- G --- Electricity: --- E --- Water: --- W --- Sewer: --- S --- TelComm Local Cable: --- T --- TelComm Major or Optic Fibre: --- MOF ---	 ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet & College Avenue)  POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529 PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE	<b>PLAN DETAILS</b> <b>SCC STANDARD DRAWING</b>	FILE: SCC BIORETENTION - LANDSCAPING	REVISION  SHEET: 12/25
SURVEYED OFFICER: DATE: SURVEY MARKS:	DESIGNED: DATE: DRAWN: DATE:	SEDIMENT AND EROSION CONTROL Provide sediment and erosion control measures in accordance with the 'Erosion & Sediment Control' guide by the NSW Office of Environment & Heritage						






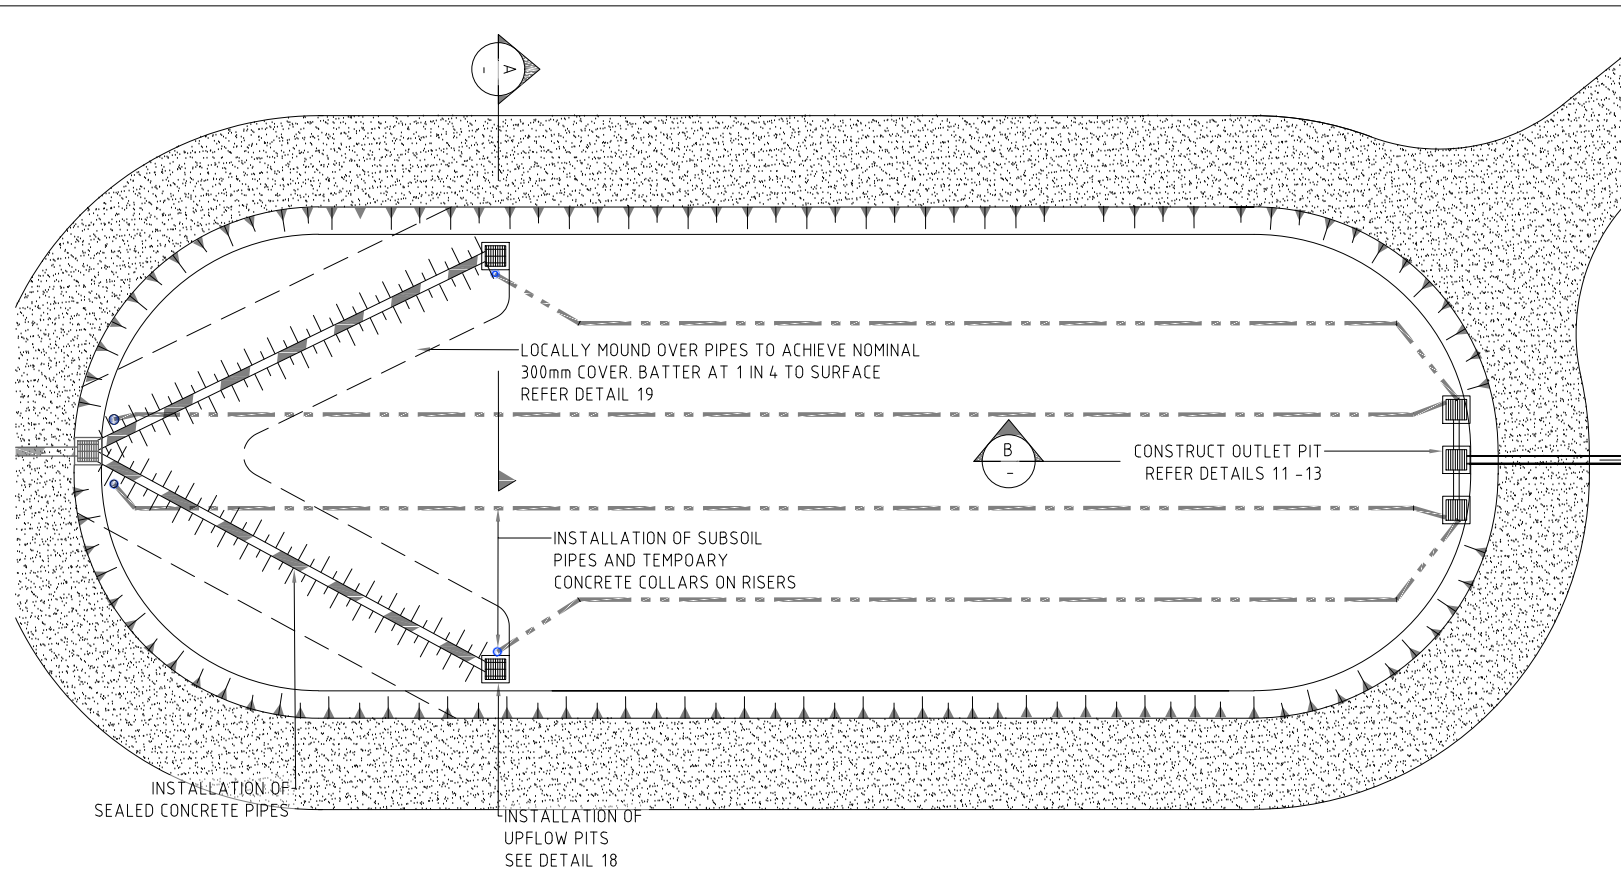

STAGE 2  
NTS

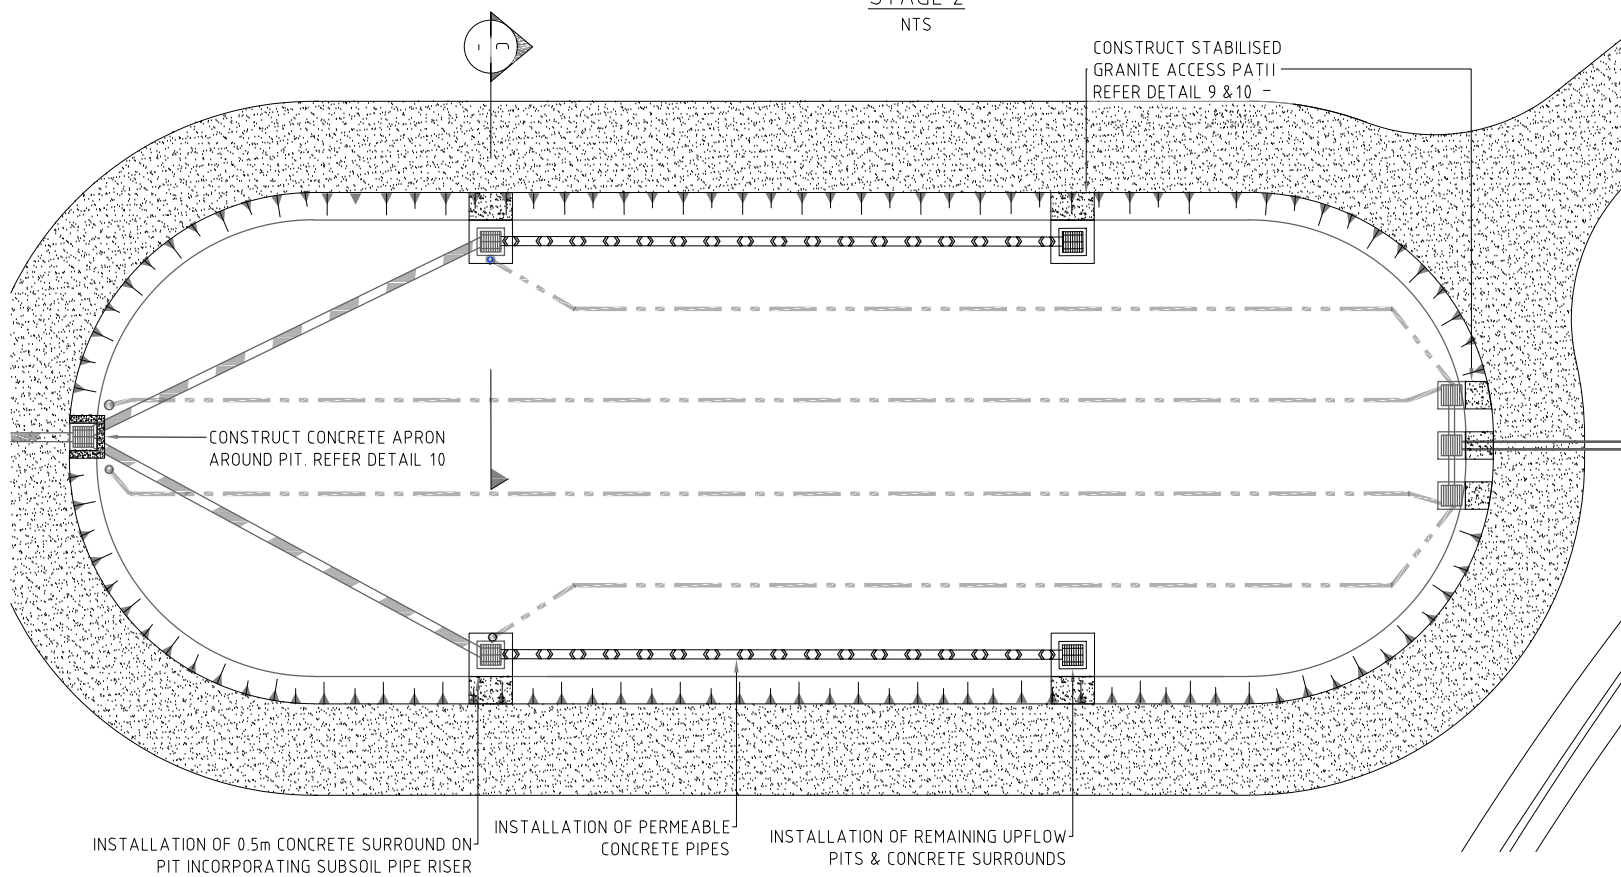


STAGE 3  
NTS

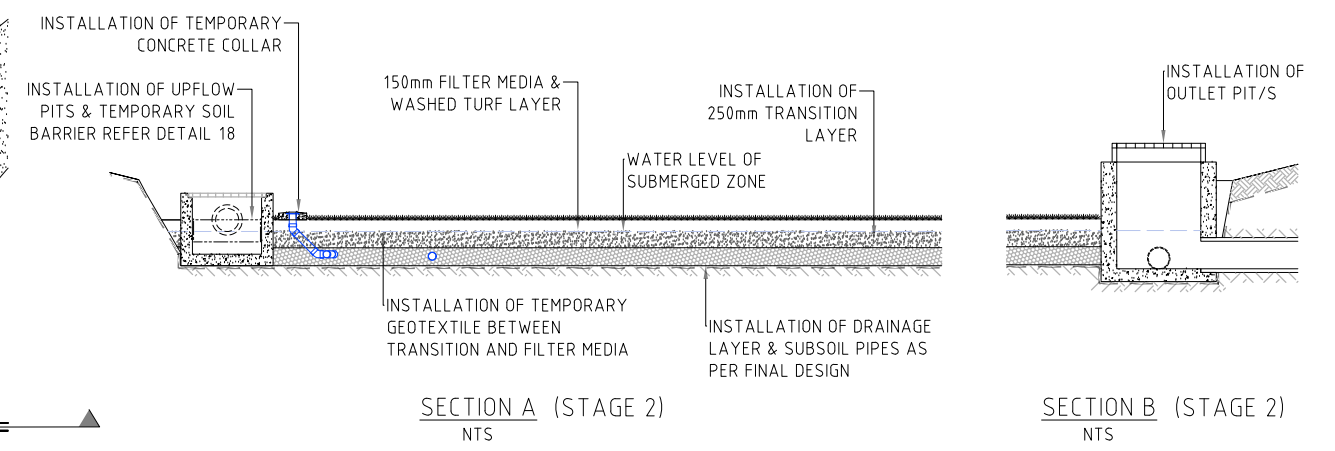


SECTION A (STAGE 2)  
NTS

SECTION B (STAGE 2)  
NTS

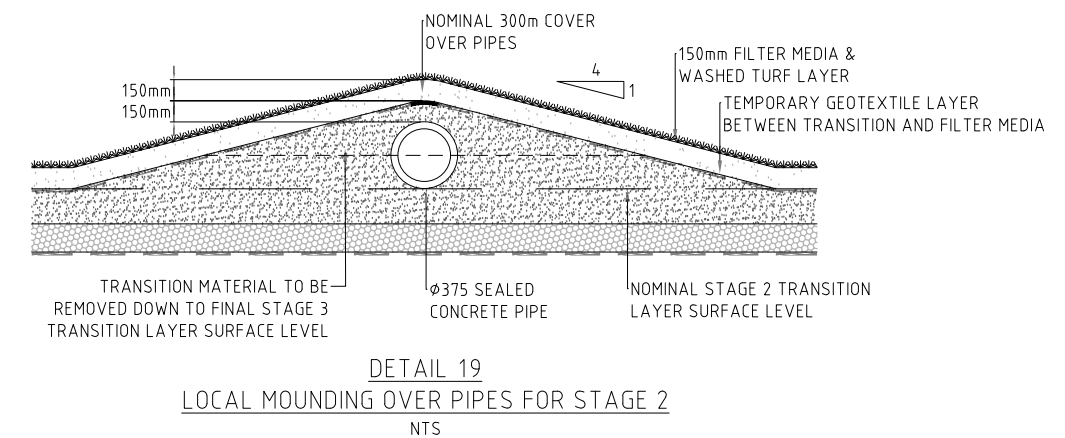


DETAIL 19  
LOCAL MOUNDING OVER PIPES FOR STAGE 2  
NTS

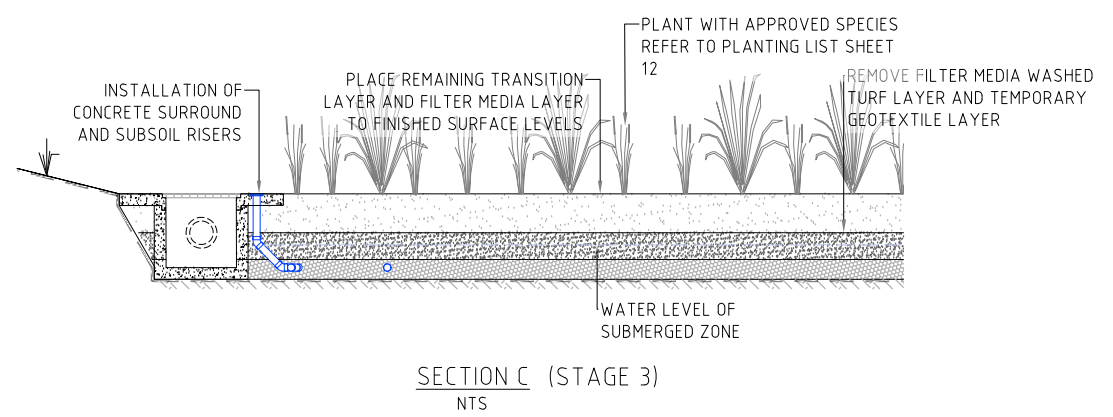


SECTION C (STAGE 3)  
NTS

<p>NOT TO SCALE</p> <p>SURVEYED OFFICER: _____ DATE: _____ SURVEY MARKS: _____</p>	<p>LIST OF REVISIONS</p> <table border="1"> <tr> <th>REV.</th> <th>DATE</th> <th>OFFICER</th> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> </table>	REV.	DATE	OFFICER																<p>AMENDMENT DETAILS</p>	<p>APPROVED - Manager Technical Services</p> <p>DATE: _____</p>		<p>LOCATIONS</p> <p>Services shown are those known to exist at date of design. Prior to commencement of excavation contact the relevant gas, electricity, water and telecommunications service providers, including the RMS, for most recent service locations and precautions that may be necessary</p>	<p>SERVICES</p> <p>LEGEND</p> <p>Gas: — G —</p> <p>Electricity: — E —</p> <p>Water: — W —</p> <p>Sewer: — S —</p> <p>TelComm Local Cable: — T —</p> <p>TelComm Major or Optic Fibre: — MOF —</p>	<p>ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet &amp; College Avenue)</p> <p>POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529</p> <p>PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE</p>	<p>FILE: SCC BIORETENTION - CONSTRUCTION WORKS STAGING 2</p>		<p>REVISION</p> <p>SHEET: 14/25</p>
		REV.	DATE	OFFICER																								
<p>DESIGNED: _____</p> <p>DATE: _____</p>		<p>SEDIMENT AND EROSION CONTROL</p> <p>Provide sediment and erosion control measures in accordance with the 'Erosion &amp; Sediment Control' guide by the NSW Office of Environment &amp; Heritage</p>		<p>PLAN DETAILS</p> <p>SCC STANDARD DRAWING</p>																								



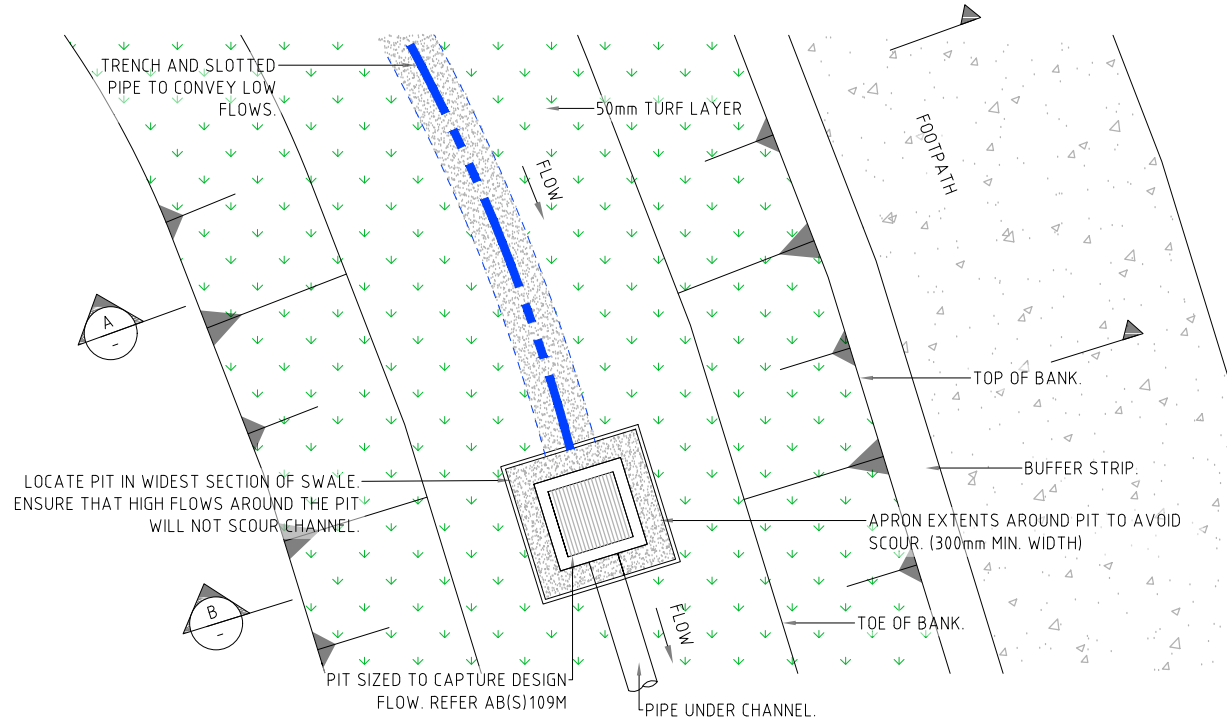


PLAN 10  
TYPICAL SWALE FOR FLAT SITE  
NTS

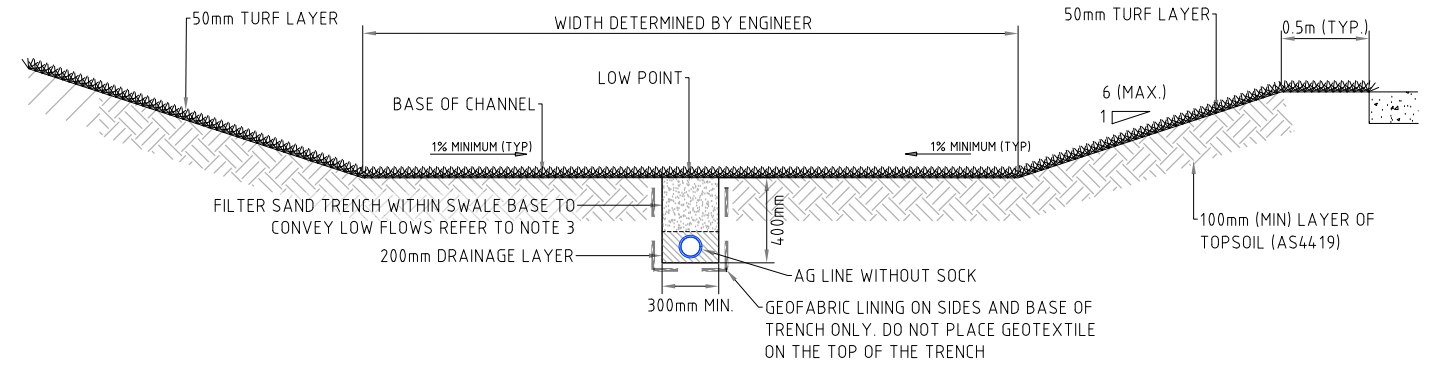

SECTION A  
NTS

**DESIGN NOTES:**


- PERMANENT PONDING AND WATERLOGGING CAN BE AN ISSUE IN FLAT SWALES, WHERE THE LONGITUDINAL SLOPE IS 1% OR LESS, LOW FLOW DRAINAGE SHALL BE INCLUDED TO MINIMISE THIS PROBLEM. CONSIDER MULTIPLE SLOTTED PIPES IN LARGE SWALES OR WHERE THE GRADE IS LESS THAN 1%. WHERE GRADE ARE STEEPER THAN 4% USE CHECK DAMS - REFER SHEET 16 FOR DETAILS
- WHERE SWALES ARE INCORPORATED IN STREET VERGES, OTHER KEY ISSUES INCLUDE:
  - CROSS SECTIONAL DIMENSIONS NEED TO ACCOMMODATE PATHWAYS, ETC. TO MEET LOCAL AUTHORITY GUIDELINES
  - CROSSING POINTS - REFER A(BS)103 FOR DRIVEWAY CROSSING DETAIL.
  - INFLOWS FROM NEIGHBOURING ALLOTMENTS.
  - PROTECTION FROM VEHICULAR DAMAGE. USE BOLLARDS OR OTHER BARRIERS TO PREVENT VEHICLE ENTRY.
  - A ROOT BARRIER MAY BE REQUIRED WHERE THE SWALE INCLUDES TREES PLANTED NEXT TO ROADWAYS OR OTHER INFRASTRUCTURE.
- FILTER SAND TO COMPLY WITH SPECIFICATION FOR TRANSITION LAYER. REFER SHEET 2 FOR DETAILS.
- MAX ACCEPTABLE VELOCITY DURING A 100 YEAR ARI EVENT SHALL BE 1.0m/s TO AVOID SCOUR OF THE SURFACE

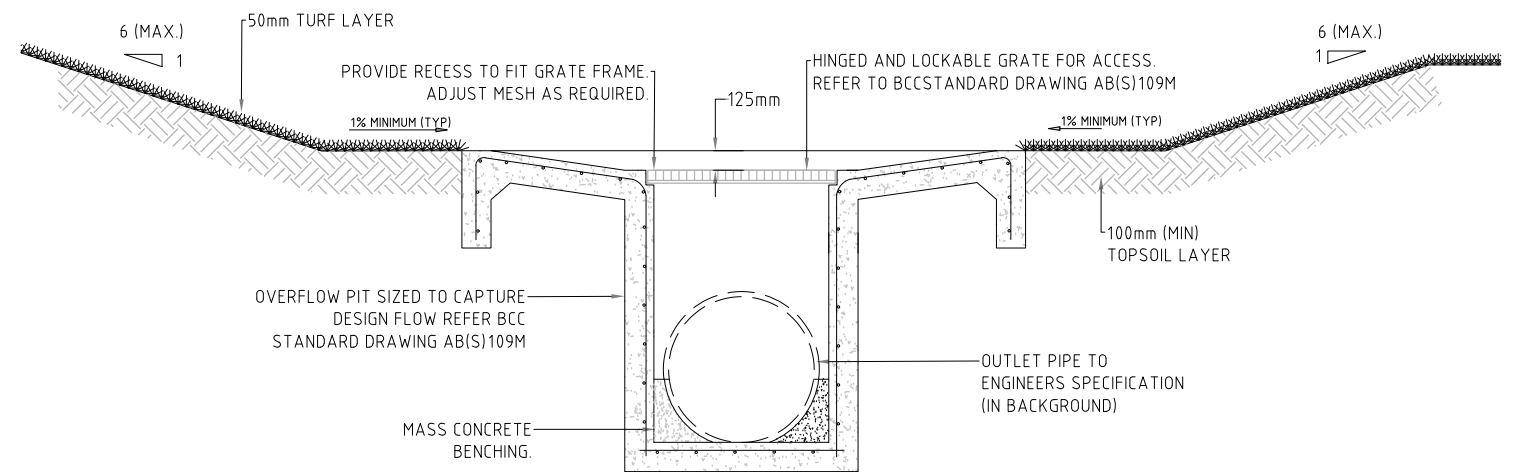


SECTION B  
NTS

NOT TO SCALE	LIST OF REVISIONS REV. DATE OFFICER	AMENDMENT DETAILS	APPROVED - Manager Technical Services		LOCATIONS	SERVICES	LEGEND	ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet & College Avenue) POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529 PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE	PLAN DETAILS SCC STANDARD DRAWING		FILE: SCC VEGETATED SWALES - FLAT SITES	REVISION
			DESIGNED: DATE:	SEDIMENT AND EROSION CONTROL Provide sediment and erosion control measures in accordance with the 'Erosion & Sediment Control' guide by the NSW Office of Environment & Heritage					Gas: — G — Electricity: — E — Water: — W — Sewer: — S — TelComm Local Cable: — T — TelComm Major or Optic Fibre: — MOF —	PLAN No:	SHEET: 15/25	




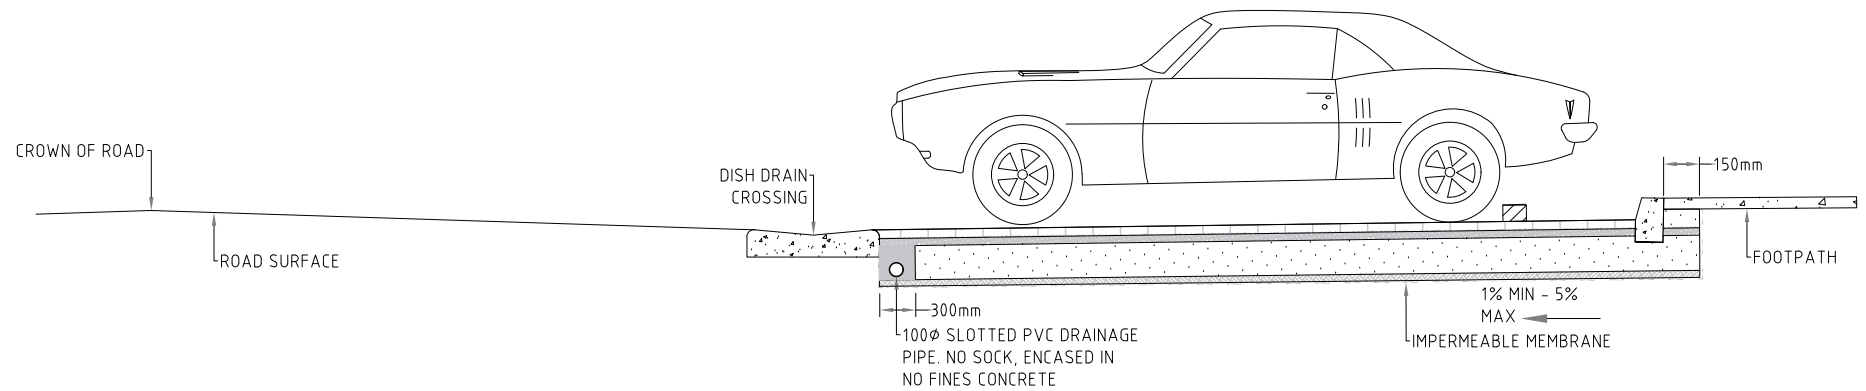


SECTION A  
NTS

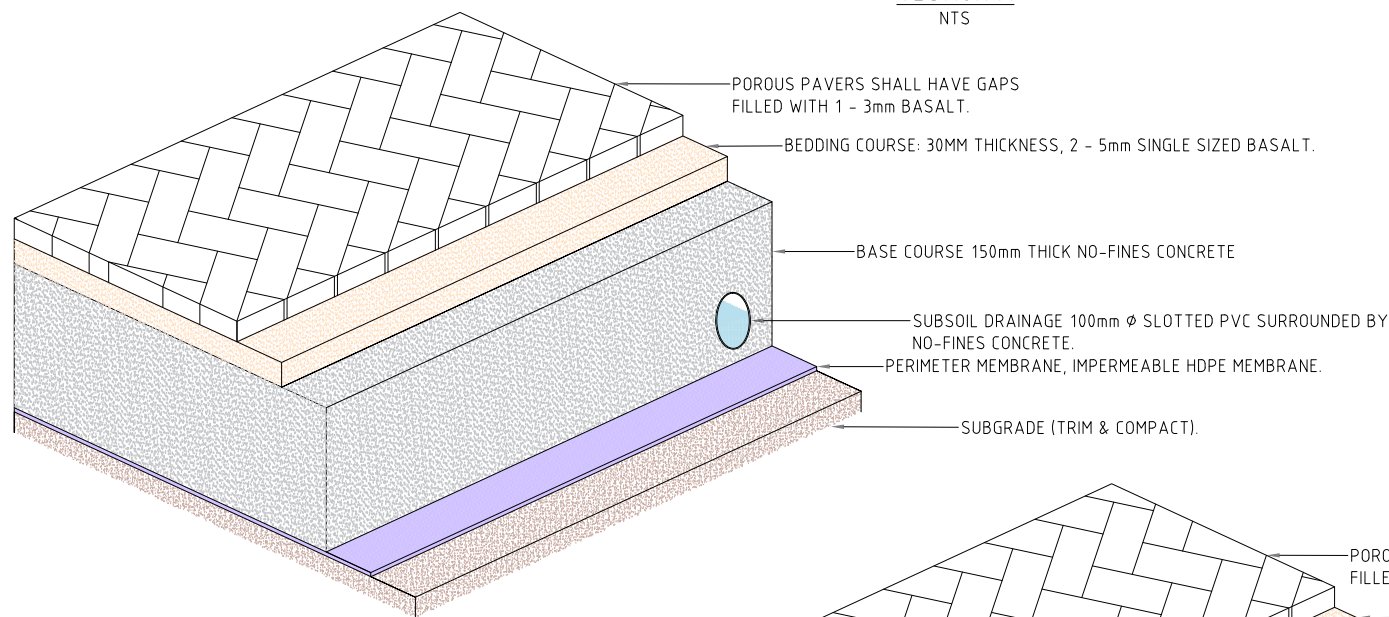

DETAIL 21A  
TYPICAL SECTION POROUS PAVERS WITH  
NO-FINES CONCRETE BASE COURSE  
NTS

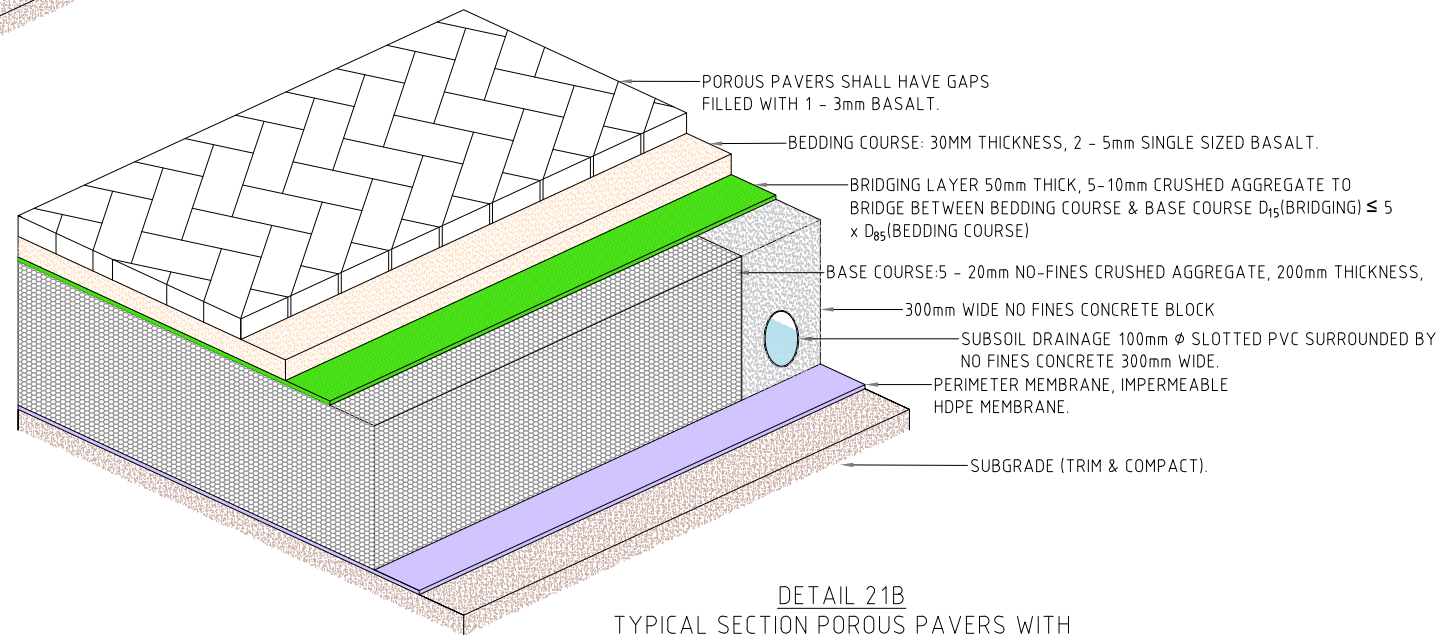

DETAIL 21B  
TYPICAL SECTION POROUS PAVERS WITH  
CRUSHED AGGREGATE BASE COURSE  
NTS

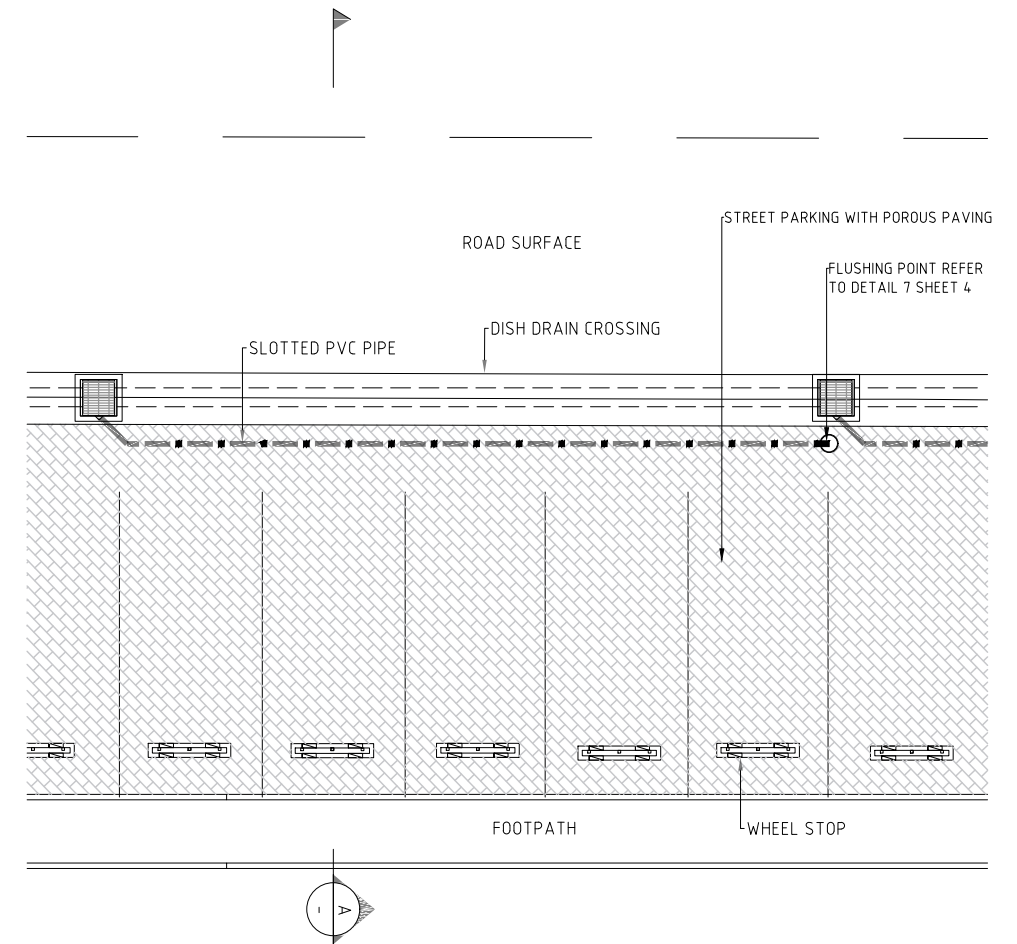



PLAN 12  
USE OF POROUS PAVING IN ON STREET PARKING  
NTS

**DESIGN NOTES:**


1. PERMEABLE PAVEMENT IS MOST SUITABLE TO PEDESTRIAN OR LOW TRAFFIC AREAS.
2. PERMEABLE PAVEMENT SHALL NOT BE USED IN AREAS WITH HEAVY TRAFFIC OR WHERE HEAVY VEHICLES ARE TURNING.
3. CLAY SOILS IN BLACKTOWN RESTRICT INFILTRATION. SUBSOIL DRAINAGE SHALL BE USED.
4. PERMEABLE PAVEMENTS SHALL HAVE NO RUN-ON WATERFLOW.
5. ANY PERMEABLE PAVEMENTS SHALL BE DESIGNED BY AN EXPERIENCED, QUALIFIED CIVIL, GEOTECHNICAL OR STRUCTURAL ENGINEER.
6. ONLY POROUS PAVERS SHALL BE USED.
7. IF THE BASE COURSE IS TO BE NO-FINES CONCRETE THEN THE BRIDGING LAYER IS NOT REQUIRED
8. SUBSOIL DRAIN LINES ARE TO HAVE FLUSHING POINTS EVERY 20m NOMINAL.
9. CLEANING & OR RENEWAL REQUIRED WHERE WATER PONDS FOR MORE THAN 1 HOUR AFTER RAINFALL.

NOT TO SCALE	LIST OF REVISIONS	AMENDMENT DETAILS	APPROVED - Manager Technical Services	LOCATIONS	SERVICES	 ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet & College Avenue) POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529 PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE	<h2 style="text-align: center;">PLAN DETAILS</h2> <h1 style="text-align: center;">SCC STANDARD DRAWING</h1>		FILE:	REVISION
	SURVEYED OFFICER: DATE: SURVEY MARKS:	REV. DATE OFFICER ..... ..... ..... ..... ..... ..... ..... ..... ..... .....		DATE:  DESIGNED: DATE: DRAWN: DATE:	SERVICES SHOWN ARE THOSE KNOWN TO EXIST AT DATE OF DESIGN. PRIOR TO COMMENCEMENT OF EXCAVATION CONTACT THE RELEVANT GAS, ELECTRICITY, WATER AND TELECOMMUNICATIONS SERVICE PROVIDERS, INCLUDING THE RMS, FOR MOST RECENT SERVICE LOCATIONS AND PRECAUTIONS THAT MAY BE NECESSARY				LEGEND Gas: --- G --- Electricity: --- E --- Water: --- W --- Sewer: --- S --- TelComm Local Cable: --- T --- TelComm Major or Optic Fibre: --- MOF ---	FILE: SCC POROUS PAVING
								PLAN No:	SHEET:	17/25



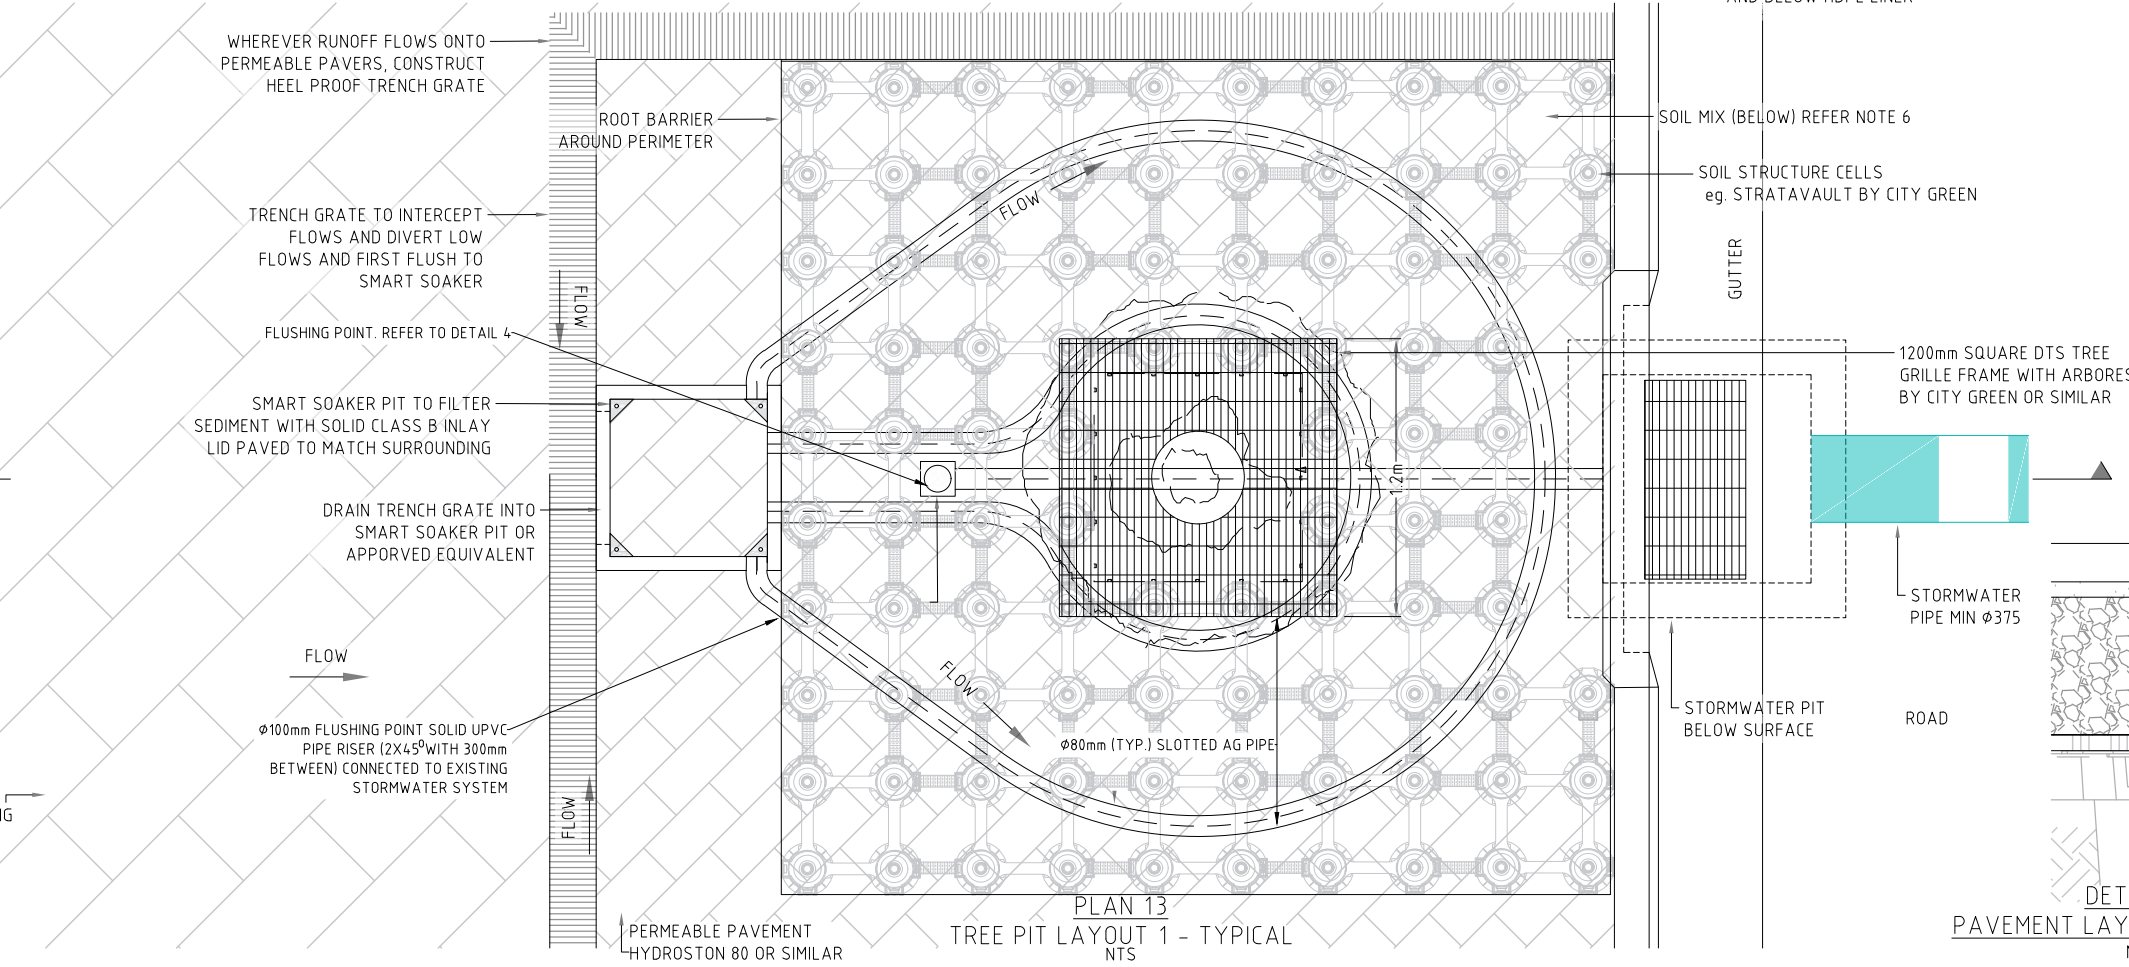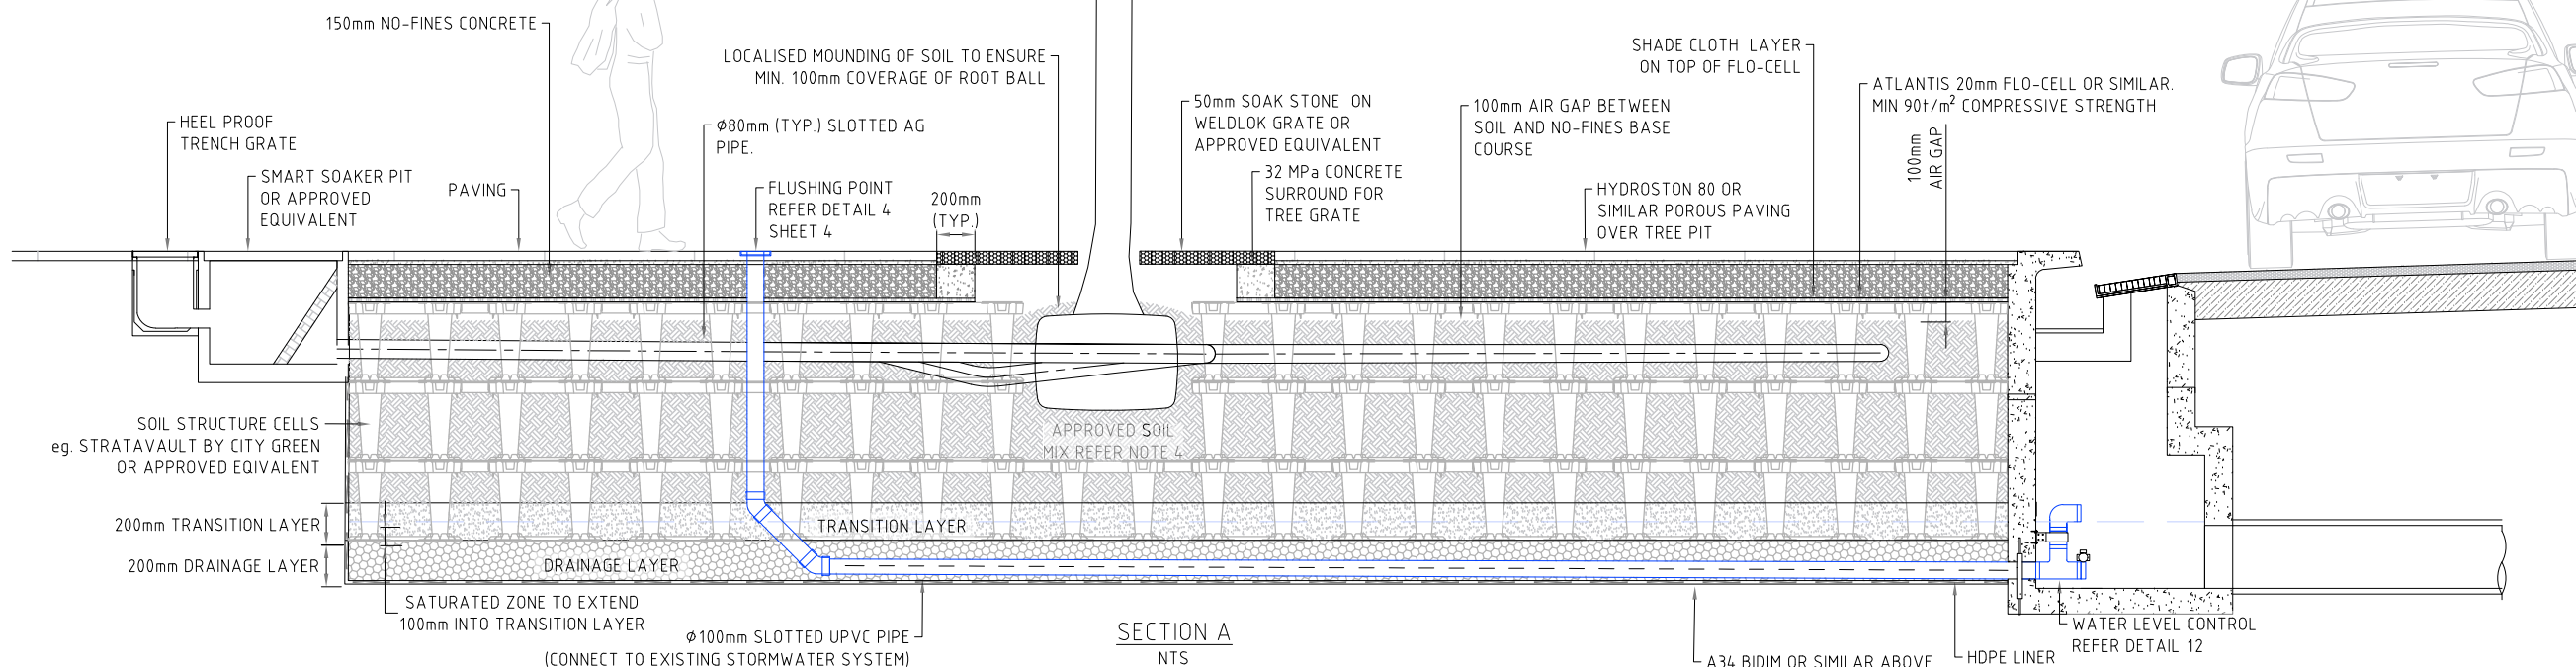

- DESIGN NOTES:**
- IT IS INTENDED THAT THIS TREATMENT IS APPLICABLE TO TOWN CENTRES AND DENSE URBAN AREAS. IT WOULD BE SUITABLE FOR PAVED OPEN SPACE AREAS WHICH CAN BENEFIT FROM EXTENSIVE SHADING AND URBAN COOLING SUCH AS OUTDOOR EATING AREAS.
  - THE LENGTH TO WIDTH RATIO OF THE TREE PIT SHALL NOT EXCEED 2:1.
  - THE STANDARD DETAILS SHOWN ON THIS DRAWING ARE TYPICAL ONLY. THESE DETAILS MAY NEED TO BE RECONFIGURED TO SUIT SITE SPECIFIC CONDITIONS.
  - THE VOLUME OF SOIL TO BE USED IN A TREE PIT SHALL BE A MIN. OF 30m<sup>3</sup>.
  - WHERE POSSIBLE GRADE PAVING TO DIRECT FLOWS TOWARDS THE TREE PITS WITHOUT CREATING A TRAPPED LOW POINT.
  - SOIL MIX SHALL BE AS PER CITY GREEN RECOMMENDATIONS FOR TREE PITS.
  - WHERE TRENCH GRATES OR PERMEABLE PAVERS ARE INAPPROPRIATE OR THE CATCHMENT IS LESS THAN 100m<sup>2</sup> CONSIDER SUPPLYING WATER FROM ALTERNATIVE SOURCES SUCH AS ROOF RUNOFF AND PROVIDE A HIGH FLOW BYPASS.




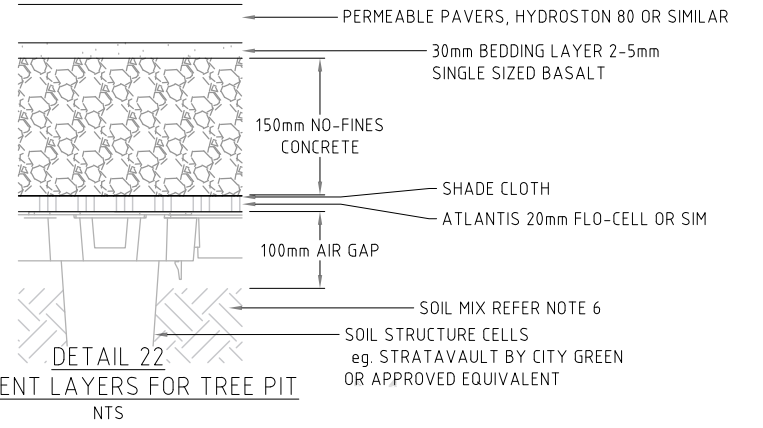


NOT TO SCALE	LIST OF REVISIONS	AMENDMENT DETAILS	APPROVED - Manager Technical Services	LOCATIONS	SERVICES	<p>ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet &amp; College Avenue)</p> <p>POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529</p> <p>PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE</p>	<p><b>PLAN DETAILS</b></p> <p><b>SCC STANDARD DRAWING</b></p>		FILE:	REVISION
	<p>DESIGNED: _____</p> <p>DATE: _____</p> <p>DRAWN: _____</p> <p>DATE: _____</p>	<p>SEDIMENT AND EROSION CONTROL</p> <p>Provide sediment and erosion control measures in accordance with the 'Erosion &amp; Sediment Control' guide by the NSW Office of Environment &amp; Heritage</p>	<p>Services shown are those known to exist at date of design. Prior to commencement of excavation contact the relevant gas, electricity, water and telecommunications service providers, including the RMS, for most recent service locations and precautions that may be necessary</p>	<p>Gas: — G —</p> <p>Electricity: — E —</p> <p>Water: — W —</p> <p>Sewer: — S —</p> <p>TelComm Local Cable: — T —</p> <p>TelComm Major or Optic Fibre: — MOF —</p>	<p>FILE: SCC BIORETENTION - TOWN CENTRES</p>		<p>REVISION</p>			
<p>SURVEYED OFFICER: _____</p> <p>DATE: _____</p> <p>SURVEY MARKS: _____</p>	<p>REV. DATE OFFICER</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p>					<p>PLAN No:</p>	<p>SHEET:</p>	<p>18/25</p>		









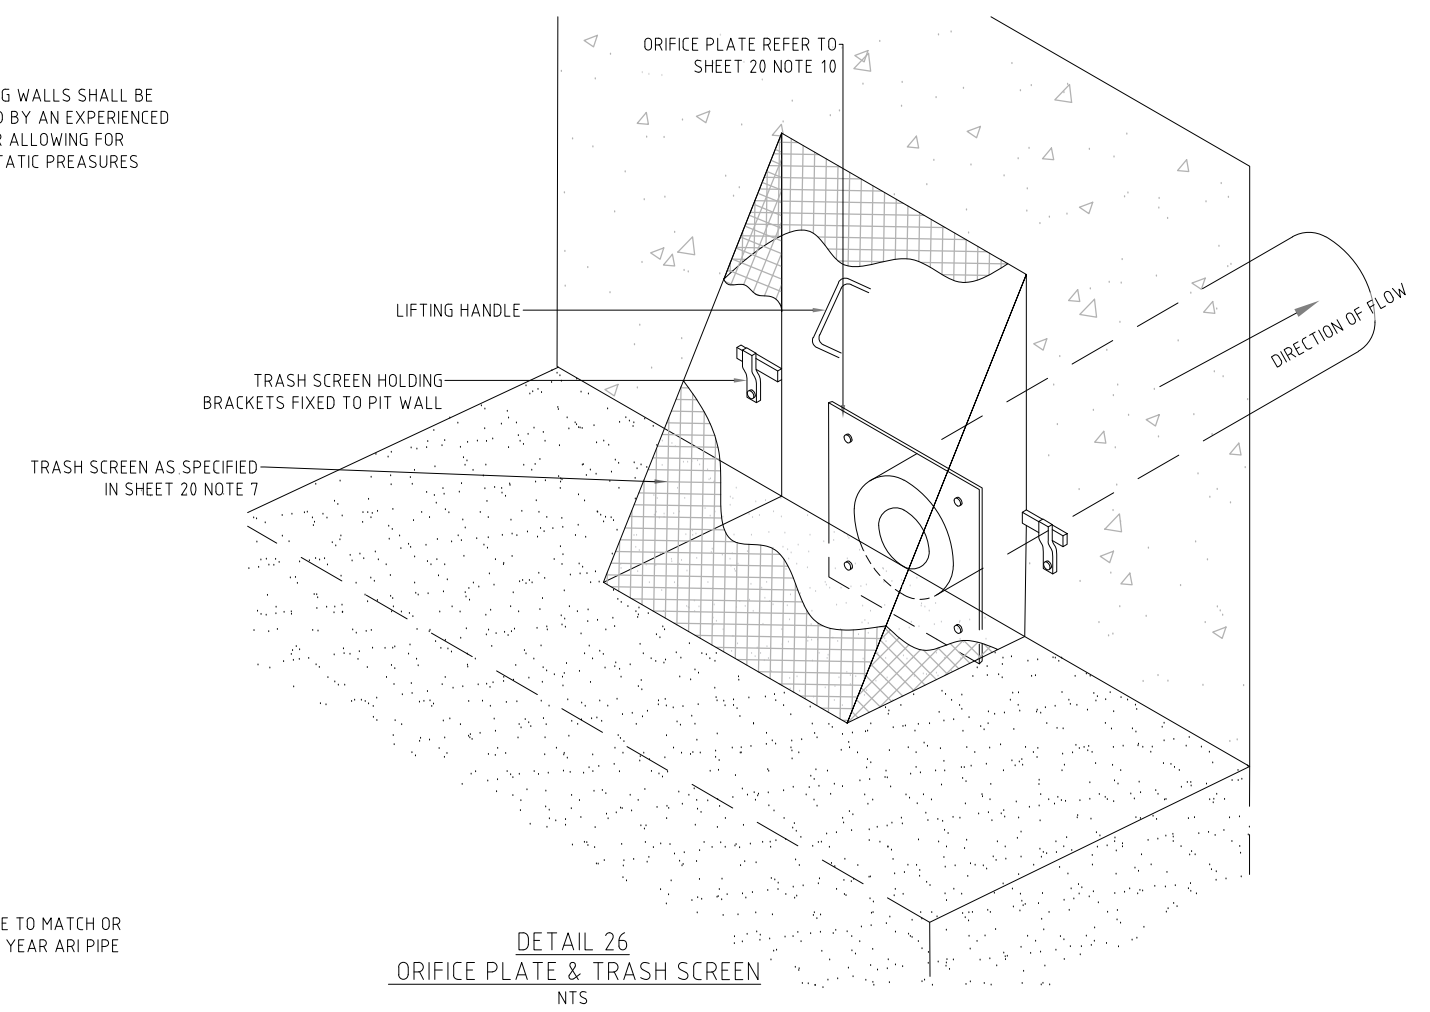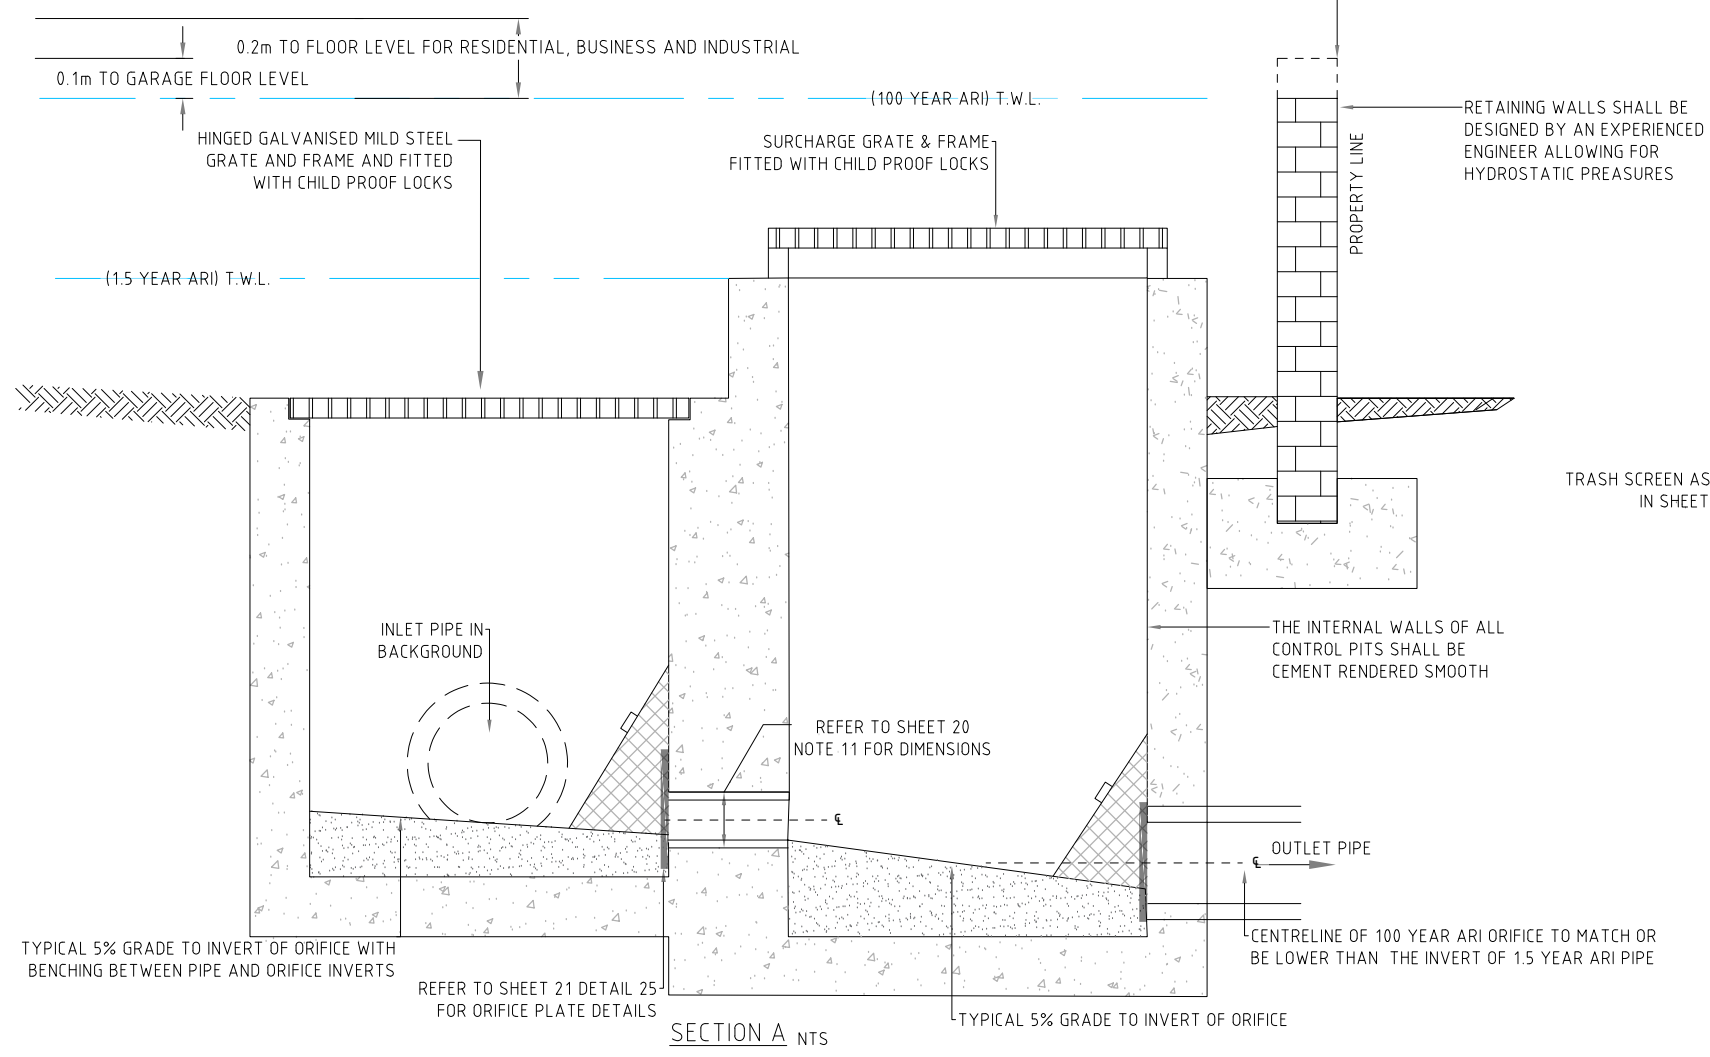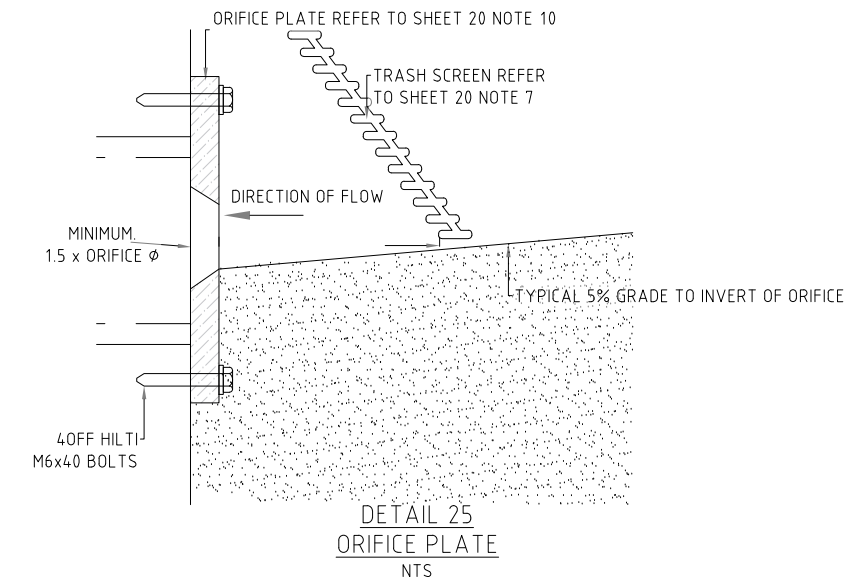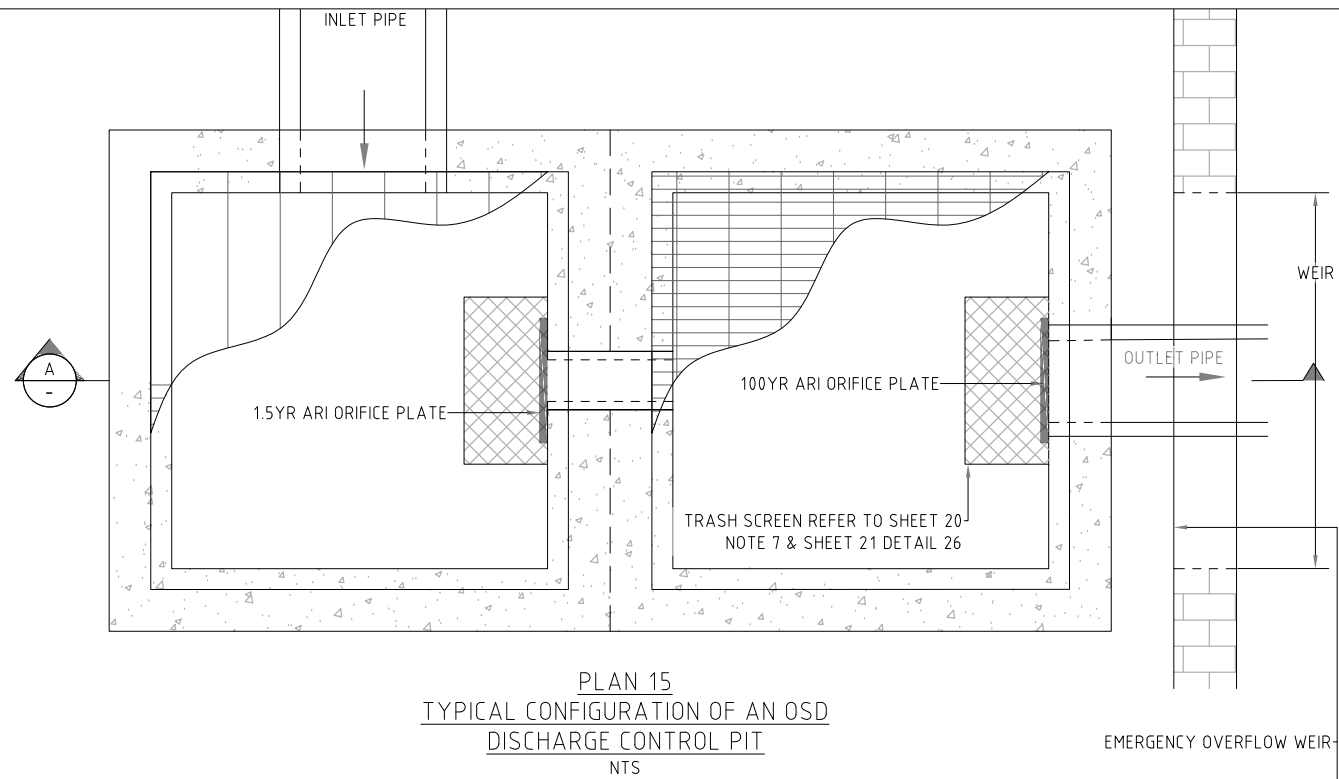

<b>NOT TO SCALE</b> SURVEYED OFFICER: _____ DATE: _____ SURVEY MARKS: _____	<b>LIST OF REVISIONS</b> REV. DATE OFFICER _____ _____ _____	<b>AMENDMENT DETAILS</b> _____ _____	<b>APPROVED - Manager Technical Services</b> DATE: _____ DESIGNED: _____ DATE: _____ DRAWN: _____ DATE: _____	<b>LOCATIONS SERVICES</b> Services shown are those known to exist at date of design. Prior to commencement of excavation contact the relevant gas, electricity, water and telecommunications service providers, including the RMS, for most recent service locations and precautions that may be necessary. <b>LEGEND</b> Gas: — G — Electricity: — E — Water: — W — Sewer: — S — TelComm Local Cable: — T — TelComm Major or Optic Fibre: — MOF —	 ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet & College Avenue) POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529 PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE	<b>PLAN DETAILS</b> <b>SCC STANDARD DRAWING</b>	FILE: SCC OSD - ABOVE GROUND STORAGE PLAN No: _____	REVISION SHEET: 21/25
	<b>SEDIMENT AND EROSION CONTROL</b> Provide sediment and erosion control measures in accordance with the 'Erosion & Sediment Control' guide by the NSW Office of Environment & Heritage							





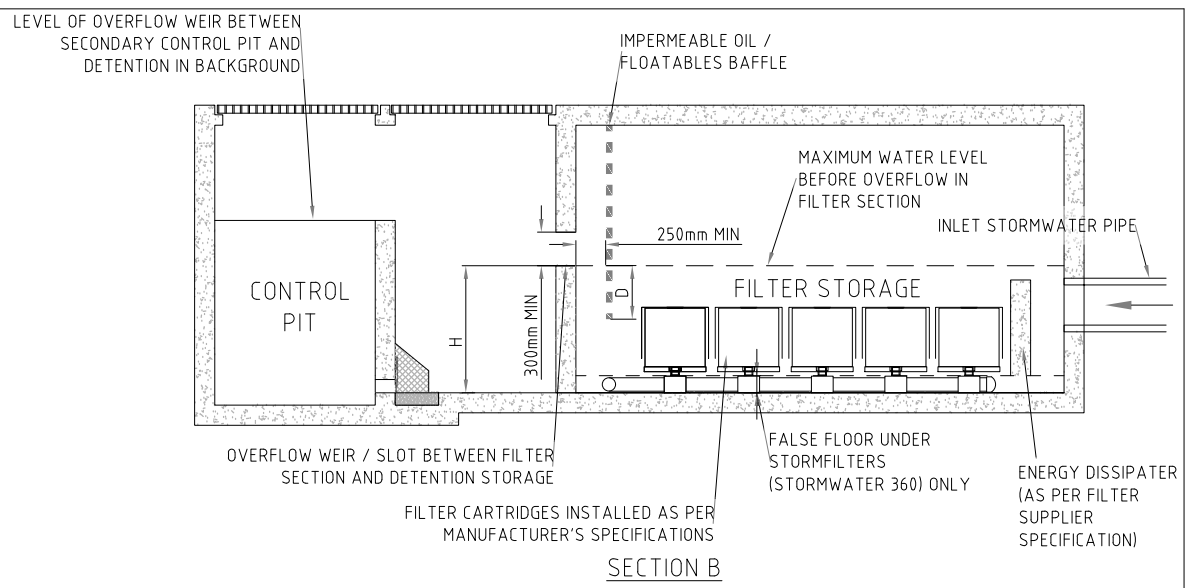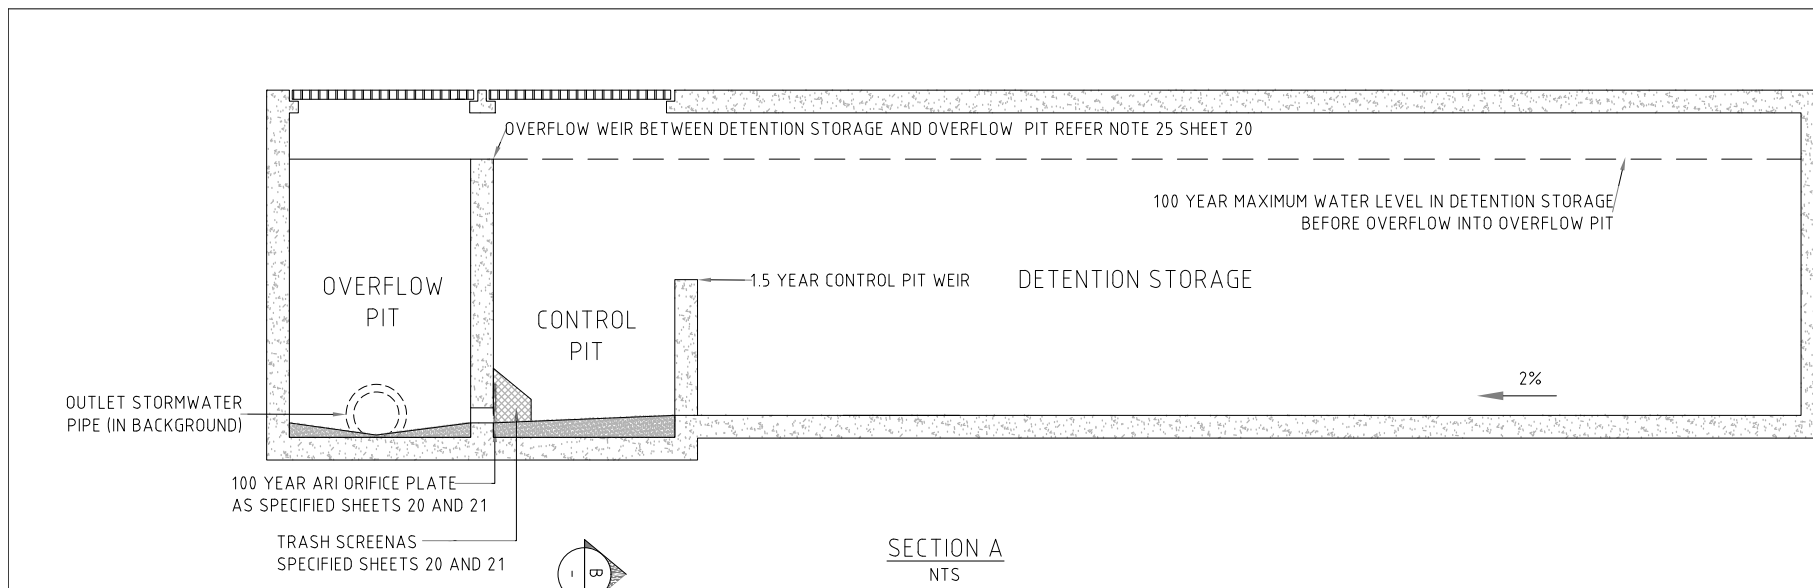

**DESIGN NOTES:**

1. THE FILTER TANK STORAGE IS CONSIDERED AS PART OF THE 1.5 YEAR ARI DETENTION STORAGE.
2. COMBINED OSD & FILTER CARTRIDGE SYSTEMS SHALL COMPLY WITH THE STORAGE VOLUME AND DISCHARGE REQUIREMENTS DOCUMENTED ON SHEET 20. THIS REQUIRES THAT ORIFICES BE ADJUSTED TO ACCOUNT FOR THE COMBINED FLOW FROM THE CARTRIDGES AND THE ORIFICES.
3. THE SIZING OF THE 1.5 YEAR ARI ORIFICES NEEDS TO TAKE INTO ACCOUNT THE BYPASS OF WATER THROUGH THE UNDERDRAIN FROM THE FILTER STORAGE USING THE MANUFACTURERS NOMINAL DESIGN FLOW RATES (REFER MANUFACTURER'S SPECIFICATIONS). IF THE MINIMUM ORIFICE SIZE NEEDS TO BE LESS THAN 15mm.
4. IN THE EVENT THAT THE NOMINAL DISCHARGE FROM THE FILTER STORAGE EXCEEDS THE 1.5 YEAR ARI FLOW THEN OMIT THE 1.5 YEAR ARI ORIFICE CONTROL AND GRADE FLOOR OF OSD TANK TO NON-RETURN FLAP.
5. THE SIZING OF THE 100 YEAR ARI ORIFICE NEEDS TO TAKE INTO ACCOUNT THE BYPASS OF WATER FROM THE FILTER CARTRIDGES, THE CARTRIDGE FLOW WILL EXCEED THE NOMINAL DESIGN FLOW RATES DURING EVENTS LARGER THAN A 1.5 YEAR ARI STORM DUE TO ADDITIONAL HEAD ON EACH CARTRIDGE. CONTACT THE MANUFACTURER FOR THE REVISED CARTRIDGE FLOW AT THE 100 YEAR TOP WATER LEVEL.
6. THE ADJUSTED ORIFICE SIZES WILL BE MANUALLY CALCULATED USING THE DIFFERENCE BETWEEN THE FLOW RATES FROM SHEET 20 AND THE CARTRIDGE FLOW RATE.
7. DETAILED DESIGN OF THE DETENTION AND FILTER CARTRIDGE SYSTEM IS TO BE DONE IN ACCORDANCE WITH SPECIFICATIONS FOR ONSITE DETENTION AND THE DETAILED DESIGN SPECIFICATIONS FROM THE CARTRIDGE MANUFACTURER.
8. DIMENSIONS D, H AND WEIR LENGTH (L) IN METRES FOR FLOW ( $Q=m^3/s$ ) (REFER SECTION B ABOVE). FOR DETENTION TANKS Q IS 100 YEAR ARI HOWEVER FOR OFF LINE TREATMENT MINIMUM Q IS 0.75 x 1 YEAR ARI.


FILTER CARTRIDGE	D	H	L
STORMFILTER (690)	400mm	770mm + FALSE FLOOR THICKNESS	10.0 x Q
STANDARD STORMFILTER (460)	300mm	540mm + FALSE FLOOR THICKNESS	13.2 x Q
SMALL STORMFILTER (310)	200mm	390mm + FALSE FLOOR THICKNESS	17.8 x Q
SPEL FILTER EMC - 45N (STANDARD)	450mm	850mm	10.0 x Q
SPEL FILTER EMC - 45L (LOW)	250mm	530mm	13.2 x Q

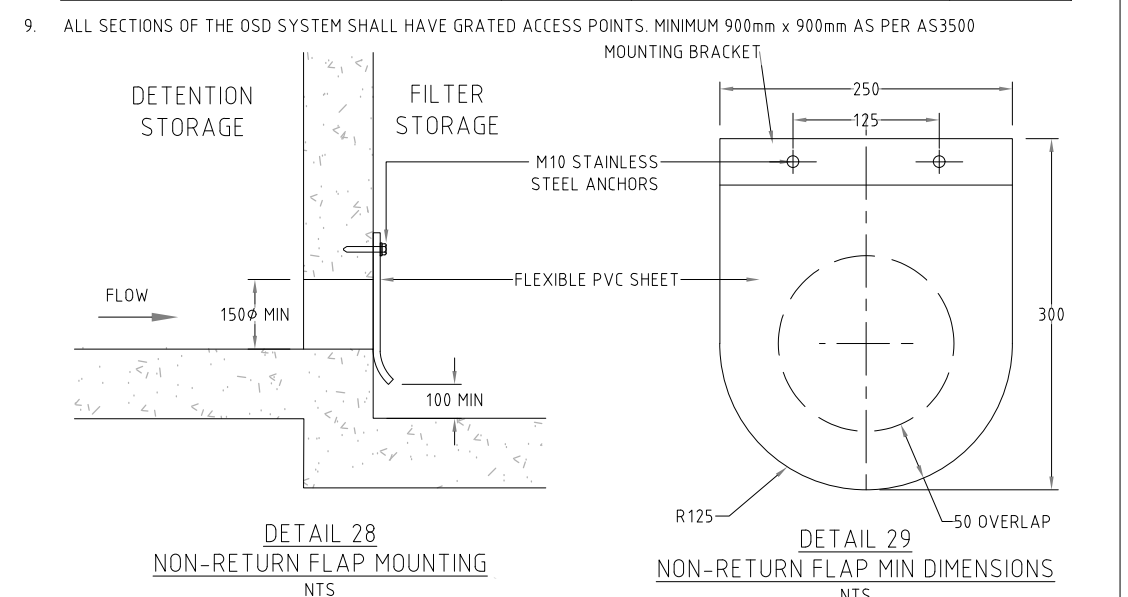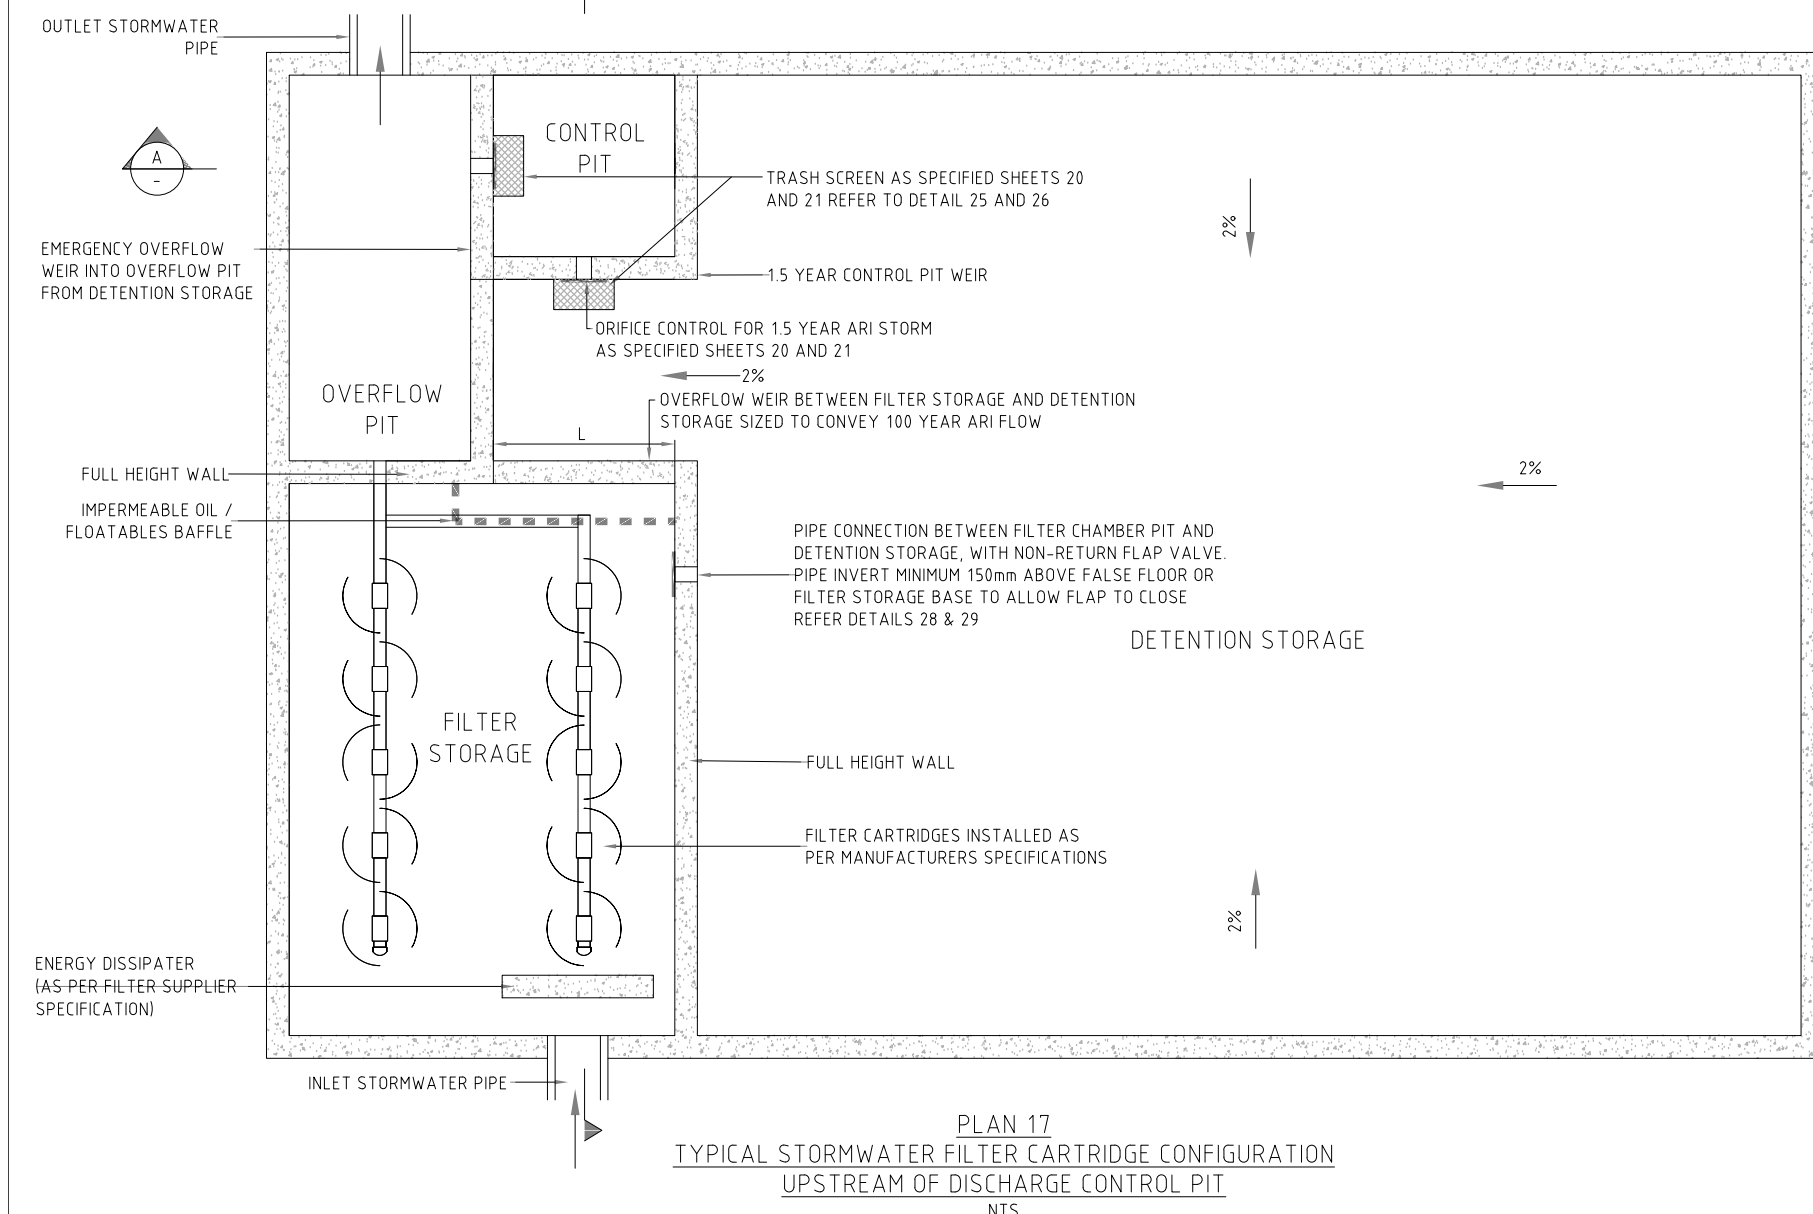

NOT TO SCALE	LIST OF REVISIONS REV. DATE OFFICER	AMENDMENT DETAILS	APPROVED - Manager Technical Services		LOCATIONS	SERVICES	LEGEND		ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet & College Avenue)  POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529 PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE	<h1>PLAN DETAILS</h1> <h2>SCC STANDARD DRAWING</h2>		FILE:	REVISION
			DESIGNED: DATE: DRAWN: DATE:	SEDIMENT AND EROSION CONTROL Provide sediment and erosion control measures in accordance with the 'Erosion & Sediment Control' guide by the NSW Office of Environment & Heritage								Gas: — G — Electricity: — E — Water: — W — Sewer: — S — TelComm Local Cable: — T — TelComm Major or Optic Fibre: — MOF —	SCC OSD - COMBINED OSD & FILTER CARTRIDGES





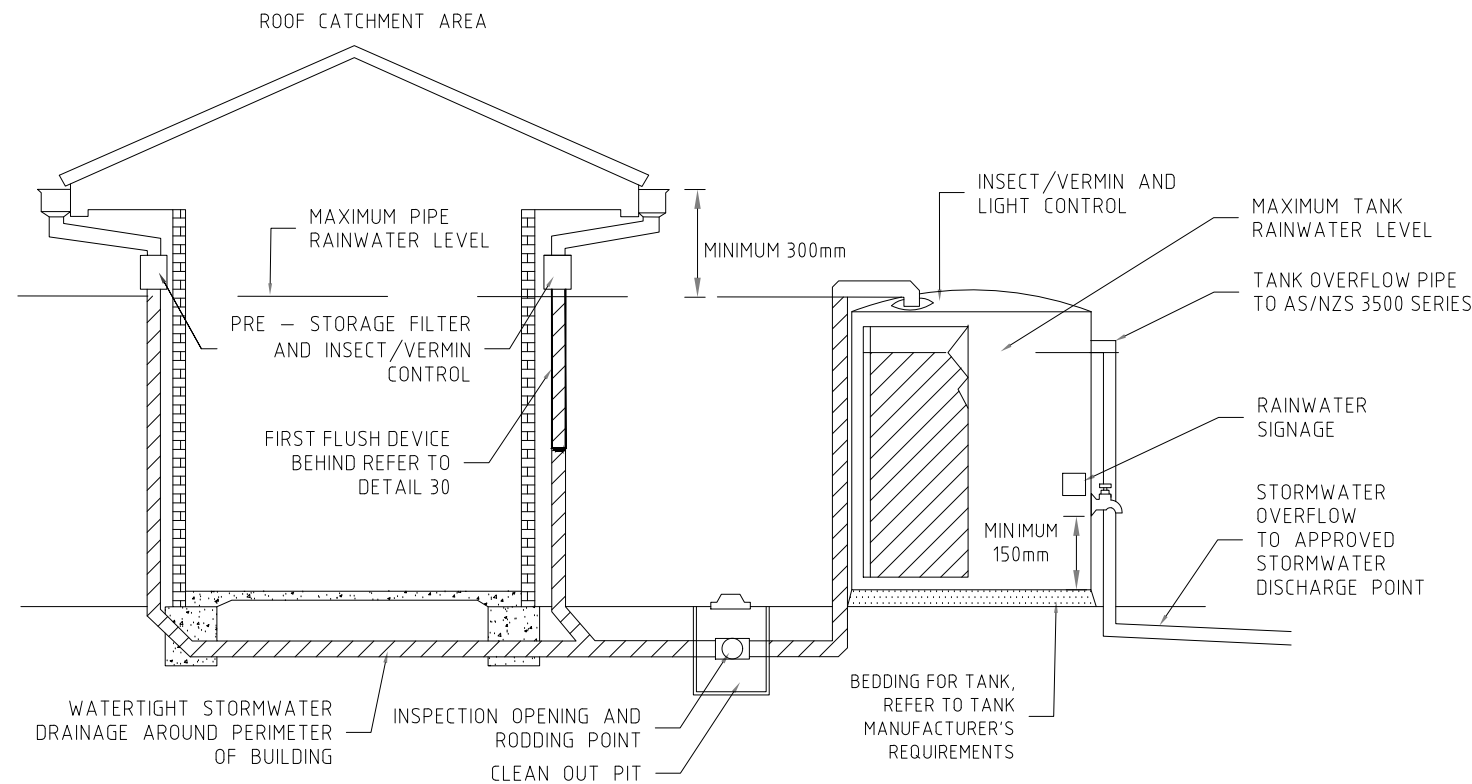

DETAIL 32  
RAINWATER TANK WITH CHARGED LINE  
NTS

**DESIGN NOTES FOR CHARGED SYSTEMS:**

1. CHARGE LINES ARE TO USE TYPE 'P' PRESSURE RATED SOLVENT.
2. SOLVENT SEALED TO UNDERSIDE OF EAVES. PAINT ALL EXPOSED SURFACES OR USE UV STABILISED PIPES.
3. FORCE LOW POINT IN CHARGE LINE TO CLEAN OUT PIT.
4. FOR ISOLATED PIT WITHOUT OUTLET PIPES PROVIDE 4 OFF 5mm Ø SEEPAGE HOLES IN BASE WITH GRAVEL UNDER.

**NOTES FOR RAINWATER TANKS:**

**GENERAL:**

1. THE TANK MAY SUPPLY TOILET, LAUNDRY, HOT WATER & ALL OUTDOOR TAPS.
2. OFF TAKE POINT IS TO BE A MINIMUM OF 150mm ABOVE THE BASE OF THE TANK.
3. FLOAT SWITCH SHALL BE SET TO ACTIVATE MAINS SUPPLY WHEN WATER LEVEL IS 200mm ABOVE BASE OF TANK.

**GENERAL MODELLING REQUIREMENTS:**

- THE FOLLOWING POINTS STIPULATE HOW RAINWATER TANKS ARE TO BE MODELLED IN MUSIC
4. WHERE IRRIGATION IS PROPOSED, IT IS TO BE SCALED USING POTENTIAL EVAPOTRANSPIRATION (PET) MINUS RAINFALL.
  5. ALLOW FOR A LOSS OF 250mm FROM THE BASE OF EACH RAINWATER TANK TO ALLOW FOR SEDIMENT STORAGE SPACE, LOW LEVEL TOP UP AND OVERFLOW.

**RESIDENTIAL MODELLING REQUIREMENTS:**

6. RESIDENTIAL DEVELOPMENT IS SUBJECT TO BASIX AND HAS NO MINIMUM REUSE TARGET.
7. A MINIMUM OF 50% OF RUN OFF FROM THE ROOF AREA IS TO BE DIRECTED TO THE RAINWATER TANK UNLESS THE BASIX CERTIFICATE NOTES OTHERWISE.
8. FOR LOW DENSITY RESIDENTIAL SUBDIVISIONS, ALLOW FOR A TANK SIZE OF 2.25KL ON EACH ALLOTMENT, MODELLED AS A 2.0KL TANK IN MUSIC. ALLOW A SURFACE AREA OF 1.7m<sup>2</sup> FOR TANK PER DWELLING.
9. INDOOR AND OUTDOOR DEMANDS SHALL BE MODELLED IN ACCORDANCE WITH THE FOLLOWING TABLE:

RESIDENTIAL RAINWATER REUSE		
TYPE OF DWELLING & LAND SIZE	INDOOR (L/DAY)	OUTDOOR (kL/YEAR)
DETACHED HOUSE >730m <sup>2</sup>	100	55
DETACHED HOUSE >520m <sup>2</sup> , <730m <sup>2</sup>		45
DETACHED HOUSE >320m <sup>2</sup> , <520m <sup>2</sup>		32
DETACHED HOUSE <320m <sup>2</sup>		25
ROW HOUSES		20
TOWN HOUSES	20	0.4kL/YEAR/m <sup>2</sup> OF LANDSCAPED AREA
APARTMENTS / HOME UNITS		

**BUSINESS AND INDUSTRIAL MODELLING REQUIREMENTS:**

10. COUNCIL REQUIRES A MINIMUM OF 80% NON-POTABLE REUSE TO BE MET THROUGH THE PROVISION OF RAINWATER OR APPROVED NON-POTABLE SOURCES SUCH AS TREATED STORMWATER
11. INDOOR AND OUTDOOR DEMANDS SHALL BE MODELLED IN ACCORDANCE WITH THE FOLLOWING TABLE:

DEVELOPMENT BUSINESS AND INDUSTRIAL WATER USE RATES		
SIZE AND TYPE OF BUILDING	INDOOR (L/DAY)	OUTDOOR (kL/YEAR)
MOTELS	25L/DAY/TOILET IN PRIVATE ROOM 100L/DAY/TOILET IN PUBLIC AREAS	0.4kL/YEAR/m <sup>2</sup>
AGED CARE / HOSPITALS		
OTHER BUSINESS AND INDUSTRIAL	100L/DAY/TOILET OR URINAL	

NOT TO SCALE	LIST OF REVISIONS REV. DATE OFFICER	AMENDMENT DETAILS	APPROVED - Manager Technical Services		LOCATIONS SERVICES LEGEND	<p>ADMINISTRATION CENTRE SHELLHARBOUR CIVIC CENTRE 76 CYGNET AVENUE (Cnr Cygnet &amp; College Avenue)</p> <p>POSTAL ADDRESS Locked Bag 155 SHELLHARBOUR CITY CENTRE NSW 2529</p> <p>PH: (02) 4221 6111 FAX: (02) 4221 6016 DX26402 SHELLHARBOUR CITY CENTRE</p>	FILE: SCC RAINWATER TANK - CHARGED LINE SYSTEMS & MUSIC MODELLING REQUIREMENTS	REVISION
			DESIGNED: DATE:	SEDIMENT AND EROSION CONTROL Provide sediment and erosion control measures in accordance with the 'Erosion & Sediment Control' guide by the NSW Office of Environment & Heritage				